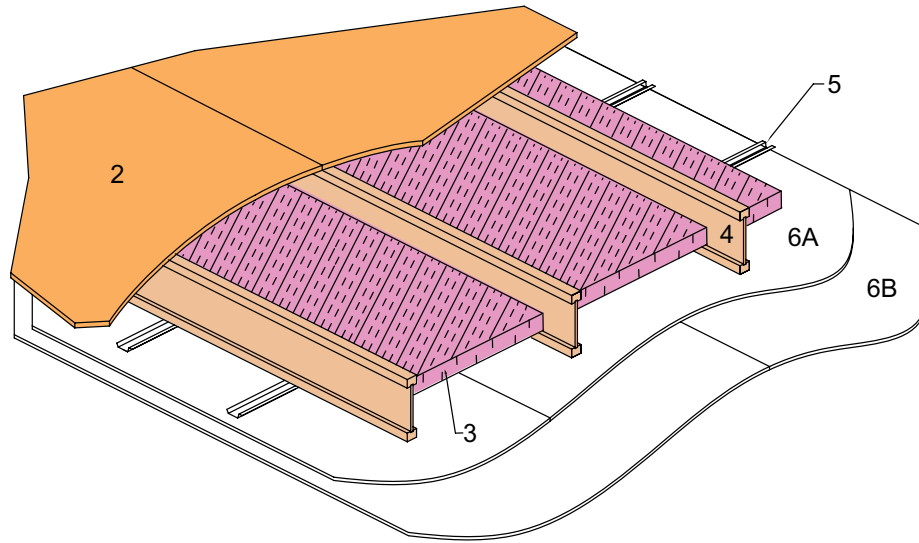


**WIJ-1.7 One-Hour Fire-Resistive Ceiling Assembly**Floor<sup>a</sup>/Ceiling - 100% Design Load - 1 Hour Rating - ASTM E 119 / NFPA 251

- 1. Floor Topping (optional, not shown):** Gypsum concrete, lightweight or normal concrete topping.
- 2. Floor Sheathing:** Minimum 23/32 inch thick tongue-and-groove wood sheathing (Exposure 1). Installed per code requirements with minimum 8d common nails.
- 3. Insulation:** Fiberglass insulation placed between I-joists supported by the resilient channels.
- 4. Structural Members:** Wood I-joists spaced a maximum of 24 inches on center.  
 Minimum I-joist flange depth: 1-1/2 inches      Minimum I-joist flange area: 2.25 inches<sup>2</sup>  
 Minimum I-joist web thickness: 3/8 inch      Minimum I-joist depth: 9-1/2 inches  
 See ASTM D 5055-07 for qualification requirements.
- 5. Resilient Channels:** Minimum 0.019 inch thick galvanized steel resilient channel attached perpendicular to the bottom flange of the I-joists with one 1-1/4 inch drywall screw. Channels spaced a maximum of 16 inches on center [24 inches on center when I-joists are spaced a maximum of 16 inches on center].
- 6. Gypsum Wallboard:** Two layers of minimum 1/2 inch Type X gypsum wallboard attached with the long dimension perpendicular to the resilient channels as follows:
  - 6a. Wallboard Base Layer:** Base layer of wallboard attached to resilient channels using 1-1/4 inch Type S drywall screws at 12 inches on center.
  - 6b. Wallboard Face Layer:** Face layer of wallboard attached to resilient channels through base layer using 1-5/8 inch Type S drywall screws spaced 12 inches on center. Edge joints of wallboard face layer offset 24 inches from those of base layer. Additionally, wallboard face layer attached to base layer with 1-1/2 inch Type G drywall screws spaced 8 inches on center, placed 1-1/2 inches from face layer end joints.
- 7. Finish System (not shown):** Face layer joints covered with tape and coated with joint compound. Screw heads covered with joint compound.

Fire Test conducted at National Research Council of Canada      Report No. A-4219.13.2      March 23, 1998

**STC and IIC Sound Ratings for Listed Assembly**

Without Gypsum Concrete				With Gypsum Concrete			
Cushioned Vinyl		Carpet & Pad		Cushioned Vinyl		Carpet & Pad	
STC	IIC	STC	IIC	STC	IIC	STC	IIC
59	50	55 <sup>b</sup>	68 <sup>b</sup>	65	51	63 <sup>b</sup>	65 <sup>b</sup>

<sup>a</sup> This assembly may also be used in a fire-rated roof/ceiling application, but only when constructed exactly as described.<sup>b</sup> STC and IIC values estimated by David L. Adams Associates, Inc