

2021

EDITION

FDS

FIRE DESIGN SPECIFICATION
FOR WOOD CONSTRUCTION

RECOMMENDED PRACTICE BY



AMERICAN
WOOD
COUNCIL

Updates and Errata

While every precaution has been taken to ensure the accuracy of this document, errors may have occurred during development. Updates or Errata are posted to the American Wood Council website at www.awc.org. Technical inquiries may be addressed to info@awc.org.

On behalf of the industry it represents, AWC is committed to ensuring a resilient, safe, and sustainable built environment. To achieve these objectives, AWC contributes to the development of sound public policies, codes, and regulations which allow for the appropriate and responsible manufacture and use of wood products. We support the utilization of wood products by developing and disseminating consensus standards, comprehensive technical guidelines, and tools for wood design and construction, as well as providing education regarding their application.

FOREWORD

This Specification is a pre-standard for use in designing wood buildings. Its use is intended to complement and not supersede any provision of the applicable building code.

Since 2001, the *National Design Specification® for Wood Construction* (NDS®) has contained provisions in Chapter 16 for design of fire exposed wood members to meet code-required structural fire-resistance ratings based on a standardized ASTM E119 time-temperature exposure. The NDS Chapter 16 provisions apply to exposed timber members of sawn lumber, glued-laminated softwood timber, laminated veneer lumber, parallel strand lumber, laminated strand lumber, and cross-laminated timber. Additional calculation procedures have been developed to address the added fire resistance and thermal benefits of protection using additional wood, gypsum panel products, and some types of insulation. These additional calculation provisions have been developed to provide standardized methods of calculating thermal separation and burn-through requirements as required in ASTM E119 and as provided in AWC's *Technical Report 10: Calculating the Fire Resistance of Exposed and Protected Wood Members* (TR10). The existing design provisions in NDS Chapter 16 and the new protection provisions contained within TR10 have been incorporated in this Specification.

In developing the provisions of this Specification, the most reliable data available from laboratory tests and experience with structures in service have been carefully analyzed and evaluated for the purpose of providing, in convenient form, a national standard of practice. AWC invites and welcomes comments, inquiries, suggestions, and new data relative to the provisions of this document.

It is intended that this Specification be used in conjunction with competent engineering design, accurate fabrication, and adequate supervision of construction. AWC does not assume any responsibility for errors or omissions in the document, nor for engineering designs, plans, or construction prepared from it. Those using this standard assume all liability arising from its use. The design of engineered structures is within the scope of expertise of licensed engineers, architects, or other licensed professionals for applications to a particular structure.

American Wood Council

AWC Fire Design Specification

Chapter 1: General Requirements for Fire Design.....1

1.1 General

1.1.1 Scope

1.1.2 Design Methods

1.1.3 Type of Construction

1.2 Terminology

1.3 Notation

1.4 Material Standards

1.4.1 Wood Products

1.4.1.1 Sawn Lumber

1.4.1.2 Glued Lumber

1.4.1.3 Structural Glued Laminated Timber

1.4.1.4 Prefabricated Wood I-Joists

1.4.1.5 Structural Composite Lumber

1.4.1.6 Prefabricated Wood Trusses

1.4.1.7 Plywood

1.4.1.8 Oriented-Strand Board

1.4.1.9 Particleboard

1.4.1.10 Cross-Laminated Timber

1.4.2 Gypsum Panel Products

1.4.2.1 Gypsum Panel Installation

1.4.2.2 Gypsum Sheathing Installation

1.4.3 Insulation

1.4.3.1 Batts or Blankets

1.4.3.2 Loose-Fill

1.4.4 Fasteners and Connectors

1.4.4.1 Bolts

1.4.4.2 Lag Screws

1.4.4.3 Screws

1.4.4.4 Nails

1.4.4.5 Metal Parts

1.4.4.6 Concrete or Masonry Parts

1.5 Heavy Timber

1.6 Material Combustibility

1.6.1 Noncombustible Materials

1.6.2 Combustible Materials

1.7 Fire-Resistance-Rated Wood Members and Wood Assemblies

1.7.1 Fire-Resistance-Rated Construction

1.7.2 Continuity of Fire-Resistance Rating

1.7.3 Supporting Construction

1.7.3.1 Platform construction

1.7.4 Column Protection

1.7.5 Beam Protection

1.7.6 Truss Protection

1.7.7 Protection of Connections

1.7.8 Intersections of Fire-Resistance Rated Wood Assemblies

1.7.8.1 Fire-resistant joint systems

1.7.8.2 Termination of gypsum panel membranes at ceiling-to-wall intersections

1.7.8.3 Termination of gypsum panel membranes at wall-to-wall intersections

1.7.8.4 Wood members entering concrete or masonry fire walls

1.7.9 Limitations and Protection of Openings

Chapter 2: Ignition & Flammability.....17

2.1 General

2.2 Ignition Resistance

2.3 Flame Spread Performance of Wood Products

2.3.1 Interior wall and ceiling finish materials

2.3.1.1 Interior finish materials tested in accordance with ASTM E84 or UL 723

2.3.1.2 E84 test results for Interior Finishes

2.3.2 Interior floor finish materials

2.3.3 Fire retardant-treated wood

2.3.3.1 Design Values

2.4 Vertical and Lateral Flame Propagation

2.4.1 Exterior Wall Coverings

2.4.1.1 Coverage area

2.4.1.2 Coverage height

2.4.1.3 Fireblocking

2.4.1.4 Top of exterior walls

2.4.1.5 Wood veneers

2.4.2 Building Projections

2.5 Firestopping, Fireblocking and Draftstopping

2.5.1 Firestopping

2.5.2 Fireblocking

2.5.2.1 Fireblocking materials

2.5.2.2 Concealed wall cavities

2.5.2.3 Intersection of concealed spaces

2.5.2.4 Stairways

2.5.2.5 Concealed sleeper spaces

2.5.3 Draftstopping

2.5.3.1 Draftstopping materials

2.5.3.2 Draftstopping in floors

2.5.3.3 Draftstopping in attics

3.2.2.1 Sawn lumber, glued-laminated timbers, laminated veneer lumber, parallel strand lumber, and laminated strand lumber

3.2.2.2 Cross-laminated timber

3.2.3 Effective char depth, a_{eff}

3.2.3.1 Sawn lumber, glued-laminated timbers, laminated veneer lumber, parallel strand lumber, and laminated strand lumber

3.2.3.2 Cross-laminated timber

3.2.4 Member strength

3.2.5 Design of members

3.2.5.1 Special provisions for lumber decking

3.2.5.2 Special provisions for structural glued laminated timber beams

3.3 Protection of Structural Wood Members and Wood Assemblies

3.3.1 Protection by wood

3.3.1.1 Wood cover in contact with protected member

3.3.1.2 Wood cover not in contact with protected member

3.3.1.3 Wood membrane

3.3.1.4 Fasteners attaching wood protection

3.3.1.5 Char contraction

3.3.2 Protection by gypsum panel products

3.3.2.1 Gypsum panel cover

3.3.2.2 Gypsum panel membrane

3.3.2.3 Fasteners attaching gypsum panel products

3.3.2.4 Gypsum panel product contraction

3.3.3 Protection by insulation

3.3.3.1 Insulation cover

3.3.3.2 Insulation as part of a membrane

3.4 Calculation of Structural Fire Resistance of Protected Wood Members and Wood Assemblies

3.5 Calculation of Thermal Separation Time

3.5.1 Thermal separation time provided by wood layers

Chapter 3: Fire Resistance.....24

3.1 General

3.1.1 Scope

3.1.2 Fire Exposure

3.1.3 Fire-Resistance Rating

3.1.3.1 Design requirements

3.1.3.2 Reference design values

3.1.3.3 Test loads

3.1.3.4 Design loads

3.2 Calculation of Structural Fire Resistance of Exposed Wood Members

3.2.1 Char rate of exposed wood members

3.2.1.1 Standard char rate

3.2.2 Char depth, a_{char}

3.5.1.1 Wood cover or membranes	3.8.1.1 Fire resistance times for wood members in wood assemblies
3.5.1.2 Char contraction	3.8.1.2 Protection of wood members
3.5.2 Thermal separation time provided by Type X gypsum panel products	3.8.2 Calculating the thermal separation time
3.5.2.1 Gypsum panel cover or membranes	3.8.2.1 Contribution from membranes
3.5.2.2 Gypsum panel product contraction	3.8.2.2 Contribution from insulation
3.5.3 Thermal separation time provided by insulation	3.9 Design of protected wood connections
3.5.3.1 Insulation protection time	3.9.1 Connection protection
3.6 Calculation of Burn-Through Time	3.9.2 Gaps at ends and edges
3.7 Tested Fire-Resistance Rated (FRR) Wood Assemblies	
3.8 Component Additive Method (CAM) for Wood Assemblies	
3.8.1 Calculating the structural fire resistance time	
	<u>References.....43</u>

Commentary to the AWC Fire Design Specification

Chapter C1: General Requirements for Fire Design.....47

C1.1 General

C1.1.1 Scope

C1.1.2 Design Methods

C1.1.3 Type of Construction

C1.2 Terminology

C1.3 Notation

C1.4 Material Standards

C1.4.1 Wood Products

C1.4.2 Gypsum Panel Products

C1.4.3 Insulation

C1.4.4 Fasteners and Connectors

C1.5 Heavy Timber

C1.6 Material Combustibility

C1.6.1 Noncombustible Materials

C1.6.2 Combustible Materials

C1.7 Fire-Resistance-Rated Wood Members and Wood Assemblies

C1.7.1 Fire-Resistance-Rated Construction

C1.7.2 Continuity of Fire-Resistance Rating

C1.7.3 Supporting Construction

C1.7.4 Column Protection

C1.7.5 Beam Protection

C1.7.6 Truss Protection

C1.7.7 Protection of Connections

C1.7.8 Intersections of Fire-Resistance Rated Wood Assemblies

C1.7.9 Limitations and Protection of Openings

Chapter C2: Ignition & Flammability.....55

C2.1 General

C2.2 Ignition Resistance

C2.3 Flame Spread Performance of Wood Products

C2.3.1 Interior wall and ceiling finish materials

C2.3.2 Interior floor finish materials

C2.3.3 Fire retardant-treated wood

C2.4 Vertical and Lateral Flame Propagation

C2.4.1 Exterior Wall Coverings

C2.4.2 Building Projections

C2.5 Firestopping, Fireblocking and Draftstopping

C2.5.1 Firestopping

C2.5.2 Fireblocking

C2.5.3 Draftstopping

Chapter C3: Fire Resistance.....59

C3.1 General

C3.1.1 Scope

C3.1.2 Fire Exposure

C3.1.3 Fire-Resistance Rating

C3.2 Calculation of Structural Fire Resistance of Exposed Wood Members

C3.2.1 Char rate of exposed wood members

C3.2.2 Char depth, a_{char}

C3.2.3 Effective char depth, a_{eff}

C3.2.4 Member strength

C3.2.5 Design of members

C3.3 Protection of Structural Wood Members and Wood Assemblies

C3.3.1 Protection by wood

C3.3.2 Protection by gypsum panel products

C3.3.3 Protection by insulation

C3.4 Calculation of Structural Fire Resistance of Protected Wood Members and Wood Assemblies

C3.5 Calculation of Thermal Separation Time

C3.5.1 Thermal separation time provided by wood layers

C3.5.2 Thermal separation time provided by gypsum panel products	C3.8.1 Calculating the structural fire resistance time
C3.5.3 Thermal separation time provided by insulation	C3.8.2 Calculating the thermal separation time
C3.6 Calculation of Burn-Through Time	C3.9 Design of protected wood connections
C3.7 Tested Fire-Resistance Rated (FRR) Wood Assemblies	3.9.1 Connection protection
C3.8 Component Additive Method (CAM) for Wood Assemblies	3.9.2 Gaps at ends and edges
	<u>Commentary References.....77</u>


Supplement to the AWC Fire Design Specification

<u>Supplement A: Flame Spread Performance of Wood Products Used for Interior Finish.....79</u>

<u>Supplement B: Fire-Resistance-Rated Wood-Frame Wall and Floor-Ceiling Assemblies.....85</u>

GENERAL REQUIREMENTS FOR FIRE DESIGN

1



CHAPTER 1: GENERAL REQUIREMENTS FOR FIRE DESIGN

1.1 General

1.1.1 Scope

This standard establishes fire design provisions that apply to all wood products, wood assemblies, and wood connections designed using products in the ANSI/AWC *National Design Specification (NDS) for Wood Construction*, unless otherwise noted.

1.1.2 Design Methods

Design methods in this standard shall be based on the provisions of this document and the fire exposure and acceptance criteria specified in the reference standards in each section.

1.1.3 Type of Construction

For the purpose of this Standard, any reference to the Type of Construction is linked to the fire-resistance ratings, materials, and detailing requirements of the applicable building code.

1.2 Terminology

APPROVED. Acceptable to the authority having jurisdiction.

BURN-THROUGH. The passage of hot gases or flames between or through wood members or wood assemblies which are intended to provide thermal separation.

BURN-THROUGH TIME. The period of time before burn-through occurs between or through wood members or wood assemblies during an ASTM E119 fire resistance test or determined using design methods in Chapter 3 which are based on ASTM E119 tests.

COMBUSTIBLE MATERIALS. Materials that ignite and burn when exposed to fire.

CROSS-LAMINATED TIMBER (CLT). A prefabricated engineered wood product consisting of at least three layers of sawn lumber or structural composite lumber where the adjacent layers are cross-oriented and bonded with structural adhesive to form a solid wood panel.

DOUBLE-STUD WALL. Framing method where two stud wall frames are set next to each other on common plates.

DOUBLE WALL. Framing method where two walls are set next to each other.

DRAFTSTOPPING. Material or construction installed to restrict the movement of air and hot gases between concealed spaces within floor-ceiling assemblies and within an attic.

EXTERIOR WALL. A loadbearing or non-loadbearing wall that is used as enclosing wall for a building, and that has a slope of 60 degrees or greater relative to the horizontal plane, and which has specific requirements for continuity and opening protection.

EXTERIOR WALL COVERING. A material, member, or assembly applied on the exterior side of exterior walls for aesthetics, as a weather-resisting barrier, or as insulation (e.g. cladding,

siding, exterior insulation and finish systems, architectural trim and embellishments such as cornices, soffits, facias, gutters and leaders).

FIRE AREA. The aggregate floor area which is used to determine requirements for a fire protection system and which is enclosed and bounded by exterior walls, fire walls, fire barriers, or horizontal assemblies of a building, including areas of the building not provided with surrounding walls that are within the horizontal projection of the adjacent roof or floor above.

FIRE BARRIER. An interior fire-resistance-rated wall that is used to separate interior building areas into fire areas according to hazards associated with function, for means of egress protection or, for purposes of building compartmentalization, and which has specific requirements for continuity and opening protection.

FIRE PARTITION. An interior fire-resistance-rated wall that is used to separate interior spaces according to hazard associated with function, and which has specific requirements for continuity and opening protection.

FIRE PROTECTION SYSTEM. Approved devices, equipment and systems or combinations of systems used to detect a fire, activate an alarm, extinguish, or control a fire; control or manage smoke and products of a fire; or any combination thereof.

FIRE RESISTANCE. The ability of a material, member, or assembly to perform its structural function or to slow or prevent the passage of excessive heat, hot gases, or flames during fire exposure.

FIRE-RESISTANCE-RATED. Having a fire-resistance rating assigned based on ASTM E119 fire resistance testing or as determined using design methods in Chapter 3 which are based on ASTM E119 tests.

FIRE-RESISTANCE RATING (FRR). The period of time a material, member, or assembly performs its structural function and, where required, prevents the passage of excessive heat, hot gases, or flames during an ASTM E119 fire resistance test or as determined using design methods in Chapter 3 which are based on ASTM E119 tests.

FIRE RETARDANT-TREATED WOOD (FRTW). Wood products that are treated with chemicals to reduce surface-burning characteristics and resist propagation of fire.

FIRE SEPARATION DISTANCE (FSD). The minimum perpendicular distance measured from the building exterior wall to the closer of:

- a. the closest interior lot line; or
- b. the centerline of a street, an alley or public right-of-way; or
- c. an imaginary line between two buildings on the same lot.

FIRE WALL. A fire-resistance rated wall that is used to provide total separation between adjacent or attached buildings, which extends vertically from the foundation to the roof or beyond, extends horizontally between or beyond exterior walls, and which has specific requirements for opening and penetration protection.

FIREBLOCKING. Material or construction installed to restrict the passage of flames within and between concealed spaces.

FIRESTOPPING. Material, device, or system that is used to prevent the spread of fire through an opening for a specified period of time.

- **Fire-Resistant Joint System.** An assemblage of materials and/or devices that is designed, tested, and approved to resist passage of fire through design joints between fire-resistance-rated assemblies.
- **Membrane-Penetration Firestop System.** An assemblage of materials and/or devices that is designed, tested, and approved to resist passage of fire through an opening in a membrane of a fire-resistance-rated assembly.
- **Through-Penetration Firestop System.** An assemblage of materials and/or devices that is designed, tested, and approved to resist passage of fire through an opening in a fire-resistance-rated assembly.

GLUED LUMBER. A product that is manufactured by end-gluing, edge-gluing, or face-gluing pieces of sawn lumber.

GYPSUM PANEL PRODUCTS. A family of sheet products consisting of a noncombustible core primarily of gypsum, includes Glass Mat Gypsum Panel and Gypsum Board. Both product lines are available as fire-rated (Type X).

- **Gypsum Board.** A line of sheet products consisting of a noncombustible core primarily of gypsum and manufactured with paper facers. Gypsum board includes gypsum wallboard, gypsum sheathing board, gypsum backing board, exterior gypsum soffit board, gypsum ceiling board, gypsum lath, and gypsum base for veneer plaster.
- **Glass Mat Gypsum Panel.** A gypsum panel product with glass mat facers.
- **Gypsum Sheathing.** A gypsum board or glass mat gypsum panel product intended as a backing for exterior surface materials.

HEAVY TIMBER (HT). Wood members or assemblies of wood members of minimum dimensions based on application (see Section 1.5).

HORIZONTAL ASSEMBLY. A fire-resistance-rated floor or roof assembly in which penetrations and openings are restricted or required to be protected.

INTERIOR FINISH. The exposed surfaces of the interior of a room including the surfaces of interior walls, partitions, ceilings and floors.

INTERIOR FLOOR FINISH. The exposed floor surfaces of buildings.

- **Interior Floor Coverings.** Loose-laid interior floor finish materials, such as carpet and vinyl, that are used to cover floors, including other interior floor finishes.

JOINT. An opening between fire-resistance-rated assemblies designed to allow independent movement of the building in any plane caused by thermal, seismic, wind, or other loading condition.

MECHANICALLY-LAMINATED TIMBER (MLT). A structural assembly of lumber members set on edge, in contact with adjacent pieces, and attached with mechanical fasteners. Nail-laminated timber (NLT) and mechanically-laminated decking are common types of mechanically-laminated timber.

MINERAL FIBER INSULATION. Insulation type including fiberglass insulation and mineral wool insulation.

- **Fiberglass insulation (glass wool or fibrous glass)** - Insulation composed of synthetic vitreous fibers made by melting predominately silica sand and other inorganic materials, and then physically forming the melted materials into fibers.
- **Mineral wool insulation** - Insulation composed of synthetic vitreous fibers made by melting predominately igneous rock or furnace slag, and other inorganic materials, and then physically forming the melted materials into fibers.

NONCOMBUSTIBLE MATERIALS. Materials that do not ignite or burn when exposed to fire, and composite materials having a core of material(s) that does not ignite or burn when exposed to fire and a finish of combustible material that meets certain performance requirements(e.g. Type X gypsum wallboard).

PARTICLEBOARD. A composite panel product composed primarily of wood or other cellulosic particles bonded together with adhesives.

PLATFORM CONSTRUCTION. Construction where the floor structure is supported by exterior and interior bearing walls below and supports exterior and interior bearing walls above.

PROJECTION. Construction that extends beyond an exterior wall such as cornices, eave overhangs, and exterior balconies.

PROTECTION. Materials used to increase the fire resistance of structural wood members and connections.

- **COVER.** A sacrificial layer of a material, such as wood or a gypsum panel product, that is used to protect a surface of an underlying structural wood member and/or connection from direct fire exposure for a specified time (e.g. wood boards or gypsum panel products directly attached to a wood beam).
- **MEMBRANE.** A sacrificial layer typically composed of panels, such as wood structural panels or gypsum panels, that protects an assembly from direct fire exposure for a specified time (e.g. gypsum wallboard ceiling used to protect a floor-ceiling assembly).

SAWN LUMBER. A product that is manufactured from trees by sawing wood logs.

SMOKE BARRIER. A building element such as a wall, floor, ceiling, or other continuous membrane or assembly, either vertical or horizontal, that is designed and constructed to restrict the movement of smoke.

SMOKE PARTITION. A wall assembly that extends from the top of the foundation or floor below to the underside of the floor or roof sheathing, deck, or slab above or to the underside of the ceiling above where the ceiling membrane is constructed to limit the movement of smoke.

STAGGERED-STUD WALL. Framing method that aligns adjacent studs with opposite edges of wide top and bottom plates to prevent the membranes on each side of the wall from being attached to common studs.

STRUCTURAL COMPOSITE LUMBER (SCL). A group of engineered wood structural products that are bonded with an exterior adhesive. Types of structural composite lumber covered under this designation in this standard are:

- **Laminated veneer lumber (LVL)** - A composite of wood veneer sheet elements in which the wood veneer thicknesses do not exceed 0.25" and the wood fiber is primarily oriented along the length of the member.

- **Parallel strand lumber (PSL)** – A composite of wood strand elements in which the least dimension of the strands does not exceed 0.25", the average length of the strands is a minimum of 150 times the least dimension, and the wood fibers are primarily oriented along the length of the member.
- **Laminated strand lumber (LSL)** - A composite of wood strand elements in which the least dimension of the strands does not exceed 0.10", the average length of the strands is a minimum of 150 times the least dimension, and the wood fibers are primarily oriented along the length of the member.
- **Oriented strand lumber (OSL)** - A composite of wood strand elements in which the least dimension of the strands does not exceed 0.10", the average length of the strands is a minimum of 75 times the least dimension, and the wood fibers are primarily oriented along the length of the member.

STRUCTURAL FIRE-RESISTANCE TIME. The period of time a material, member, or assembly performs its structural function during an ASTM E119 fire resistance test or as determined using design methods in Chapter 3 based on ASTM E119 tests.

STRUCTURAL GLUED LAMINATED TIMBER (Glulam or GLT). An engineered, stress rated product of a timber laminating plant, comprising assemblies of specially selected and prepared wood laminations bonded together with adhesives. The grain of all laminations is approximately parallel longitudinally. The separate laminations do not exceed 2" in net thickness and are permitted to be composed of:

- one piece
- pieces joined end-to-end to form any length
- pieces placed or glued edge-to-edge to make wider ones
- pieces bent to curved form during gluing

THERMAL SEPARATION TIME. The period of time a material, member, or assembly prevents the passage of excessive heat, hot gases, or flames during an ASTM E119 fire resistance test or as determined using design methods in Chapter 3 which are based on ASTM E119.

TYPE OF CONSTRUCTION (TOC). Classification system used in building codes to establish permitted materials, fire-resistance ratings, and to set detailing requirements for building elements and assemblies.

WOOD ASSEMBLY. A wood structural framing system that combines wood members and other materials to create assemblies such as walls, floors, and roofs.

WOOD I-JOIST (prefabricated wood I-joist). A structural member composed of sawn or structural composite lumber flanges and wood structural panel webs bonded together with exterior exposure adhesives, forming an "I" cross-sectional shape.

WOOD MEMBER. A wood element or interconnected elements used to transfer loads through the structure or to provide support for attached non-structural elements, such as insulation and finish materials. A wood member may consist of one element (e.g. solid beam or column) or multiple elements (e.g. truss, built-up beam, or built-up column).

WOOD STRUCTURAL PANEL (WSP). A wood-based panel product bonded with a waterproof adhesive. Types of wood structural panels covered under this designation in this standard are:

- **Plywood** - A panel composed of wood veneer plies arranged and bonded in cross-aligned layers.
- **Oriented strand board (OSB)** – A mat-formed panel composed of thin rectangular wood strands arranged in cross-aligned layers with surface layers normally arranged in the long panel direction and bonded with waterproof adhesive.
- **Composite panels** – A panel composed of wood veneer and reconstituted wood-based material and bonded with waterproof adhesive.

WOOD TRUSS. Engineered frames constructed of wood structural components (and possibly other materials) joined together in triangular shapes using metal connector plates, timber connectors, plywood gussets, or by other means.

1.3 Notation

Except where otherwise noted, the symbols used in this Specification have the following meanings:

C_D	= ASD load duration factor
F_b	= reference bending design value, psi
F_{bE}	= critical buckling design value for a bending member, psi
F_c	= reference compression parallel to grain design value, psi
F_{cE}	= critical buckling design value for a compression member, psi
$F_{c\perp}$	= reference compression perpendicular to grain design value, psi
F_t	= reference tension parallel to grain design value, psi
F_v	= reference shear design value, psi
K_F	= LRFD format conversion factor
a_{char}	= char depth, in.
a_{eff}	= effective char depth, in.
d_p	= thickness of the protective layer of wood, in.
h_{lam}	= thickness of a CLT lamination where all laminations are of equal thickness, in.
$h_{lam,i}$	= thickness of individual lamination where lamination thicknesses vary, in.
n_{lam}	= number of CLT laminations fully charred
t	= exposure time to standardized time-temperature curve from ASTM E119, hr
t_{gl}	= time for char front to reach glued interface where all laminations are of equal thickness, hr
$t_{gl,i}$	= time for char front to reach glued interface where lamination thicknesses vary, hr
t_p	= protection time (minutes)
w_D	= wood member or wood assembly dead load
w_S	= wood member or wood assembly superimposed load for use in ASTM E119 testing or ASD design
w_T	= wood member or wood assembly total load for use in ASTM E119 testing or ASD design
w_{T-LRFD}	= wood member or wood assembly total load for strength (LRFD) design
β_t	= non-linear char rate constant, in./hr ^{0.813}
β_n	= nominal char rate constant, in./hr
λ	= LRFD time effect factor
ϕ	= LRFD resistance factor

1.4 Materials Standards

The provisions of this standard are not intended to prevent the use of any material or method of construction not specifically prescribed herein, where it is demonstrated by experience, modeling, or testing by an approved agency, that a product or procedure provides equivalent or greater fire safety. Alternative materials and methods shall be subject to approval by the authority having jurisdiction.

1.4.1 Wood Products

Sawn lumber, glued lumber, structural glued laminated timber, prefabricated wood I-joists, structural composite lumber, prefabricated wood trusses, and panel and siding products, shall conform to the applicable standards or grading rules, including marking requirements specified in 1.4.1.1 through 1.4.1.10.

1.4.1.1 *Sawn Lumber*: Sawn lumber used for load-bearing purposes shall meet the provisions of U.S. Department of Commerce Voluntary Product Standard 20 (PS20) *American Softwood Lumber Standard*. Each piece shall be identified by the grademark of a lumber grading or inspection agency accredited by the American Lumber Standards Committee (ALSC). The grademark shall include an easily distinguishable mark or insignia of the accredited agency in accordance with the requirements of PS20.

1.4.1.2 *Glued Lumber*. Glued lumber used for load-bearing purposes shall meet the provisions of PS20. Each piece shall be identified by the grademark of a lumber grading or inspection agency accredited by ALSC. The grademark shall include an easily distinguishable mark or insignia of the agency in accordance with the requirements of PS20 and the ALSC *Glued Lumber Policy*. The grademark shall include an indication that glued joint integrity is subject to quality control by the accredited agency.

1.4.1.2.1 End-jointed (finger-jointed) lumber used in fire-resistance-rated assemblies shall be manufactured with heat-resistant adhesives (HRA) meeting the requirements of the American Lumber Standard Committee *Glued Lumber Policy* or with adhesives complying with ANSI 405 *Standard for Adhesives for Use in Structural Glued Laminated Timber*. The grademark shall include the designation “Heat-Resistant Adhesive” or “HRA” or “Adhesives Meet ANSI 405”.

1.4.1.2.2 Face-glued and Edge-glued lumber used in fire-resistance-rated assemblies shall be manufactured with adhesives complying with ANSI 405 *Standard for Adhesives for Use in Structural Glued Laminated Timber*. The grademark shall include the designation “Adhesives Meet ANSI 405.”

1.4.1.3 *Structural Glued Laminated Timber*: Structural glued laminated timber shall meet the provisions of ANSI A190.1 *Structural Glued Laminated Timber*. Each piece shall be identified with the trademark of an accredited inspection agency in accordance with the requirements of ANSI A190.1.

1.4.1.4 *Prefabricated Wood I-Joists*: Prefabricated wood I-joists shall meet the provisions of ASTM D5055 *Standard Specification for Establishing and Monitoring Structural Capacities of Prefabricated Wood I-Joists*. Each piece shall be identified with the trademark of an accredited inspection agency in accordance with the requirements in ASTM D5055.

1.4.1.5 *Structural Composite Lumber*: Structural composite lumber used in applications covered by this standard shall meet the provisions of ASTM D5456 *Standard Specification for*

Evaluation of Structural Composite Lumber Products. Each piece shall be identified with the trademark of an accredited inspection agency in accordance with the requirements in ASTM D5456.

1.4.1.6 Prefabricated Wood Trusses: Prefabricated wood trusses used in applications covered by this standard shall meet the provisions set forth in ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction*, the truss design drawings, or the manufacturer's code evaluation report.

1.4.1.7 Plywood: Plywood shall meet the provisions of U.S. Department of Commerce Voluntary Product Standard 1 (PS1) *Structural Plywood*, U.S. Department of Commerce Voluntary Product Standard 2 (PS2) *Performance Standard for Wood-Based Structural-Use Panels*, or applicable code evaluation reports. Each panel shall be identified for grade, bond classification, and Performance Category by the trademarks of an approved testing and grading agency. The Performance Category value shall be used as the "nominal panel thickness" whenever referenced in this standard.

1.4.1.8 Oriented-Strand Board (OSB): Oriented-strand board shall meet the provisions of PS2 or applicable code evaluation reports. Each panel shall be identified for grade, bond classification, and Performance Category by the trademarks of an approved testing and grading agency. The Performance Category value shall be used as the "nominal panel thickness" whenever referenced in this standard.

1.4.1.9 Particleboard: Particleboard shall meet the provisions of ANSI A208.1 *Particleboard Standard* and any additional requirements as set forth in the manufacturer's code evaluation report.

1.4.1.10 Cross-Laminated Timber: Cross-laminated timber shall meet the requirements of ANSI/APA PRG 320.

1.4.2 Gypsum Panel Products

Gypsum board shall conform to ASTM C1396 *Standard Specification for Gypsum Board*. Glass mat gypsum panels used as an exterior substrate for a weather barrier shall conform to ASTM C1177 *Standard Specification for Glass Mat Gypsum Substrate for Use as Sheathing*. Glass mat gypsum panels not used as an exterior substrate for a weather barrier shall conform to ASTM C1658 *Standard Specification for Glass Mat Gypsum Panels*. Gypsum panel products shall be installed as specified in 1.4.2.1 through 1.4.2.2.

1.4.2.1 Gypsum Panel Installation: Regular and Type X gypsum panel products shall be installed in accordance with the provisions of this standard. Where installation requirements for a specific application are not provided in this standard, the gypsum panel products shall be installed in accordance with ASTM C840 *Standard Specification for Application and Finishing of Gypsum Board*.

1.4.2.2 Gypsum Sheathing Installation: Regular and Type X gypsum sheathing shall be installed in accordance with the provisions of this standard. Where installation requirements for a specific application are not provided in this standard, the gypsum sheathing shall be installed in accordance with ASTM C1280 *Standard Specification for Application of Exterior Gypsum Panel Products for Use as Sheathing*.

1.4.3 Insulation

Mineral fiber insulation, including fiberglass and mineral wool, shall conform to the standards specified in 1.4.3.1 for batts or blankets and 1.4.3.2 for loose-fill insulation.

1.4.3.1 *Batts or Blankets*: Mineral fiber thermal insulation batts or blankets shall meet the provisions of ASTM C665 Standard Specification for Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing.

1.4.3.2 *Loose-Fill*: Mineral fiber loose-fill thermal insulation shall meet the provisions of ASTM C764 Standard Specification for Mineral Fiber Loose-Fill Thermal Insulation.

1.4.4 Fasteners and Connectors

Fasteners and connectors shall conform to the standards specified in 1.4.4.1 through 1.4.4.4.

1.4.4.1 *Bolts*: Bolts shall comply with ANSI/ASME B18.2.1 *Square and Hex Bolts and Screws (Inch Series)*.

1.4.4.2 *Lag Screws*: Lag screws or lag bolts shall comply with ANSI/ASME B18.2.1 *Square and Hex Bolts and Screws (Inch Series)*.

1.4.4.3 *Screws*: Screws shall comply with ANSI/ASME B18.6.1 *Wood Screws (Inch Series)*.

1.4.4.4 *Nails*: Nails shall comply with ASTM F1667 *Standard Specification for Driven Fasteners: Nails, Spikes, and Staples*.

1.4.4.5 *Metal Parts*: Metal plates, hangers, and other metal parts shall be designed in accordance with the applicable code-recognized design procedures. Connections between wood members and metal parts shall be designed in accordance with NDS.

1.4.4.6 *Concrete or Masonry Parts*: Concrete footers, walls, and other concrete or masonry parts shall be designed in accordance with the applicable code-recognized design procedures. Connections between wood members and concrete or masonry parts shall be designed in accordance with NDS.

1.5 Heavy Timber

To qualify as Heavy Timber, sawn lumber, structural glued laminated timber, glued lumber, structural composite lumber, cross-laminated timber, mechanically-laminated timber and wood structural panels shall be of the minimum sizes for the applications specified in Tables 1.5.1 and 1.5.2.

Table 1.5.1 Minimum Sizes ² for Heavy Timber Elements

	Material	Minimum Size
Roof decking	• Lumber decking, laid flat and splined or T&G	2x3 ¹
	• Wood structural panels	1-1/8 in., nominal thickness
	• Mechanically-laminated decking, set on edge and fastened to adjacent pieces	2x3 ¹
	• CLT, laid flat and splined, lap-spliced, or T&G	3 in., actual thickness
Floor decking	• Lumber decking, laid flat and splined or T&G; topped with:	3x4 ¹
	- Tongue-and-groove wood plank ³ flooring, laid crosswise or diagonally, or	1x3 ¹
	- Wood structural panels, or	15/32 in., nominal thickness
	- Particleboard panels	1/2 in., actual thickness
	• Mechanically-laminated decking, set on edge and fastened to adjacent pieces; topped with:	2x4 ¹
	- Tongue and groove wood plank ³ flooring, laid crosswise or diagonally, or	1x3 ¹
Roof framing	- Wood structural panels, or	15/32 in., nominal thickness
	- Particleboard panels	1/2 in., nominal thickness
	• CLT, laid flat and splined, lap-spliced, or T&G	4 in. actual thickness
	• Wood ³ arches from the floor line or grade, not supporting floors:	
	- Lower half of the height	6x8 ¹
	- Upper half of the height	6x6 ¹
Floor framing	• Wood ³ arches from the top of walls, not supporting floors	4x6 ¹
	• Wood ³ beams and girders	4x6 ¹
	• Wood ³ trusses ⁴	4x6 ¹
	• Wood roof framing members protected by approved automatic sprinklers under the roof deck	3x6 ¹
	• Wood ³ beams and girders	6x10 ¹
Columns	• Wood ³ arches supporting floors	8x8 ¹
	• Wood ³ trusses	8x8 ¹
	• Wood ³ columns:	
Exterior Walls ⁵	- Supporting floor loads	8x8 ¹
	- Supporting only roof and ceiling loads	6x8 ¹
	• Mechanically laminated decking ³ , assembled and fastened with wide faces in contact and installed with the length of the wood decking members oriented either vertically or horizontally; solid wood wall	2x4 ¹
Interior Walls & Partitions	• CLT	4 in. actual thickness
	• Wood planks ³ , laid flat and splined or T&G	2 layers 1x4 ¹
	• Mechanically laminated decking ³ , assembled and fastened with wide faces in contact and installed with the length of the wood decking members oriented either vertically or horizontally; solid wood wall	2x4 ¹
	• CLT	3 in. actual thickness

¹ See Table 1.5.2 for minimum dimensions of sawn lumber or glued lumber; structural glued laminated timber; and LSL, LVL, or PSL that correspond to these heavy timber nominal sizes.

² "Thickness" refers to cross-sectional dimension perpendicular to fire-exposed face.

³ Wood members include sawn lumber, glued lumber, structural glued laminated timber, LSL, LVL, and PSL. Glued lumber that is end-glued shall use heat-resistant adhesives (HRA).

⁴ Spaced members shall be permitted, where composed of two or more members that are not less than 3x6. The intervening spaces between the 3-inch (nominal) spaced members shall be either entirely filled with blocking or the spaces shall be tightly enclosed by a continuous wood cover plate of 2-inch (nominal) minimum thickness, attached to the fire-exposed edge(s) of the 3-inch (nominal) spaced members. Splice plates shall be not less than 3x6.

Table 1.5.2 Heavy Timber Nominal Sizes and Minimum Dimensions

Heavy Timber Nominal Size	Sawn Lumber or Glued Lumber ¹ Minimum Dimensions		Structural Glued-Laminated Timber Minimum Dimensions		LSL, LVL, or PSL Minimum Dimensions	
	Narrow Face (inches)	Wide Face (inches)	Narrow Face (inches)	Wide Face (inches)	Narrow Face (inches)	Wide Face (inches)
Framing Members						
8x8	7-1/4	7-1/4	6-3/4	8-1/4	7	7-1/2
6x10	5-1/2	9-1/4	5	10-1/2	5-1/4	9-1/2
6x8	5-1/2	7-1/4	5	8-1/4	5-1/4	7-1/2
6x6	5-1/2	5-1/2	5	6	5-1/4	5-1/2
4x6	3-1/2	5-1/2	3	6-7/8	3-1/2	5-1/2
3x6	2-1/2	5-1/2	2-1/2	5-1/2	2-1/2	5-1/2
Lumber Decking Members						
3x4	2-1/2	3-1/2	2-1/2	3-1/2	2-1/2	3-1/2
2x4	1-1/2	3-1/2	--	--	1-1/2	3-1/2
2x3	1-1/2	2-1/2	--	--	1-1/2	2-1/2
Boards						
1x4	3/4	3-1/2	--	--	--	--
1x3	3/4	2-1/2	--	--	--	--

¹ Glued lumber meeting the requirements of ALSC Glued Lumber Policy and, where end-glued, manufactured with heat-resistant adhesives (HRA).

1.6 Material Combustibility

Use of materials shall be in accordance with this section and the applicable building code requirements for the Type of Construction.

1.6.1 Noncombustible Materials

1.6.1.1 Material required to be noncombustible shall be tested in accordance with ASTM E136 and meet the requirements to be classified as noncombustible. A material shall not be classified as a noncombustible material if it is subject to an increase in combustibility or flame spread beyond the limitations herein established through the effects of age, moisture, or other atmospheric conditions.

1.6.1.2 Composite material that has a base layer of noncombustible material, as determined in accordance with 1.6.1.1, and a surface layer of not more than 0.125 inches thick that has a flame spread index not greater than 50 as determined in accordance with ASTM E84 or UL 723, shall be acceptable as noncombustible materials.

1.6.1.3 Material not meeting the requirements of 1.6.1.1 or 1.6.1.2 shall be deemed as combustible material and meet the requirements of 1.6.2.

1.6.2 Combustible Materials

1.6.2.1 Where combustible materials are permitted, they shall comply with the requirements in Chapter 2.

1.7 Fire-Resistance-Rated Wood Members and Assemblies

The required fire-resistance ratings for wood members and assemblies shall be in accordance with this section and the applicable building code requirements for the Type of Construction.

1.7.1 Fire-Resistance-Rated Construction

Fire-resistance ratings for wood members and assemblies shall be established in accordance with Chapter 3.

1.7.2 Continuity of Fire-Resistance Rating

The fire-resistance-rating of a fire-resistance-rated assembly shall be maintained for the full extent of the assembly, as determined in Chapter 3, according to the continuity requirements of the applicable building code and detailing requirements at intersections in 1.7.8.

1.7.3 Supporting Construction

Construction that supports gravity loads from fire-resistance-rated building elements or assemblies shall have a fire-resistance rating that is equal to or greater than the required fire-resistance rating of the supported building elements or assemblies, except as permitted in this chapter and by the applicable building code.

1.7.3.1 Platform construction. In platform construction where a floor-ceiling assembly supports gravity loads from a wall, portions of the floor-ceiling construction that support the wall shall provide at least the same fire-resistance rating as required for the wall. Where a floor-ceiling assembly supports an exterior wall, the material requirements of the floor-ceiling assembly shall be in accordance with requirements for interior building elements for the Type of Construction, including portions of the floor-ceiling construction that support gravity loads from the exterior wall.

1.7.4 Column protection

Wood columns required to have a fire-resistance rating shall be designed in accordance with Chapter 3.

1.7.4.1 A wood column shall meet its required fire-resistance rating for the entire height of the column without consideration of protection from ceiling membranes.

1.7.4.2 Where a wood column is located within a wood wall assembly, protection provided to the wood wall assembly, that also protects the column, shall be permitted to be included in the design of the wood column.

1.7.4.3 Vertical wood members located entirely within a loadbearing wood stud wall assembly shall be considered to have the fire-resistance rating of the wood stud wall assembly without additional protection where the wood member is equal in cross-section size to the wood studs or larger, such as wood columns (including built-up columns), and boundary elements.

1.7.5 Beam protection

Wood beams required to have a fire-resistance rating shall be designed in accordance with Chapter 3.

1.7.5.1 A wood beam shall meet its required fire-resistance rating for the entire span of the beam. For multi-span beams where individual spans have different required fire-resistance ratings, the maximum required fire-resistance rating shall be provided for all spans.

Exception: For multi-span beams where individual spans have different required fire-resistance ratings, and where failure of any individual span would not decrease the fire resistance ratings of the remaining spans, the fire-resistance rating required for each individual span shall be provided.

1.7.5.2 Where a wood beam supports gravity loads from more than two floors, more than one floor and one roof, or a wall more than two stories high, the wood beam shall achieve its required fire-resistance rating without consideration of protection from ceiling membranes.

1.7.5.3 Where a wood beam supports gravity loads from two floors or less, one floor and one roof, or walls not more than two stories high, ceiling membranes that also provide protection to the beam shall be permitted to be included in the design of the beam.

1.7.5.4 Horizontal wood members located entirely within a wood joist floor-ceiling or roof-ceiling assembly and that support gravity loads from one floor or one roof only, shall be considered to have the fire-resistance rating of the wood floor-ceiling or roof-ceiling assembly without additional protection where the wood member is equal in cross-section size to the wood joists or larger, such as wood beams (including built-up beams), and boundary elements.

1.7.6 Truss protection

The fire-resistance rating of wood trusses and wood truss assemblies shall be established based on tests or approved calculations that consider the fire performance of the wood trusses, including connections such as chord splices and web-to-chord connections. Approval shall be based on tests or analyses that demonstrate the fire-resistance of the truss or assembly meets the required fire resistance.

1.7.6.1 A wood truss shall meet its required fire-resistance rating for the entire length of the truss.

1.7.6.2 Where a wood truss supports gravity loads from more than two floors, more than one floor and one roof, or a wall more than two stories high, the wood truss shall achieve its required fire-resistance rating without consideration of protection from ceiling membranes.

1.7.6.3 Where a wood truss supports gravity loads from two floors or less, one floor and one roof, or walls not more than two stories high, ceiling membranes that also provide protection to the truss shall be permitted to be included in the design of the truss.

1.7.7 Protection of Connections

Where a wood member is required to have a fire-resistance rating, wood structural connections of that member shall be protected from fire exposure for the time corresponding to the required fire resistance rating of the wood member. Protection of the wood structural connection shall be established by test or designed in accordance with 3.9. Intersections of fire-resistance-rated wood assemblies shall be in accordance with 1.7.8.

Exception: Wood structural connections tested as part of a fire-resistance-rated assembly shall be considered to have the fire-resistance rating of the assembly without additional protection.

1.7.8 Intersections of Fire-resistance-rated Wood Assemblies

Fire-resistance-rated wood assemblies shall be tightly connected at intersections without voids, gaps, or openings between the assemblies unless such openings are protected with a fire-resistance-rated joint system in accordance with Section 1.7.8.1. Gypsum panel membranes at intersections between horizontal assemblies and walls shall be installed in accordance with Section 1.7.8.2. Gypsum panel membranes at the intersection of fire-resistance-rated walls or at the intersection of a fire-resistance-rated wall with an unrated wall shall be installed in accordance with Section 1.7.8.3. Intersections and abutting edges of fire-resistance-rated mass timber elements shall be sealed against the passage of air with sealants or adhesives meeting the requirements of ASTM C920 or ASTM D3498. Fireblocking shall be installed at intersections of concealed spaces in accordance with Section 2.5.2.

1.7.8.1 *Fire-resistant joint systems.* Where required by the applicable building code, designed joints between separate fire-resistance-rated assemblies shall be protected in accordance with 2.5.1.2.

1.7.8.2 *Termination of gypsum panel membranes at ceiling-to-wall intersections.* At wall-to-ceiling intersections, the ceiling gypsum panel membrane shall be installed first, followed by the wall gypsum panel membrane to ensure that the ceiling gypsum panel membrane is supported by each layer of the wall gypsum panel membrane.

1.7.8.3 *Termination of gypsum panel membranes at wall-to-wall intersections.* At wall-to-wall intersections, the gypsum panel membrane on the wall with a greater fire resistance rating shall be installed first, followed by the gypsum panel membrane on the intersecting wall with a lesser fire-resistance rating. The edges of gypsum panel membranes at wall-to-wall intersections involving fire-resistance-rated walls shall be attached to and fully supported by vertical framing equal in size to the wood studs or larger.


1.7.8.4 *Wood members entering concrete or masonry fire walls.* Where wood structural members are embedded in a concrete or masonry fire wall from opposite sides of the fire wall, there shall be at least 4 inches between the embedded member ends. Where wood members frame into hollow walls or walls of hollow units, the hollow space shall be filled with non-combustible materials that are approved for use as fireblocking and shall fill the full thickness of the wall for a distance not less than 4 inches above, below, and between the embedded ends of members.

1.7.9 Limitations and Protection of Openings

Limitations and protection of openings and penetrations in fire-resistance-rated wood assemblies shall be in accordance with the applicable building code.

IGNITION & FLAMMABILITY

2



CHAPTER 2: IGNITION AND FLAMMABILITY

2.1 General

Chapter 2 specifies ignition and flammability requirements for wood products and provides reference test standards to be used to show compliance with these requirements.

2.2 Ignition Resistance

Where ignition resistance of combustible exterior wall coverings is regulated, materials shall be tested in accordance with NFPA 268 and shall not exhibit sustained flaming when exposed to an incident radiant heat flux of 12.5 kW/m².

Exception: Testing is not required for wood or wood-based products used as exterior wall coverings.

2.3 Flame Spread Performance of Wood Products

2.3.1 Interior wall and ceiling finish materials

2.3.1.1 Where interior wall and ceiling finishes are required to be tested for flame spread and smoke development, materials used in these applications shall be tested in accordance with ASTM E84 or UL723 and shall be classified in accordance with their reported flame spread index (FSI) and smoke developed index (SDI) as indicated by Table 2.3.1.

Table 2.3.1. Material Classification

Class	FSI Range	SDI Range
A	0-25	0-450
B	30-75	0-450
C	80-200	0-450

EXCEPTION: Wood materials tested in accordance with NFPA 286 and complying with the following requirements shall be considered to meet the requirements of Class A:

1. During the 40-kW exposure, flames shall not spread to the ceiling.
2. Flames shall not spread to the outer extremity of the sample on any wall or ceiling.
3. Flashover, as defined in NFPA 286, shall not occur.
4. The peak heat release rate throughout the test shall not exceed 800 kW.
5. The total smoke released throughout the test shall not exceed 1,000 m².

2.3.1.2 As an alternative to 2.3.1.1, the FSI and SDI values and the associated material classifications listed in Supplement A1 shall be permitted to be used for sawn lumber and products manufactured from sawn lumber, such as structural glued laminated timber and cross-laminated timber, of the species tested, and the FSI values and material classifications listed in Supplement A2 shall be permitted to be used for oriented strand board (OSB), hardwood and softwood plywood, particleboard, and medium density fiberboard (MDF) of the listed thicknesses.

2.3.2 Interior floor finish materials

Where interior floor finish materials are required to be classified for fire performance, these materials shall be tested in accordance with ASTM E648 or NFPA 253 and shall meet the requirements of Class I (0.45 watts/cm² or greater) or Class II (0.22 watts/cm² or greater) in accordance with the applicable building code.

2.3.3 Fire retardant-treated wood

Fire retardant-treated wood (FRTW) shall meet the conditions of classification specified in ASTM E2768. FRTW shall be permitted to be manufactured by pressure impregnation, application of a surface coating, or other by means. The chemical treatment or coating shall be durable for the life of the structure.

2.3.3.1 Design values: Design values and treatment adjustment factors for FRTW shall consider both the immediate effects of treatment chemicals and re-drying, and the long-term effects of elevated temperature and humidity on wood properties. Treatment adjustment factors shall consider the wood species and the climatological location where FRTW will be used. All adjustment factors applicable to untreated wood from the NDS shall also apply to FRTW.

2.3.3.1.1 Softwood plywood: Design values for fire-retardant-treated softwood plywood shall be determined based on published design values for untreated softwood plywood determined in accordance with PS1 or PS2, with treatment adjustment factors determined and published by the fire-retardant-treatment manufacturer in accordance with ASTM D5516 and ASTM D6305.

2.3.3.1.2 Sawn Lumber: Design values for fire-retardant-treated sawn lumber shall be determined based on the design values for untreated sawn lumber published by lumber rules writing agencies accredited by the American Lumber Standard Committee under PS20, with treatment adjustment factors determined and published by the fire retardant-treatment manufacturer in accordance with ASTM D5664 and ASTM D6841.

2.3.3.1.3 Laminated Veneer Lumber (LVL): Reference design values and treatment adjustment factors for fire-retardant-treated LVL shall be determined and published by the fire retardant-treated LVL manufacturer in accordance with ASTM D8223.

2.4 Vertical and Lateral Flame Propagation

2.4.1 Exterior Wall Coverings

Where combustible exterior wall coverings are permitted by the Type of Construction and the ignition resistance of the exterior wall covering is regulated, wood or wood-based materials used as wall coverings shall meet the requirements of Sections 2.2, 2.3.3, and this section.

2.4.1.1 Coverage area: Exterior wall coverings of wood or wood-based materials shall not exceed 10% of the exterior wall surface when the fire separation distance is 5 feet or less.

Exception: Where the exterior wall covering is constructed of fire-retardant-treated wood suitable for exterior use, there is no limit of the coverage area.

2.4.1.2 Coverage height: Exterior wall coverings of wood or wood-based materials shall not exceed 40 feet in height above grade.

Exception: Where the exterior wall covering is constructed of fire-retardant-treated wood (FRTW) suitable for exterior use, the exterior wall covering shall not exceed 60 feet in height above grade. Where FRTW exterior wall coverings are used above 40 feet, the exterior wall shall be tested in accordance with and shall comply with the acceptance criteria of NFPA 285.

2.4.1.3 Fireblocking: Where exterior wall coverings or other exterior architectural elements are of wood construction or installed over wood furring or wood, fireblocking meeting the requirements of 2.5.2 shall be installed within concealed spaces between the exterior wall coverings and the exterior walls. The distance between the back of the exterior wall covering and the exterior wall shall not exceed 1-5/8 inches. Fireblocking shall be installed at maximum intervals of 20 feet in either dimension so that there will be no concealed space exceeding 100 square feet between fireblocking. Exterior trim need not be considered as part of the 20-foot interval if the exterior trim sections are separated by at least 4 inches and the ends are closed.

Exception: Fireblocking shall not be required where the exterior wall covering has been tested without the fireblocking and complies with NFPA 285, and the exterior wall covering is installed as tested.

2.4.1.4 Top of exterior walls: exterior wall coverings of wood or wood-based materials shall not extend beyond the top of exterior walls.

2.4.1.5 Wood veneers. Wood veneers used as part of the exterior wall covering shall meet the requirements of this section.

2.4.1.5.1 Wood veneer thickness: Wood veneers shall be not less than 1-inch (nominal) lumber (3/4-inch thickness), 7/16-inch exterior hardboard siding, or 3/8-inch exterior-type wood structural panels or particleboard.

2.4.1.5.2 Wood veneer shall be attached to a noncombustible backing or furred from a noncombustible sheathing.

2.4.1.5.3 Where open or spaced wood veneers are installed without concealed spaces, the wood veneers shall not project more than 24 inches from the exterior wall.

2.4.2 Building Projections

Balconies and similar appendages of wood construction, and projections of wood or wood-based materials extending to less than five feet from a property line or a line used to establish fire separation distance, shall be in accordance with the applicable building code.

2.5 Firestopping, Fireblocking and Draftstopping

2.5.1 Firestopping

2.5.1.1 Membrane-penetration firestop system: Where an approved membrane-penetration firestop system is required to protect a membrane penetration in a fire-resistance-rated wood assembly, the wood assembly shall be permitted to be designed in accordance with Chapter 3, and the firestop system shall have an F and T rating not less than the fire-resistance-rating of the fire-resistance-rated assembly when tested in accordance with ASTM E814 or UL1479 with a minimum positive pressure differential of 0.01 in. of water.

2.5.1.2 Through-penetration firestop system: Where an approved through-penetration firestop system is required to protect a penetration through a fire-resistance-rated wood assembly, the wood assembly shall be permitted to be designed in accordance with Chapter 3, and the firestop system shall have an F and T rating not less than the fire-resistance-rating of the fire-resistance-rated assembly when tested in accordance with ASTM E814 or UL 1479 with a minimum positive pressure differential of 0.01 in. of water.

2.5.1.3 Fire-resistant joint system: Where an approved fire-resistant joint system is required for a designed joint between fire-resistance rated wood assemblies, the wood assemblies shall be permitted to be designed in accordance with Chapter 3 and the fire-resistance joint system shall be tested in accordance with ASTM E1966 or UL 2079.

2.5.2 Fireblocking

In wood construction, fireblocking shall be installed to restrict the passage of flames within and between concealed spaces constructed using exposed combustible materials. Fireblocking materials shall be in accordance with 2.5.2.1. Fireblocking shall be installed in the locations specified in 2.5.2.2 through 2.5.2.5 and as specified by the applicable building code. The integrity of fireblocking shall be maintained permanently. If the fireblocking is removed to allow temporary access or construction, it shall be replaced immediately after access or construction is completed.

2.5.2.1 Fireblocking materials: The following materials shall be permitted for fireblocking:

1. One layer of 2-inch (nominal) lumber, (1½-inch thickness).
2. One layer of minimum 1⅝-inch thick structural composite lumber.
3. One layer of minimum 1⅝-inch thick engineered wood rim board.
4. Two layers of 1-inch (nominal) lumber, (¾-inch thickness); abutting ends and edges in adjacent layers spaced at least 2 inches apart.
5. One layer of 23/32-inch wood structural panels with all panel edges backed by 23/32-inch wood structural panels, wood framing, or wood blocking.
6. One layer of 3/4-inch particleboard with all panel edges backed by 3/4-inch particleboard, wood framing, or wood blocking.
7. One layer of 1/2-inch gypsum panel product; with all panel edges backed by wood framing or wood blocking.
8. One layer of 1/4-inch cement-based millboard; with all panel edges backed by wood framing or wood blocking.
9. Batts or blankets of minimum 2.5 pcf mineral wool filling the entire cross section of the wall cavity, installed to be securely retained in place, and tightly packed around piping, conduit, or similar obstructions.
10. Wood members and wood protection materials designed in accordance with Chapter 3 to limit the passage of flames for at least 15 minutes.

2.5.2.2 Concealed wall cavities: Concealed spaces of stud walls and partitions, which include furred spaces and spaces within double walls, double-stud walls, and staggered stud walls, shall have fireblocking in accordance with 2.5.2.2.1 and 2.5.2.2.2.

2.5.2.2.1 Horizontal intervals: Fireblocking shall be provided for the full height of the cavity, at horizontal intervals not exceeding 10 feet.

Exception: Fireblocking is not required where batts or blankets of mineral wool, fiberglass or other approved nonrigid materials are installed such that they prevent the movement of hot air and gases and will remain in place.

2.5.2.2.2 Vertical intervals: Fireblocking shall be installed at the ceiling and floor levels for the full length of the wall.

2.5.2.3 Intersection of concealed spaces: Fireblocking shall be provided at intersections between concealed spaces within wall assemblies and concealed spaces within floor/ceiling and roof/ceiling assemblies, and at intersections between concealed spaces in other locations such as occur at soffits, drop ceilings, and cove ceilings.

2.5.2.4 Stairways: Fireblocking shall be provided in concealed spaces between stair stringers at the top and bottom of the stair run.

2.5.2.5 Concealed sleeper spaces: Where wood sleepers are used for laying wood flooring on masonry or concrete fire-resistance-rated floors, the concealed space between the floor and the underside of the wood flooring shall meet one of the following:

1. The concealed space between the floor slab and the underside of the wood flooring shall be filled with an approved material to resist the free passage of flame and products of combustion; or,
2. Fireblocking shall be installed to limit open spaces under the flooring to no more than 100 square feet and also beneath permanent partitions to prevent fire spread between adjoining rooms.

2.5.3 Draftstopping

In wood construction, draftstopping shall be installed to subdivide large areas and restrict the movement of air and hot gases between combustible concealed spaces within floor-ceiling assemblies, and within attic spaces. Draftstopping materials shall be in accordance with 2.5.3.1. The integrity of draftstopping shall be maintained permanently. If the draftstopping is removed to allow temporary access or construction, it shall be replaced immediately after access or construction is completed.

2.5.3.1 Draftstopping materials: The following materials shall be permitted for draftstopping:

1. 1/2-inch gypsum panel product
2. 3/8-inch wood structural panel
3. 3/8-inch particleboard
4. 1-inch (nominal) lumber, (3/4-inch thickness)
5. cement fiberboard
6. batts or blankets of mineral wool or glass fiber insulation, adequately supported

2.5.3.2 Draftstopping in floors: Draftstopping shall be installed to divide concealed spaces within floor/ceiling assemblies constructed using wood or wood-based materials so that horizontal areas of concealed spaces do not exceed 1,000 square feet.


Exception: Buildings equipped throughout with an automatic sprinkler system.

2.5.3.3 Draftstopping in attics: Draftstopping shall be installed to divide attic spaces constructed using wood or wood-based materials such that horizontal areas do not exceed 3,000 square feet. Separate ventilation shall be provided for each attic space.

Exception: Buildings equipped throughout with an automatic sprinkler system.

FIRE RESISTANCE

3



CHAPTER 3: FIRE RESISTANCE

3.1 General

3.1.1 Scope

Chapter 3 establishes fire resistance design provisions that apply to all wood structural members, wood assemblies, and connections designed using the National Design Specification® (NDS®) for Wood Construction.

3.1.2 Fire Exposure

The provisions of Chapter 3 are based on the standard fire exposure and acceptance criteria specified in ASTM E119 or UL 263. Design fire scenarios, used to conduct performance-based designs, are outside the scope of this standard.

3.1.3 Fire-Resistance Rating

The fire-resistance rating of a wood member or wood assembly shall be based on the fire exposure and acceptance criteria specified in ASTM E119 or UL 263. Fire-resistance ratings shall be permitted to be determined using fire tests, calculations as prescribed herein, or engineering analyses based on comparison with fire tests of similar wood members or wood assemblies. Where a wood member or wood assembly is required to prevent passage of fire, the fire-resistance rating of that wood member or wood assembly shall be the least of the structural fire resistance time, the thermal separation time, and the burn-through time. Where a wood member or wood assembly is not required to prevent passage of fire, the fire-resistance rating of that wood member or wood assembly shall be the structural fire resistance time.

3.1.3.1 Design requirements: Each wood member or connection shall be designed in accordance with NDS for all loads prescribed by the applicable building code. In addition, where required to be fire-resistance-rated, the wood member, wood assembly or connection shall be designed to support its design dead load plus any applied live, roof live, or snow loads for the required fire resistance time based on the ASTM E119 or UL 263 fire exposure.

3.1.3.2 Reference design values: Reference design values and specific design provisions applicable to wood members, wood assemblies, and connections shall be in accordance with the NDS and this standard. Application of adjustment factors to reference design values and use with reduced cross-sections shall be in accordance with 3.2.4.

3.1.3.3 Test loads: Where the fire-resistance rating is determined by testing, the total load (w_T) to be used in ASTM E119 or UL 263 fire resistance testing shall simulate a maximum design load unless limited design criteria are specified, and a corresponding reduced load is applied and reported. The total load (w_T) shall include the superimposed load (w_S) to be applied throughout a fire resistance test combined with the wood member or wood assembly dead load (w_D).

3.1.3.3.1 For wood-frame walls, the superimposed load (w_S) shall be determined in accordance with ASTM D6513.

3.1.3.3.2 For wood-frame floor-ceiling assemblies, the superimposed load (w_S) shall be determined in accordance with ASTM D7746.

3.1.3.3.3 For other wood members and assemblies, the maximum design load shall be determined based on the reference design value determined in accordance with the NDS multiplied by all applicable adjustment factors, except for C_D , K_F , ϕ , and λ . The superimposed load (w_S) shall be calculated as the total load (w_T) minus the member or assembly dead load (w_D):

$$w_S = w_T - w_D \quad (3.1-1)$$

3.1.3.3.4 The total load (w_T) shall be reported as a percentage of the maximum design load for the wood member, wood assembly, or connection.

3.1.3.4 *Design loads*: Where the fire-resistance rating is determined by calculation in accordance with the provisions of this Chapter, the design load used for calculating the fire-resistance time shall be determined in accordance with the NDS and this section.

3.1.3.4.1 *Allowable Stress Design (ASD)*: Where required to be fire-resistance-rated, the total load (w_T) to be used to calculate the fire resistance time for a wood member, wood assembly, or a wood connection designed using ASD methods shall be the dead load (w_D) of the member or assembly plus the design gravity live loads (w_L), including applicable occupancy live load, roof live load, and snow load, supported by the member or assembly.

$$w_T = w_D + w_L \quad (3.1-2)$$

3.1.3.4.2 *Strength Design (LRFD)*: Where a wood member, wood assembly, or a wood connection is designed using LRFD methods, the total load (w_{T-LRFD}) to be used to calculate the fire resistance time shall be calculated as follows:

$$w_{T-LRFD} = \frac{1.5(w_D + w_L)^2}{1.2w_D + 1.6w_L} \quad (3.1-3)$$

3.2 Calculation of Structural Fire Resistance of Exposed Wood Members

Design provisions for exposed wood members herein are limited to structural fire resistance calculations not exceeding 2 hours. Wood members or assemblies protected with one or more of the protection options in 3.3 shall be permitted to exceed the 2-hour limitation on calculated fire resistance per this section, however, the calculated contribution of the wood members to the structural fire resistance shall not exceed 2 hours.

3.2.1 Char Rate of Exposed Wood Members

The non-linear char rate to be used in this procedure shall be estimated from published nominal 1-hour char rate data using the following equation:

$$\beta_t t^{0.813} = \beta_n t \quad (\text{at } t = 1 \text{ hr}) \quad (\text{Equation 3.2-1})$$

where:

- β_t = Non-linear char rate constant (in./hr^{0.813}), adjusted for exposure time, t
- β_n = Nominal char rate constant (in./hr), linear char rate based on 1-hour exposure
- t = Exposure time (hr)

3.2.1.1 *Standard Char Rate*: A nominal char rate, β_n , of 1.5 in./hr shall be applicable for sawn lumber, structural glued laminated softwood timber, laminated veneer lumber, parallel strand lumber, laminated strand lumber, and cross-laminated timber.

3.2.2 Char Depth, a_{char}

3.2.2.1 For sawn lumber, structural glued laminated timber, laminated veneer lumber, parallel strand lumber, and laminated strand lumber, the char depth, a_{char} , for each exposed surface shall be calculated as:

$$a_{char} = \beta_t t^{0.813} \quad (\text{Equation 3.2-2})$$

3.2.2.2 For cross-laminated timber, the time required to reach the glueline for each lamination shall be calculated as:

$$t_{gl,i} = \left(\frac{h_{lam,i}}{\beta_t} \right)^{1.23} \quad (\text{Equation 3.2-3})$$

where:

$$\begin{aligned} t_{gl,i} &= \text{time to char through lamination } i \text{ (hr)} \\ h_{lam,i} &= \text{thickness of lamination } i \text{ (in.)} \end{aligned}$$

The number of laminations fully charred through, n_{lam} , shall be calculated by subtracting the sum of times to char through each fully charred lamination, $t_{gl,i}$, from the total exposure time, t . The value of n_{lam} shall be the maximum integer value in which the following equation is true:

$$t - \sum_{i=1}^{n_{lam}} t_{gl,i} \geq 0 \quad (\text{Equation 3.2-4})$$

where:

$$n_{lam} = \text{number of laminations fully charred (truncated integer)}$$

The values of $t_{gl,i}$ and n_{lam} determined in the Equations 3.2-3 and 3.2-4, respectively, shall be used to calculate the char depth, a_{char} :

$$a_{char} = \sum_{i=1}^{n_{lam}} h_{lam,i} + \beta_t \left(t - \sum_{i=1}^{n_{lam}} t_{gl,i} \right)^{0.813} \quad (\text{Equation 3.2-5a})$$

Alternately, for cross-laminated timber manufactured with laminations of equal thickness, h_{lam} , the char depth, a_{char} , shall be permitted to be calculated using the time to char through one lamination, t_{gl} , and the following equation:

$$a_{char} = n_{lam} \cdot h_{lam} + \beta_t \left(t - (n_{lam} \cdot t_{gl}) \right)^{0.813} \quad (\text{Equation 3.2-5b})$$

where:

$$t_{gl} = \left(\frac{h_{lam}}{\beta_t} \right)^{1.23} \quad (\text{Equation 3.2-6})$$

$$n_{lam} = \frac{t}{t_{gl}} \quad (\text{Equation 3.2-7})$$

3.2.3 Effective Char Depth, a_{eff}

For structural calculations, section properties shall be calculated using standard equations for area, section modulus and moment of inertia using reduced cross-sectional dimensions to account for charring and the effects of elevated temperature. The dimensions are reduced by the effective char depth, a_{eff} , for each surface exposed to fire, where:

$$a_{\text{eff}} = 1.2 a_{\text{char}} \quad (\text{Equation 3.2-8})$$

3.2.3.1 For sawn lumber and timbers, structural glued laminated timber, laminated veneer lumber (LVL), parallel strand lumber (PSL), and laminated strand lumber (LSL), assuming a nominal char rate, $\beta_n = 1.5$ in./hr, the char depth, a_{char} , and effective char depth, a_{eff} , are provided in Table 3.2.3.1.

**Table 3.2.3.1 Char Depth and Effective Char Depth
(for $\beta_n = 1.5$ inches/hour)**

Required Fire-Resistance Rating (hr)	Char Depth, a_{char} (in.)	Effective Char Depth, a_{eff} (in.)
1-Hour	1.5	1.8
1½-Hour	2.1	2.5
2-Hour	2.6	3.2

3.2.3.2 For cross-laminated timber, reduced section properties shall be calculated using equations provided by the cross-laminated timber manufacturer based on the actual layup used in the manufacturing process. For cross-laminated timber manufactured with laminations of equal thickness and assuming a nominal char rate, β_n , of 1.5 in./hr, the char depth, a_{char} , and effective char depth, a_{eff} , are provided for each exposed surface in Table 3.2.3.2:

Table 3.2.3.2 Effective Char Depth (for CLT with $\beta_n = 1.5$ inches/hour)

Required Fire-Resistance Rating (hr)	Lamination Thickness, h_{lam} (in.)								
	5/8	3/4	7/8	1	1-1/4	1-3/8	1-1/2	1-3/4	2
	Char Depth, a_{char} (in.)								
1-Hour	1.8	1.8	1.7	1.7	1.7	1.6	1.5	1.5	1.5
1½-Hour	2.8	2.7	2.6	2.5	2.4	2.4	2.4	2.3	2.2
2-Hour	3.7	3.6	3.4	3.4	3.2	3.2	3.0	3.0	3.0
	Effective Char Depth, a_{eff} (in.)								
1-Hour	2.2	2.2	2.1	2.0	2.0	1.9	1.8	1.8	1.8
1½-Hour	3.4	3.2	3.1	3.0	2.9	2.8	2.8	2.8	2.6
2-Hour	4.4	4.3	4.1	4.0	3.9	3.8	3.6	3.6	3.6

Alternatively, for CLT layups in Annex A of APA PRG 320, the cross-laminated timber is permitted to be designed using properties for one of the tabulated CLT layups in Annex A where the number of laminations does not exceed the number of uncharred laminations remaining after the effective char depth, from Table 3.2.3.2, has been removed.

3.2.4 Member Strength

For sawn lumber, structural glued laminated softwood timber, laminated veneer lumber, parallel strand lumber, laminated strand lumber, and cross-laminated timber, the average member strength shall be approximated by multiplying reference design values (F_b , F_{bE} , F_t , F_v , F_c , F_{cE} , $F_{c\perp}$) by the adjustment factors specified in Table 3.2.4. All design values and cross-sectional properties shall be adjusted prior to structural calculations, including structural interaction equations, in the NDS provisions.

Table 3.2.4 Adjustment Factors for Fire Design^{1, 2}

			ASD or LRFD						
			Design Stress to Member Strength Factor, K	Size Factor ³	Volume Factor ³	Flat Use Factor ³	Repetitive Member Factor	Beam Stability Factor ⁴	Column Stability Factor ⁴
Bending Strength	F_b	x	2.85	C_F	C_V	C_{fu}	C_r	C_L	-
Beam Buckling Strength	F_{bE}	x	2.03	-	-	-	-	-	-
Tensile Strength	F_t	x	2.85	C_F	-	-	-	-	-
Shear Strength	F_v	x	2.75	-	-	-	-	-	-
Compressive Strength	F_c	x	2.58	C_F	-	-	-	-	C_P
Column Buckling Strength	F_{cE}	x	2.03	-	-	-	-	-	-
Bearing Strength	$F_{c\perp}$	x	1.67						

1. See NDS for applicability of adjustment factors for specific products.

2. Member strengths shall not be adjusted for C_D , C_M , nor C_t since these adjustments are addressed in the design stress to member strength factor.

3. Factor shall be based on initial cross-section dimensions.

4. Factor shall be based on reduced cross-section dimensions.

3.2.5 Design of Members

Induced stresses calculated using the design loads determined in 3.1.3.4 and the reduced section properties determined in 3.2.3 shall not exceed the member strength determined in 3.2.4.

3.2.5.1 *Special Provisions for Lumber Decking*: Lumber decking shall consist of tongue-and-groove (T&G) planks or mechanically-laminated dimension lumber set on edge and nailed to the adjacent pieces.

3.2.5.1.1 Single and double tongue- and-groove (T&G) decking shall be designed as an assembly of wood beams fully exposed only on the bottom face.

3.2.5.1.2 Mechanically-laminated decking shall be designed as an assembly of wood beams partially exposed on the sides due to shrinkage and char contraction and fully exposed on the bottom face. To compute the effects of partial exposure on the sides of the individual decking laminations, the char rate for this limited exposure shall be permitted to be reduced to 33% of the effective char rate. Alternatively, a more detailed analysis accounting for the loss of section from partial exposure between members, due to shrinkage and char contraction, shall be permitted.

3.2.5.2 Special Provisions for Structural Glued Laminated Timber Beams: For structural glued laminated timber bending members that are required to have a fire-resistance rating and are manufactured with multiple lamination grades throughout the depth, the following additional layup requirements shall apply in addition to any requirements of the structural design:

1. Where the top of the beam will be exposed to fire, a balanced layup shall be specified.
2. Where the top of the beam will not be exposed to fire, an unbalanced layup shall be permitted, except where a balanced layup is required by structural design.
3. For structural glued laminated timber bending members required to have a fire resistance rating of up to 1 hour, the beam shall be manufactured to the specified layup except that:
 - a. For unbalanced beams, a nominal 2-inch core lamination shall be removed, and an additional nominal 2-inch outer tension lamination shall be placed adjacent to the outer tension lamination as shown in Figure 3-1.
 - b. For balanced beams, two nominal 2-inch core laminations shall be removed, and an additional nominal 2-inch outer tension lamination shall be placed adjacent to the outer tension lamination at the top and bottom of the beam as shown in Figure 3-2.
4. For structural glued laminated timber bending members required to have a fire resistance rating of greater than 1 hour, the beam shall be manufactured to the specified layup except that:
 - a. For unbalanced beams, two nominal 2-inch core laminations shall be removed, and two additional nominal 2-inch outer tension laminations shall be placed adjacent to the outer tension lamination as shown in Figure 3-1.
 - b. For balanced beams, four nominal 2-inch core laminations shall be removed, and two additional nominal 2-inch outer tension laminations shall be placed adjacent to the outer tension lamination at the top and bottom of the beam as shown in Figure 3-2.

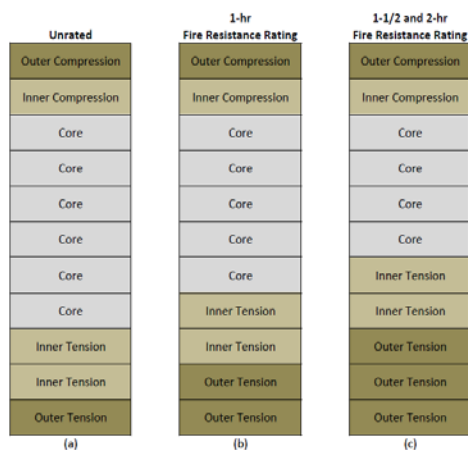


Figure 3-1 Typical Unbalanced Beam Layup

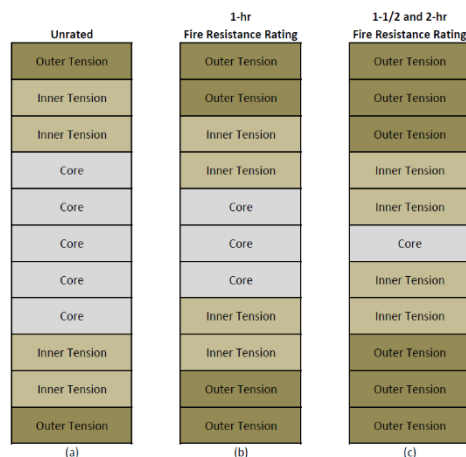


Figure 3-2 Typical Balanced Beam Layup

3.3 Protection of Structural Wood Members and Wood Assemblies

Where protective materials are used to increase the fire resistance of structural wood members, the structural fire resistance times of protected wood members shall be permitted to be calculated in accordance with 3.2, except with delayed onset of charring of each protected surface. The protection time, t_p , from the protective material shall be determined either by testing or using assigned values and calculations in accordance with this section. The protection times assigned in 3.3.1 through 3.3.3 shall be permitted to be used to estimate the delayed onset of charring of each protected surface. Where all surfaces of the structural wood member are protected with the same protection system, such as one or more protective membranes, the protection times of the protection system are directly additive with the structural fire resistance times of the structural wood members calculated in 3.2.

3.3.1 Protection by Wood

Wood cover shall be permitted as protection to increase fire resistance of structural wood members and wood assemblies.

3.3.1.1 Wood cover in contact with protected member: The protection time, t_p , provided by each layer of wood cover that is in contact with either the protected member or another underlying layer of protection shall be calculated as:

$$t_p = 60 \left(\frac{d_p}{\beta_t} \right)^{1.23} \text{ minutes} \quad (\text{Equation 3.3-1})$$

where:

d_p = thickness of the protective layer of wood (in.)
 β_t = non-linear char rate constant (in./hr^{0.813})

For a nominal char rate of 1.5 in./hr, the non-linear char rate constant is calculated as $\beta_t = 1.5$ in./hr^{0.813}, and the protection time associated with a protective wood membrane of a thickness, d , shall be calculated as follows:

$$t_p = 60 \left(\frac{d_p}{1.5} \right)^{1.23} \text{ minutes} \quad (\text{Equation 3.3-2})$$

3.3.1.2 Wood cover not in contact with protected member: The protection time, t_p , provided by a layer of wood cover that is not in contact with the protected member or another underlying layer of protection shall be calculated as follows:

$$t_p = \left[60 \left(\frac{d_p - 0.6}{1.5} \right)^{1.23} + 17 \right] \text{ minutes for } d_p \geq 0.6 \text{ inches} \quad (\text{Equation 3.4-1a})$$

$$t_p = 60 \left(\frac{d_p}{2.1} \right) \text{ minutes for } d_p < 0.6 \text{ inches} \quad (\text{Equation 3.4-1b})$$

3.3.1.3 Wood membrane: Where wood cover is used as a membrane to protect the entire wood member or wood assembly, the protection time calculated in 3.3.1.1 or 3.3.1.2 shall be the added protection time.

3.3.1.4 *Fasteners attaching wood protection:* Each layer of the wood cover shall be attached with fasteners of sufficient length to penetrate the protected wood member or underlying layers of wood cover, for a total depth of at least one inch. Fasteners attaching wood protection shall not be required to be protected.

3.3.1.5 *Char contraction:* Where char contraction will cause gaps to form between wood members or wood cover that are initially considered to be in contact, ignition shall be assumed to extend into unprotected gaps a distance equal to twice the char depth, $2a_{\text{char}}$. Additional protection shall be provided at the gaps, as necessary, to ensure that the wood cover provides the required protection.

3.3.2 Protection by Type X Gypsum Panel Products

Fire-rated gypsum panel products (Type X) shall be permitted as protection to increase fire resistance of wood members and wood assemblies.

3.3.2.1 *Gypsum panel cover:* Where used to increase fire resistance of wood members, the protection time, t_p , provided by each layer of Type X gypsum panel cover that is in contact with either the protected member or another underlying layer of protection shall be as provided in Table 3.3.2.1.

3.3.2.2 *Gypsum panel membrane:* Where Type X gypsum panels are used as a membrane to protect the entire wood member or wood assembly, the protection time, t_p , provided by each layer of Type X gypsum panels shall be in accordance with Table 3.3.2.1.

Table 3.3.2.1 Fire Resistance Time for Type X Gypsum Panel Products

Protection Description ¹	Gypsum Panel Cover of Members ^{2,3}	Gypsum Panel Membrane Protection of Members & Assemblies ^{4,5,6,7}		Protection Time, t_p (minutes)
	Maximum Fastener Spacing (inches)	Maximum Framing Spacing (inches)	Maximum Fastener Spacing (inches)	
1/2-inch Type X Gypsum Panel Product	12	16 24	12 8	30 ⁸
5/8-inch Type X Gypsum Panel Product	12	16 24	12 8	40 ⁹

¹ Each gypsum panel layer shall be attached with fasteners of sufficient length to penetrate the wood member at least 1 inch or be attached to steel channels capable of supporting the weight of the gypsum panel.

² Where multiple layers of gypsum panels are required, all adjoining panel edges shall be offset at least 16 inches from those of the adjacent underlying layer and attached with fasteners offset at least 4 inches in both orthogonal directions from the fasteners in all underlying layers.

³ Gypsum panel cover attached to wood members shall be installed such that gypsum panel cover at outside corners overlaps by at least the thickness of the gypsum panel. For gypsum panel cover attached to horizontal wood members (e.g. wood beams), side layers are installed first, followed by the bottom layer(s) to ensure that the edges of the side layers are covered.

⁴ Panel edges of the gypsum panel membrane face layer shall be taped and finished with joint compound, and fastener heads shall be covered with joint compound.

⁵ Where multiple layers of gypsum panels are required, adjoining panel edges occurring over framing shall be staggered at least one framing spacing from those of the adjacent underlying layer and attached to framing with fasteners offset at least 4 inches from the fasteners in all underlying layers. Unbacked adjoining panel edges shall be offset by at least 12 inches from those of the adjacent underlying layer.

⁶ At wall-to-ceiling intersections, the gypsum panel membrane shall be installed such that the ceiling gypsum panel membrane is installed first, followed by the wall gypsum panel membrane to ensure that the ceiling gypsum panel membrane is supported by each layer of the wall gypsum panel membrane.

⁷ At wall-to-wall intersections, each layer of the gypsum panel membrane shall be installed such that the gypsum panel membrane on the wall with a greater fire resistance rating is installed first, followed by the gypsum panel membrane on the intersecting wall.

⁸ For wood-frame walls with studs spaced 16 inches on center or less, the protection time, t_p , for 1/2" Type X gypsum panel, with 2-1/4" Type S drywall screws spaced at 7 inches on center or less, shall be permitted to be increased to 33 minutes for a single layer or a base layer of 1/2" Type X gypsum panel. Additional layers of 1/2" Type X gypsum panel are limited to 30 minutes/layer.

⁹ For wood-frame walls with studs spaced 24 inches on center or less, the protection time, t_p , for 5/8" Type X gypsum panel, with 2-1/4" Type S drywall screws spaced at 7 inches on center or less, shall be permitted to be increased to 48 minutes for a single layer or a base layer of 5/8" Type X gypsum panel. Additional layers of 5/8" Type X gypsum panel are limited to 40 minutes/layer.

3.3.2.3 Fasteners attaching gypsum panel products: Each Type X gypsum panel layer shall be attached with fasteners of sufficient length to penetrate the wood member at least 1 inch or be attached to steel channels capable of supporting the weight of the gypsum panel. Fasteners attaching gypsum panel shall not be required to be protected.

3.3.2.4 Gypsum panel product contraction: Where Type X gypsum panel contraction will cause gaps to form at edges of gypsum panels that are initially considered to be in contact, ignition of combustible materials directly behind the gaps shall be assumed to occur at the time assigned to

that Type X gypsum panel layer, determined in 3.3.2.1 or 3.3.2.2, multiplied by 0.50. Additional protection shall be provided at the gaps, as necessary, to ensure that the Type X gypsum panel provides the required protection.

3.3.3 Protection by Insulation

Mineral wool and fiberglass insulation shall be permitted as protection to increase fire resistance of wood members and wood assemblies.

3.3.3.1 Insulation cover: Where used to increase fire resistance of wood members or assemblies, the protection time, t_p , provided by mineral wool or fiberglass insulation batts of the specified minimum thickness and density or R-value, shall be as provided in Table 3.3.3.1. Protection times specified in Table 3.3.3.1 shall not be additive with each other and shall not be increased for additional insulation thickness, density, or R-value.

3.3.3.2 Insulation as part of a membrane: Where mineral wool or fiberglass insulation batts are used as part of a membrane to protect the entire wood member or wood assembly, the protection time calculated in 3.3.3.1 shall be the added protection time. Protection times specified in Table 3.3.3.1 shall not be additive with each other and shall not be increased for additional insulation thickness, density, or R-value.

Table 3.3.3.1 Fire Resistance Time for Protected Wood Surfaces

Insulation Description	Minimum Thickness (inches)	Protection Time, t_p , (minutes)
Mineral wool batts (minimum nominal density: 2.5 pcf)	3.5	19
	1.5	17
Fiberglass batts (minimum R-13)	3.5	3

3.4 Calculation of Structural Fire Resistance Time of Protected Wood Members and Wood Assemblies

The structural fire resistance time for protected wood members and assemblies shall be permitted to be calculated in accordance with 3.2, accounting for delayed charring on each protected surface in accordance with 3.3. Wood members or assemblies protected with one or more of the protection options in 3.3 shall be permitted to exceed the 2-hour limitation on calculated fire resistance for exposed wood members in 3.2, however, the calculated contribution of the wood members to the structural fire resistance shall not exceed 2 hours.

3.5 Calculation of Thermal Separation Time

The calculated thermal separation time provided by a wood assembly shall be equal to the sum of the times assigned to the protective membranes on both the fire-exposed side of the assembly and the unexposed side of the assembly, and additional contribution by other protective

components such as insulation. Where the calculated thermal separation time for a structural assembly exceeds the structural fire resistance time, the thermal separation time shall be limited to the structural fire resistance time.

3.5.1 Thermal Separation Time provided by Wood Layers

3.5.1.1 *Wood cover or membranes*: The contribution of wood layers to the thermal separation time shall be equal to the sum of protection times assigned to each layer, determined in 3.3.1, except where a single layer of wood is used to provide thermal separation or where the final layer on the unexposed side of the thermal separation is wood, the time assigned to that wood layer, as determined in 3.3.1, shall be multiplied by 0.85.

3.5.1.2 *Char contraction*: Where char contraction will cause gaps to form between wood members or wood cover that are initially considered to be in contact, additional protection shall be provided, as necessary, to ensure that wood members or wood cover provide the required thermal separation time. The depth of char penetration into gaps shall be determined per 3.3.1.5.

3.5.2 Thermal Separation Time provided by Type X Gypsum Panel Products

3.5.2.1 *Gypsum panel cover or membranes*: The contribution of Type X gypsum panel layers to the thermal separation time shall be equal to the sum of protection times assigned to each layer, determined in 3.3.2, except where a single layer of Type X gypsum panel is used to provide thermal separation or where the final layer on the unexposed side of the thermal separation is Type X gypsum panel, the time assigned to that Type X gypsum panel layer, determined in 3.3.2, shall be multiplied by 0.50.

3.5.2.2 *Gypsum panel product contraction*: Where Type X gypsum panel contraction will cause gaps to form between adjoining gypsum panels that are initially considered to be in contact, ignition of combustible materials directly behind the gaps shall be assumed to occur at the time assigned to that Type X gypsum panel layer, determined in 3.3.2, multiplied by 0.50; however, the effect on the thermal separation time, estimated in 3.5.2.1, shall be permitted to be ignored.

3.5.3 Thermal Separation Time provided by Insulation

3.5.3.1 *Insulation protection time*: Where insulation is used to provide a portion of the thermal separation, the protection time, t_p , determined in 3.3.3, shall be permitted to be added. Protection times specified in Table 3.3.3.1 shall not be additive with each other and shall not be increased for additional insulation thickness, density, or R-value.

3.6 Calculation of Burn-Through Time

Burn-through time shall be considered between wood members or through wood assemblies. Provisions for addressing char contraction between wood members or wood cover are provided in 3.5.1.2. Provisions for addressing Type X gypsum panel product contraction are provided in 3.5.2.2. Detailing shall be provided to prevent burn-through before the required structural fire resistance time or the required thermal separation time is reached.

3.7 Tested Fire-resistance-rated Wood Assemblies

Wood assemblies tested in accordance with ASTM E119 or UL 263 are provided in Supplement B. Supplement B1 and B2 provides a listing of reported wood wall assemblies meeting specified 1-hr and 2-hr fire-resistance ratings, respectively. Supplement B3 and B3 provides a listing of reported wood floor/ceiling and roof/ceiling assemblies meeting specified 1-hr and 2-hr fire-resistance ratings, respectively.

3.8 Component Additive Method for Wood Assemblies

The fire-resistance ratings of wall assemblies, floor/ceiling assemblies, and roof/ceiling assemblies shall be permitted to be calculated using the provisions of this section which are based on ASTM E119 or UL 263 test data. The fire-resistance rating shall be the minimum time determined from the structural fire resistance time calculated in 3.8.1 and the thermal separation time calculated in 3.8.2.

3.8.1 Calculating the Structural Fire Resistance Time

The structural fire resistance time of a wood assembly shall be equal to the sum of the structural fire resistance times assigned to the wood members in 3.8.1.1 and the protection times assigned protective membrane on the fire-exposed side in accordance with 3.8.1.2. The membrane on the unexposed side shall not be included in determining the structural fire resistance time of the assembly.

3.8.1.1 Fire Resistance Times for Wood Members in Wood Assemblies: The structural fire resistance times for wood members in common wood assemblies are provided in 3.8.1.1.1 through 3.8.1.1.3.

3.8.1.1.1 Sawn Lumber, LVL, PSL, or LSL Studs: The structural fire resistance times for sawn lumber or LVL, PSL, or LSL studs in Table 3.8.1.1.1 shall be permitted for use with the component additive method of this section provided that the stress ratio for the studs does not exceed the tabulated value.

Table 3.8.1.1.1 Structural Fire Resistance Times Assigned to Sawn Lumber or LVL, PSL, or LSL Studs

Stud Size	Maximum Bearing	Maximum Axial Compression		Assigned Fire Resistance Time for Studs (minutes)		
	Stress Ratio ¹	Stress Ratio ^{2,3}		No Insulation	Mineral Wool ⁴	Fiberglass ⁴
	$(f_c / F_{c\perp})$	(f_c / F_c')			(Min. 2.5 pcf)	(Min. R-13)
		$K_e=1.0$ ²	$K_e=0.7$ ³			
2x4	78%	100%	54%	10	23	12
	61%	78%	42%	12	26	14
2x6	100%	61%	42%	14	30	16

¹ The maximum Bearing Stress Ratio limits the allowable load on 2x6 studs as a result of the calculated compression perpendicular-to-grain stress, $F_{c\perp}'$.

² The maximum Axial Compression Stress Ratio for $K_e=1.0$ limits the allowable load on 2x4 studs as a result of the calculated compression parallel-to-grain stress, F_c' , assuming concentric loading and pinned-end reactions at each end of studs.

³ The Axial Compression Stress Ratio for $K_e=0.7$ is the basis of the calculated fire resistance times and is based on the calculated compression parallel-to-grain stress, F_c' , assuming concentric loading and square-end bearing reactions at each end of studs.

⁴ Cavity between studs shall be filled completely with insulation.

3.8.1.1.2 Sawn Lumber, LVL, PSL, or LSL Joists: The structural fire resistance times for sawn lumber or LVL, PSL, or LSL joists in Table 3.8.1.1.2 shall be permitted for use with the component additive method of this section, provided that the stress ratio for the joists does not exceed the tabulated value.

Table 3.8.1.1.2 Structural Fire Resistance Times Assigned to Sawn Lumber or SCL Joists^{1, 2, 3}
(Protected Surface on Top Edge)

	ASD Stress Ratio ⁴	2x6	2x8	2x10	2x12	Additional LVL, PSL, or LSL Sizes			
		1½"x5½"	1½"x7¼"	1½"x9¼"	1½"x11¼"	1½"x9½"	1½"x11⅝"	1¾"x9½"	1¾"x11⅝"
	Structural Fire Resistance Time for Joists (minutes)								
No Insulation	0.5	15.1	15.3	15.5	15.6	15.5	15.7	18.6	18.8
	0.6	14.1	14.4	14.6	14.7	14.6	14.8	17.5	17.7
	0.7	13.2	13.5	13.7	13.8	13.7	13.9	16.4	16.7
	0.8	12.3	12.6	12.8	13.0	12.9	13.0	15.4	15.6
	0.9	11.4	11.8	12.0	12.1	12.0	12.2	14.3	14.6
	1.0	10.6	10.9	11.2	11.3	11.2	11.4	13.3	13.6
Fiberglass Batt Insulation (min. R-13)	0.5	17.9	18.2	18.4	18.6	18.4	18.6	21.5	21.7
	0.6	16.9	17.2	17.5	17.6	17.5	17.7	20.4	20.6
	0.7	15.9	16.3	16.6	16.7	16.6	16.8	19.3	19.5
	0.8	15.0	15.4	15.7	15.9	15.7	15.9	18.2	18.5
	0.9	14.1	14.5	14.8	15.0	14.8	15.0	17.1	17.4
	1.0	13.3	13.7	14.0	14.2	14.0	14.2	16.1	16.4
Mineral Wool Batt (min. 1.5" thick, 2.5 pcf)	0.5	30.9	31.6	31.9	32.2	32.0	32.2	34.9	35.3
	0.6	29.8	30.5	30.9	31.2	31.0	31.3	33.7	34.1
	0.7	28.7	29.5	29.9	30.2	30.0	30.3	32.5	33.0
	0.8	27.6	28.5	29.0	29.3	29.0	29.4	31.3	31.8
	0.9	26.6	27.5	28.0	28.4	28.1	28.5	30.2	30.7
	1.0	25.7	26.5	27.1	27.5	27.2	27.6	29.1	29.7

¹ Values are applicable to joists that are continuously laterally supported such that $C_L = 1.0$.

² Interpolation shall be permitted.

³ Glulam joists of the sizes listed for sawn lumber or SCL joists shall be permitted for use with the component additive method and utilize the tabulated fire resistance times assigned for the ASD stress ratios.

⁴ Stress ratio is for f_b/F_b' . For cases where f_v/F_v' controls the design, the tabulated fire resistance time for the given stress ratio is slightly conservative.

3.8.1.1.3 Wood I-Joists: The structural fire resistance time assigned to a wood I-joist, based on the lesser of the structural fire resistance times assigned to the flange in Table 3.8.1.1.3a and the web in Table 3.8.1.1.3b, shall be permitted for use with the component additive method of this section. Alternatively, I-joist fire resistance times shall be permitted to be assumed as zero for the analysis.

Table 3.8.1.1.3a Structural Fire Resistance Times Assigned to Wood I-joist Flanges ¹

Insulation Description and Location	ASD Stress Ratio ²	I-joists – Flange Dimensions (width x depth)							
		1-1/2" x 1-5/16"	1-1/2" x 1-1/2"	1-3/4" x 1-1/8"	1-3/4" x 1-1/4"	1-3/4" x 1-5/16"	2-5/16" x 1-1/8"	2-5/16" x 1-1/4"	3-1/2" x 1-1/2"
		Time (minutes) ³							
<i>All flange surfaces exposed, no insulation</i>	0.5	9.6	10.5	9.0	9.9	10.3	9.7	10.8	14.2
	0.6	8.8	9.6	8.3	9.1	9.5	9.0	10.0	13.2
	0.7	8.1	8.8	7.7	8.4	8.7	8.3	9.2	12.2
	0.8	7.4	8.1	7.0	7.7	8.0	7.7	8.5	11.3
	0.9	6.8	7.4	6.5	7.1	7.3	7.1	7.8	10.5
	1.0	6.2	6.8	5.9	6.5	6.7	6.5	7.2	9.6
<i>Bottom and sides of flange exposed, top protected with fiberglass insulation (min. 3.5 in., R13)</i>	0.5	10.4	11.2	10.1	10.9	11.3	11.0	12.0	15.5
	0.6	9.6	10.3	9.4	10.1	10.4	10.2	11.2	14.4
	0.7	8.9	9.6	8.7	9.4	9.7	9.5	10.4	13.5
	0.8	8.2	8.8	8.1	8.7	8.9	8.9	9.6	12.5
	0.9	7.6	8.2	7.5	8.0	8.3	8.3	9.0	11.7
	1.0	7.1	7.5	7.0	7.4	7.7	7.7	8.3	10.8
<i>Bottom and sides of flange exposed, top protected with mineral wool insulation (min. 1.5 in., 2.5 pcf)</i>	0.5	13.3	13.8	14.5	15.1	15.4	17.2	17.8	21.8
	0.6	12.3	12.7	13.3	13.9	14.1	16.1	17.0	20.7
	0.7	11.3	11.8	12.2	12.8	13.0	14.7	15.7	19.7
	0.8	10.5	10.9	11.2	11.7	12.0	13.5	14.4	18.7
	0.9	9.6	10.0	10.3	10.8	11.0	12.4	13.2	17.9
	1.0	8.8	9.2	9.4	9.9	10.1	11.3	12.1	17.1
<i>Bottom exposed, top and sides of flange protected with fiberglass insulation (min. 3.5 in., R13)</i>	0.5	10.0	10.8	9.7	10.4	10.8	10.6	11.5	14.8
	0.6	9.4	10.1	9.1	9.8	10.1	9.9	10.8	13.9
	0.7	8.9	9.5	8.6	9.2	9.5	9.3	10.1	13.0
	0.8	8.4	9.0	8.1	8.6	8.9	8.8	9.5	12.2
	0.9	7.9	8.5	7.6	8.1	8.4	8.3	8.9	11.4
	1.0	7.4	8.0	7.2	7.7	7.9	7.8	8.4	10.7
<i>Bottom exposed, top and sides of flange protected with mineral wool insulation (min. 1.5 in., 2.5 pcf)</i>	0.5	18.3	19.1	17.8	18.5	18.8	18.4	19.3	22.4
	0.6	17.8	18.6	17.3	18.0	18.3	17.9	18.7	21.6
	0.7	17.4	18.1	17.0	17.5	17.8	17.4	18.1	20.8
	0.8	17.1	17.7	16.0	17.1	17.4	17.1	17.7	20.1
	0.9	16.3	17.3	15.0	16.5	17.1	16.2	17.3	19.4
	1.0	15.4	17.0	14.0	15.5	16.2	15.1	16.8	18.8
<i>All flange surfaces protected with mineral wool insulation (min. 1.5 in., 2.5 pcf)</i>	0.5	26.6	27.5	26.0	26.9	27.3	26.7	27.8	31.2
	0.6	25.8	26.6	25.3	26.1	26.5	26.0	27.0	30.2
	0.7	25.1	25.8	24.7	25.4	25.7	25.3	26.2	29.2
	0.8	24.4	25.1	24.0	24.7	25.0	24.7	25.5	28.3
	0.9	23.8	24.4	23.5	24.1	24.3	24.1	24.8	27.5
	1.0	23.2	23.8	22.9	23.5	23.7	23.5	24.2	26.6
<i>Top and sides of flange protected with mineral wool insulation (min. 1.5 in., 2.5 pcf), bottom protected with 3/4" wood strips</i>	0.5	29.0	29.5	29.2	29.8	30.1	30.4	31.3	34.9
	0.6	28.2	28.7	28.4	29.0	29.2	29.6	30.4	33.9
	0.7	27.5	27.9	27.7	28.2	28.4	28.9	29.6	32.9
	0.8	26.8	27.2	27.1	27.5	27.7	28.2	28.8	31.9
	0.9	26.2	26.6	26.5	26.9	27.1	27.6	28.1	31.0
	1.0	25.7	26.0	26.0	26.3	26.5	27.0	27.5	30.2

¹ Assigned times shall be taken as the lesser of the times assigned to the flange and the web.² Stress ratio is for ASD induced moment divided by ASD resisting moment of I-joist.³ Values are applicable to I-joists that are continuously laterally supported such that $C_L = 1.0$.

Table 3.8.1.1.3b Structural Fire Resistance Times Assigned to Wood I-joist Web ¹

Insulation Description and Location	I-joists – Web Thickness		
	3/8"	7/16"	1/2"
	Time (minutes) ²		
<i>Both faces exposed, no insulation</i>	2	3	3
<i>Both faces protected with fiberglass insulation (min. 3.5" thick, R13)</i>	5	6	6
<i>Both faces protected with mineral wool insulation (min. 1.5 in. thick, 2.5 pcf.)</i>	19	20	20
<i>Both faces protected with mineral wool insulation (min. 3.5 in. thick, 2.5 pcf.)</i>	21	22	22

¹ Assigned times shall be taken as the lesser of the times assigned to the flange and the web.

² Times calculated assuming full ASD shear design stress ratio.

3.8.1.2 Protection of Wood Members: Where a membrane is used to protect the wood assembly, the added fire protection time shall be taken as sum of the protection time, t_p , assigned to wood membrane in Table 3.8.1.2a or to Type X gypsum panels in Table 3.8.1.2b.

Table 3.8.1.2a Added Protection Time Assigned to Wood Membrane

Description of Wood Membrane	Max. Framing Spacing, in.	Max. Fastener Spacing		Time, minutes
		Panel Edge, in.	Panel Field, in.	
3/8-inch Wood Structural Panels	24	6	12	10
1/2-inch Wood Structural Panels	24	6	12	14
5/8-inch Wood Structural Panels	24	6	12	17
23/32-inch Wood Structural Panels	24	6	12	19

Interpolation shall be permitted based on panel thickness.

Table 3.8.1.2b Added Protection Time Assigned to Type X Gypsum Panel Membrane

Description of Gypsum Panel Membrane ^{1, 2, 3, 4, 5}	Max. Framing Spacing, in.	Max. Fastener Spacing, in.	Time, minutes
1/2-inch Type X gypsum panel product	16	12	30 ⁶
	24	8	
5/8-inch Type X gypsum panel product	16	12	40 ⁷
	24	8	

¹ Each gypsum panel layer shall be attached with fasteners of sufficient length to penetrate the wood member at least 1 inch or be attached to steel channels capable of supporting the weight of the gypsum panel.

² Panel edges of the gypsum panel face layer shall be taped and finished with joint compound and fastener heads shall be covered with joint compound.

³ Where multiple layers of gypsum panel are required, adjoining panel edges occurring over framing shall be staggered at least one framing spacing from those of the adjacent underlying layer and attached to framing with fasteners offset at least 4 inches from the fasteners in all underlying layers. Unbacked adjoining panel edges shall be offset by at least 12 inches from those of the adjacent underlying layer.

⁴ At wall-to-ceiling intersections, the gypsum panel membrane shall be installed such that the ceiling gypsum panel membrane is installed first, followed by the wall gypsum panel membrane to ensure that the ceiling gypsum panel membrane is supported by each layer of the wall gypsum panel membrane.

⁵ At wall-to-wall intersections, each layer of gypsum panel membrane shall be installed such that the gypsum panel membrane on the wall with a greater fire resistance rating is installed first, followed by the gypsum panel membrane on the intersecting wall.

⁶ For wood-frame walls with studs spaced 16 inches on center or less, the protection time, t_p , for 1/2" Type X gypsum panel with 2-1/4" Type S drywall screws spaced at 7 inches on center or less shall be permitted to be increased to 33 minutes for a single layer or a base layer of 1/2" Type X gypsum panel. Additional layers of 1/2" Type X gypsum panel are limited to 30 minutes/layer.

⁷ For wood-frame walls with studs spaced 24 inches on center or less, the protection time, t_p , for 5/8" Type X gypsum panel with 2-1/4" Type S drywall screws spaced at 7 inches on center or less shall be permitted to be increased to 48 minutes for a single layer or a base layer of 5/8" Type X gypsum panel. Additional layers of 5/8" Type X gypsum panel are limited to 40 minutes/layer.

3.8.2 Calculating the Thermal Separation Time

The calculated thermal separation time provided by a wood assembly is equal to the sum of the times assigned to the protective membranes on both the fire-exposed side and the unexposed side, and additional contribution by other protective measures such as insulation. Where the calculated thermal separation time for a structural assembly exceeds the structural fire resistance time, the thermal separation time shall be limited to the structural fire resistance time.

3.8.2.1 Contribution from Membranes: Thermal separation times assigned to protective membranes in Tables 3.8.1.2a and 3.8.1.2b shall be permitted to be added except that, where a single layer of wood or Type X gypsum panel is used to provide all of the thermal separation or where the final layer of thermal separation on the unexposed side of the assembly is a wood layer or Type X gypsum panel layer, the time assigned to that wood layer or Type X gypsum panel layer shall be multiplied by 0.85 or 0.50, respectively.

3.8.2.2 Contribution from Insulation: Thermal separation times assigned to insulation, when incorporated into the assembly, shall be permitted to use the values in Table 3.8.2.2. Protection times specified in Table 3.8.2.2 shall not be additive with each other and shall not be increased for additional insulation thickness, density, or R-value.

Table 3.8.2.2 Added Protection Time Assigned to Insulation Membrane

Description of Insulation	Min. Thickness, in.	Time, minutes
Mineral Wool Insulation (minimum nominal density of 2.5 pcf)	3.5	19
	1.5	15
Fiberglass insulation (minimum R-13)	3.5	3

3.9 Design of Protected Wood Connections

Where a wood member or a wood assembly is required to have a fire-resistance rating, wood structural connections in that member or assembly shall be protected from fire exposure for the time corresponding to the required fire resistance rating of the wood member. All components of the wood structural connection, including connectors, fasteners and portions of the connected members that are part of the structural connection, shall be protected. Protection of the wood structural connection shall be provided by wood, Type X gypsum panel, other approved materials, or a combination thereof. Each wood cover layer shall be attached with fasteners of sufficient length to penetrate the adjacent wood member or cover at least one inch. Fasteners attaching the protection shall not be required to be protected; however, wood cover shall be attached in accordance with 3.3.1.4 and Type X gypsum panel protection shall be attached in accordance with 3.3.2.3.

Exception: Wood structural connections within a fire-resistance-rated assembly shall be considered to have the fire-resistance rating of the assembly without additional protection.

3.9.1 Connection Protection

Design of the protection shall be in accordance with the thermal separation provisions of 3.5.1 for wood protection and 3.5.2 for Type X gypsum panel protection.


Exception: Connections in fire-resistance-rated assemblies tested in accordance with ASTM E119 or UL 263.

3.9.2 Gaps at Ends and Edges

The penetration of ignition into gaps formed by char contraction at unbonded wood member ends and edges shall be taken as twice the char depth, $2a_{char}$. The char penetration into the gap need not be increased by the 1.2 factor required for structural calculations in 3.2.3. Protection of connections at ends and edges of wood members shall address this penetration to ensure the provisions of 3.9.1 are met.

Exception: Penetration of ignition between contact surfaces at bearing locations shall be taken as a_{char} .

REFERENCES

R


REFERENCES

1. ANSI A190.1-2017 *Standard for Wood Products — Structural Glued Laminated Timber*. APA – The Engineered Wood Association, Tacoma, WA, 2017
2. ANSI A208.1-2016 *Particleboard Standard*. Composite Panel Association, Leesburg, VA, 2016.
3. ANSI 405-2018 *Standard for Adhesives for Use in Structural Glued Laminated Timber*. APA – The Engineered Wood Association, Tacoma, WA, 2018
4. ANSI/ASME B18.2.1-2012 *Square, Hex, Heavy Hex, and Askew Head Bolts and Hex, Heavy Hex, Hex Flange, Lobed Head, and Lag Screws (Inch Series)*. American Society of Mechanical Engineers, New York, NY, 2012.
5. ANSI/ASME B18.6.1-1981(R2016) *Wood Screws (Inch Series)*. American Society of Mechanical Engineers, New York, NY, 2016.
6. ASTM C665-17 *Standard Specification for Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing*. ASTM International, West Conshohocken, PA, 2017.
7. ASTM C764-19 *Standard Specification for Mineral Fiber Loose-Fill Thermal Insulation*. ASTM International, West Conshohocken, PA, 2019.
8. ASTM C840-20 *Standard Specification for Application and Finishing of Gypsum Board*. ASTM International, West Conshohocken, PA, 2020.
9. ASTM C1177-17 *Standard Specification for Glass Mat Gypsum Substrate for Use as Sheathing*. ASTM International, West Conshohocken, PA, 2017.
10. ASTM C1280-18 *Standard Specification for Application of Exterior Gypsum Panel Products for Use as Sheathing*. ASTM International, West Conshohocken, PA, 2018.
11. ASTM C1396-17 *Standard Specification for Gypsum Board*. ASTM International, West Conshohocken, PA, 2017.
12. ASTM C1658-19 *Standard Specification for Glass Mat Gypsum Panels*. ASTM International, West Conshohocken, PA, 2019.
13. ASTM D5055-19e1 *Standard Specification for Establishing and Monitoring Structural Capacities of Prefabricated Wood I-Joists*. ASTM International, West Conshohocken, PA, 2019.
14. ASTM D5456-19e1 *Standard Specification for Evaluation of Structural Composite Lumber Products*. ASTM International, West Conshohocken, PA, 2019.
15. ASTM D5516-18 *Standard Test Method for Evaluating the Flexural Properties of Fire-Retardant Treated Softwood Plywood Exposed to Elevated Temperatures*. ASTM International, West Conshohocken, PA, 2018.
16. ASTM D5664-17 *Standard Test Method for Evaluating the Effects of Fire-Retardant Treatments and Elevated Temperatures on Strength Properties of Fire-Retardant Treated Lumber*. ASTM International, West Conshohocken, PA, 2017.
17. ASTM D6305-08(2015)e1 *Standard Practice for Calculating Bending Strength Design Adjustment Factors for Fire-Retardant-Treated Plywood Roof Sheathing*. ASTM

- International, West Conshohocken, PA, 2015.
18. ASTM D6841-16 *Standard Practice for Calculating Design Value Treatment Adjustment Factors for Fire-Retardant-Treated Lumber*. ASTM International, West Conshohocken, PA, 2016.
 19. ASTM D8223-19 *Standard Practice for Evaluation of Fire-Retardant Treated Laminated Veneer Lumber*. ASTM International, West Conshohocken, PA, 2019.
 20. ASTM E84-20 *Standard Test Method for Surface Burning Characteristics of Building Materials*. ASTM International, West Conshohocken, PA, 2020.
 21. ASTM E119-20 *Standard Test Methods for Fire Tests of Building Construction and Materials*. ASTM International, West Conshohocken, PA, 2020.
 22. ASTM E648-19ae1 *Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source*. ASTM International, West Conshohocken, PA, 2019.
 23. ASTM E814 - 13a(2017) *Standard Test Method for Fire Tests of Penetration Firestop Systems*. ASTM International, West Conshohocken, PA, 2017.
 24. ASTM E1966 - 15(2019) *Standard Test Method for Fire-Resistive Joint Systems*. ASTM International, West Conshohocken, PA, 2019.
 25. ASTM E2768-11(2018) *Standard Test Method for Extended Duration Surface Burning Characteristics of Building Materials (30 min Tunnel Test)*. ASTM International, West Conshohocken, PA, 2018.
 26. ASTM F1667-18a *Standard Specification for Driven Fasteners: Nails, Spikes, and Staples*. ASTM International, West Conshohocken, PA, 2018.
 27. ANSI/APA PRG 320-19: *Standard for Performance-Rated Cross-Laminated Timber*. APA – The Engineered Wood Association, Tacoma, WA, 2019
 28. ANSI/AWC NDS-2018: *National Design Specification® (NDS®) for Wood Construction*. American Wood Council, Leesburg, VA, 2018.
 29. NFPA 253 *Standard Method of Test for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source*. National Fire Protection Association, Quincy, MA, 2019.
 30. NFPA 268 *Standard Test Method for Determining Ignitability of Exterior Wall Assemblies Using a Radiant Heat Energy Source*. National Fire Protection Association, Quincy, MA, 2017.
 31. NFPA 285 *Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Wall Assemblies Containing Combustible Components*. National Fire Protection Association, Quincy, MA, 2019.
 32. NFPA 286 *Standard Methods of Fire Tests for Evaluating Contribution of Wall and Ceiling Interior Finish to Room Fire Growth*. National Fire Protection Association, Quincy, MA, 2019.
 33. PS1-09 *Structural Plywood*. U.S. Department of Commerce. National Institute of Standards and Technology. Gaithersburg, MD, 2009.
 34. PS2-18 *Performance Standard for Wood-Based Structural-Use Panels*. U.S. Department of Commerce. National Institute of Standards and Technology. Gaithersburg, MD, 2018.

35. PS20-20 *American Softwood Lumber Standard*. U.S. Department of Commerce. National Institute of Standards and Technology. Gaithersburg, MD, 2020.
36. ANSI/TPI 1-2014: *National Design Standard for Metal Plate Connected Wood Truss Construction*. Truss Plate Institute, Waldorf, MD, 2014.
37. UL 263. *Fire Tests of Building Construction and Materials*. Underwriters Laboratories Inc, Northbrook, IL, 2020.
38. UL 723: *Standard for Test for Surface Burning Characteristics of Building Materials*. Underwriters Laboratories Inc, Northbrook, IL, 2018.
39. UL 1479 *Standard for Fire Tests of Penetration Firestops*. Underwriters Laboratories Inc, Northbrook, IL, 2015.
40. UL 2079 *Tests for Fire Resistance of Building Joint Systems*. Underwriters Laboratories Inc, Northbrook, IL, 2020.
41. *ALSC Glued Lumber Policy*. American Lumber Standards Committee, Frederick, MD, 2020.

COMMENTARY

C

FDS Commentary: Chapter C1

C1.1 General

C1.1.1 Scope

This standard establishes fire design provisions that apply to all wood products, wood assemblies, and wood connections designed using products in the ANSI/AWC *National Design Specification (NDS) for Wood Construction* [1], unless otherwise noted.

C1.1.2 Design Methods

Design methods in this standard are based on the provisions of this Standard and the fire exposure and acceptance criteria specified in reference standards.


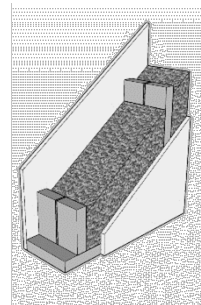
C1.1.3 Type of Construction

Building codes typically limit building heights and areas based on expected fire performance. To facilitate this objective, building codes used in the United States typically define “Types of Construction” which determine the fire-resistance ratings, materials, and detailing requirements for the building. Other considerations, such as occupancy, location, or the use of automatic sprinkler systems may further modify permissible building heights and areas.


C1.2 Terminology

Further explanation on some terminology in FDS 1.2:

- **Double-stud wall.** A double-stud wall is fabricated with two rows of studs with common top and bottom plates that are typically more than twice the width of the studs. Studs on opposite edges of the plates are typically aligned and separated by a gap to reduce sound or thermal transmission paths through the assembly. The width of end studs may match the full width of the plates. An example would be 2x8 plates (7-1/4” wide) with two rows of 2x4 (3-1/2” wide) aligned studs. The wall cavity can be filled or partially filled with insulation for improved thermal or acoustic performance.
- **Double wall.** A double wall is fabricated with two walls that are set next to each other, sometimes with insulation between them, to provide additional sound, thermal, and/or fire resistance. A double wall may be constructed either with or without membranes attached to the edges of the studs between the walls, depending on structural, fire, and acoustic design requirements. The wall cavities can be filled or partially filled with insulation for improved thermal or acoustic performance.



- **Staggered-stud wall.** A staggered-stud wall is fabricated with two rows of studs with common top and bottom plates that are typically less than twice the width of the studs. Adjacent studs (along the length of the wall) are placed at opposite edges of top and bottom plates without contacting each other to reduce sound and thermal transmission paths through the assembly. The width of end studs typically matches the full width of the plates. An example would be 2x6 plates (5-1/2" wide) with two rows of 2x4 (3-1/2" wide) staggered studs. The wall cavity can be filled or partially filled with insulation for improved thermal or acoustic performance.



- **Fire separation distance (FSD).** Building codes use the concept of fire separation distance (FSD) to determine construction requirements for exterior walls and projections based on proximity to other buildings which exist on the same site or adjacent sites or may exist in the future. The intent is to prevent a fire in one building from spreading to adjacent buildings. The FSD determines the required fire-resistance-ratings for exterior walls, maximum area of openings and requirements for opening protection in exterior walls, and maximum distances of projections from exterior walls. In addition, the egress pathways on the exterior of a building require minimum FSD to ensure safe egress in the event of fire.

Where there is only one building on a lot, the FSD is determined based on the distance from the exterior wall to the nearest lot line or to the centerline of the adjacent street, alley or right-of-way. Where multiple buildings occur on the same lot, the FSD between buildings is determined by establishing an imaginary lot line between buildings, such that the building code requirements for exterior walls and projections are met for both buildings. The imaginary line does not have to be placed halfway between the two buildings, but once it is established, both buildings must meet the requirements associated with their respective FSD. In some cases, exterior walls and projections on an existing building may require modification to meet code requirements when second building is added in close proximity. Establishing the imaginary line as close to the original building as permitted by the existing construction will permit the maximum flexibility in design and construction of the exterior walls and projections of the new building without requiring modification of the existing building.

C1.3 Notation

The system of notation used in the Specification helps to identify the meaning of certain frequently used symbols. Adjustment factors, identified by the symbol “C”, modify reference design values for conditions of use, geometry, or stability. The subscripts “D”, “F”, “L”, etc., are used to distinguish between different adjustment factors. In certain cases, upper- and lower-case subscripts of the same letter (“D” and “d”) are used to denote two different adjustments (load duration factor and penetration depth factor for split ring and shear plate connections, respectively). There is no particular significance to the use of the same letter with different cases for different adjustment factors. The symbols “F” and “F” denote reference and adjusted design values, respectively; where adjusted design values represent reference design values multiplied by all applicable adjustment factors. The symbol “f” indicates the actual or induced stress caused by the applied loads. The subscripts “b”, “t”, “c”, “v”, and “c_⊥” indicate bending, tension parallel to

grain, compression parallel to grain, shear, and compression perpendicular to grain stress, respectively.

C1.4 Materials Standards

Alternative materials and methods may be used where the authority having jurisdiction determines that the proposed design provides equivalent performance and complies with the intent of the applicable building code.

C1.4.1 Wood Products

References to product standards for wood products, including sawn lumber, glued lumber, structural glued laminated timber, prefabricated wood I-joists, structural composite lumber, prefabricated wood trusses, panel and siding products, and cross-laminated timber are provided. For proprietary or specialty products, further information may be available from the manufacturer.

C1.4.2 Gypsum Panel Products

References to product standards for gypsum panel products, including gypsum board and glass mat gypsum panel products, are provided.

C1.4.3 Insulation

References to product standards for mineral fiber insulation, including fiberglass or mineral wool, are provided.

C1.4.4 Fasteners and Connectors

References to product standards for fasteners, including bolts, lag screws, screws and nails are provided. For metal parts, such as metal plates and hangers, and concrete or masonry parts, such as footers and walls, the user is directed to use code-recognized design procedures.

C1.5 Heavy Timber

Heavy Timber is a classification of wood members or assemblies of wood members of minimum dimensions, specific to particular applications. Minimum sizes for sawn lumber, structural glued laminated timber, glued lumber, structural composite lumber, cross-laminated timber, mechanically-laminated timber and wood structural panels have been provided.

C1.6 Material Combustibility

A combustible material is any material that doesn't qualify as a noncombustible material.

C1.6.1 Noncombustible Materials

To qualify as a noncombustible material, the material must be tested in accordance with and meet the requirements of ASTM E136. A composite material such as gypsum wallboard, that has a base layer of noncombustible material and a thin combustible surface layer that has a thickness of not more than 1/8-inch and that meets specific flame spread limits, is generally acceptable as a noncombustible material.

C1.6.2 Combustible Materials

C1.6.2.1 Combustible materials used as exterior finish materials are required to meet specific requirements in FDS Chapter 2.

C1.7 Fire-Resistance-Rated Wood Members and Assemblies

The requirements in FDS 1.7 are intended to provide a minimum level of performance for wood members and assemblies required to have a fire-resistance rating.

C1.7.1 Fire-Resistance-Rated Construction

Fire-resistance ratings for wood members and assemblies are to be determined, by testing or calculation, in accordance with FDS Chapter 3.

C1.7.2 Continuity of Fire-Resistance Rating

The need for continuity of a fire-resistance rated assembly is established by the building code based on the function and location of the assembly in the building. Openings in the span of an assembly (between intersections with other walls, floors, or roofs), or penetrations into or through it for mechanicals, plumbing, or electrical installations, may or may not be required to be protected. For such breaches of horizontal assemblies such as floors, the codes almost always require protection to maintain continuity of fire resistance. But that is not the case with rated walls. It is only the openings and penetrations in walls with specific fire safety functions (commonly designated fire walls, fire barriers, or other names for walls serving a protective separation function) that are limited or required to be protected to provide continuity of fire resistance. Walls that are required to be fire-resistance rated only as a function of construction type can have unlimited openings and unprotected penetrations.

The required fire-resistance rating of an assembly is assumed to be provided from intersection to intersection of other connected walls, floors, and roofs. The codes contain no criteria for continuity of assembly fire resistance through intersections with other building assemblies or structural members. Specific protections at these locations may be required due to other code requirements, such as requirements for fireblocking within concealed spaces, requirements for equal fire resistance of supporting construction to that of supported assemblies, or requirements for the protection of designed joints between assemblies with fire-resistant joint systems. Otherwise continuity of fire resistance at the intersections of rated assemblies with each other or with other structural members should not be assumed and is generally unregulated, since it would be difficult to quantify the real safety benefit of such regulation. (For the protection of connectors and connections critical to the performance of rated beams, columns, and other structural members, see Section 1.7.7).

Where continuity of the fire-resistance rating is required, the fire resistance must be maintained for the full extent of the assembly. It is not required to provide continuity of materials, but only to ensure that the required fire resistance rating is maintained. For example, when a fire-resistance-rated wall assembly is required to have continuity for a fire safety separation function such as the protection of an exit shaft, it may be necessary to demonstrate that intersecting walls or floors do not adversely affect the fire-resistance of the exit shaft wall. As another example, a portion of a wood member may be protected by gypsum board, while another portion of the member is

protected by wood or other materials, provided that the required fire-resistance rating is maintained.

C1.7.3 Supporting Construction

Where construction supports gravity loads from a fire-resistance-rated building element or assembly, the construction is normally required to be capable of supporting the loads for the full time associated with the required fire-resistance rating of the supported element or assembly. Gravity loads are specifically cited because it is assumed that a fire event could occur simultaneously with design live and dead loads applied to the structure. It is not typically required to design for fire events simultaneous with lateral loads.

C1.7.3.1 Platform construction. In platform construction where a floor-ceiling assembly supports gravity loads from a fire-resistance rated wall, portions of the floor-ceiling construction that support the wall normally have a fire-resistance rating that is equal or greater than the required fire-resistance rating of the wall in order to meet the requirements of FDS 1.7.3. However, portions of the floor-ceiling construction that do not support the fire-resistance rated wall only need to meet the fire-resistance ratings for the floor-ceiling assembly. A common example of this requirement is a 2-hr exterior wall supported by a floor assembly. In this example, the supporting rim board, blocking, and/or the ends of floor joists must be capable of supporting the exterior wall for the required 2-hr fire-resistance rating of the exterior wall, but the remaining portion of the floor joists may have a lesser fire-resistance rating as required by the Type of Construction. Note that, where a floor-ceiling assembly supports an exterior wall that is required to be of noncombustible materials or fire-retardant treated wood, the material requirements of the floor-ceiling assembly are in accordance with requirements for interior building elements for the Type of Construction, including portions of the floor-ceiling construction that support gravity loads from the exterior wall.

C1.7.4 Column protection

Wood columns required to have a fire-resistance rating are to be designed in accordance with Chapter 3. Subsections 1.7.4.1 through 1.7.4.3 clarify how protection from ceiling and wall membranes is to be considered when designing a fire-resistance-rated column.

C1.7.5 Beam protection

Wood beams required to have a fire-resistance rating are to be designed in accordance with Chapter 3.

Section 1.7.5.1 recognizes that failure of one span of a fire-resistance rated beam may affect the load-carrying capacity and fire-resistance rating of the remaining span(s), therefore, all spans of multi-span beams are required to be designed for the maximum required fire-resistance rating of any of the spans, unless the failure of a single span can be shown to not reduce the fire-resistance rating of the remaining span(s).

Sections 1.7.5.2 through 1.7.5.4 recognize different consequences of failure and require different levels of protection for beams based on the number of floors or roofs supported.

C1.7.6 Truss protection

The fire-resistance rating of wood trusses and wood truss assemblies are typically established based on tests. Calculations using the provisions of FDS Chapter 3 for the design of wood members should be considered, but design of truss connections at chord splices and web-to-chord connections is beyond the provisions of this Standard. Approval should be based on tests or analyses that demonstrate the fire-resistance of the truss or assembly meets the required fire resistance.

Sections 1.7.6.1 and 1.7.6.2 recognize different consequences of failure and require different levels of protection for trusses based on the number of floors or roofs supported.

C1.7.7 Protection of Connections

Where a wood member or a wood assembly is required to have a fire-resistance rating, wood structural connections in that member or assembly must perform their function for the time corresponding to the required fire resistance rating. Since neither ASTM E119 nor UL 263 contain provisions for testing the fire resistance of structural connections, these connections are designed using the requirements of FDS 3.9. For wood structural connections, all required components of the connection are required to be protected, including any metal connectors, fasteners that are part of the structural connection, and portions of the connected members that are part of the structural connection. For further information on protection of connections, see C3.9.

For light-frame wood assemblies, such as wall, floor, and roof assemblies, testing and calculations have demonstrated that structural connections within a fire-resistance rated assembly are adequately protected to ensure that the assembly meets the required fire resistance rating. Intersections of repetitive-member fire-resistance rated wall and floor assemblies in light-frame wood construction are not considered connections needing protection; however, designed joints between the assemblies may require protection by fire-resistant joint systems. See Section C1.7.8 for more information about intersections.

C1.7.8 Intersections of Fire-resistance-rated Wood Assemblies

Fire-resistance-rated wood assemblies should be tightly connected at intersections with other fire-resistance-rated assemblies without voids, gaps, or openings between the assemblies. In some Types of Construction, intersections and abutting edges of fire-resistance-rated mass timber elements are required to be sealed against the passage of air and hot gases with sealants or adhesives meeting the requirements of ASTM C920 or ASTM D3498. Where required by the applicable building code, designed joints used between intersecting fire-resistance-rated assemblies must be designed per FDS 1.7.8.1.

C1.7.8.1 Fire-resistant joint systems. Designed joints used between fire-resistance-rated assemblies may be required to be protected by an approved fire-resistant joint system, which is rated for a time period not less than the required fire-resistance rating of the wall, floor, or roof assemblies. In the FDS and model building codes, the term “joint” has a very specific meaning. Not all intersections between fire-resistance rated wood assemblies contain designed joints; most do not. See the definition of “joint” for this application.

C1.7.8.2 Termination of gypsum panel membranes at ceiling-to-wall intersections. At wall-to-ceiling intersections, attachment of the ceiling gypsum panel membrane prior to attachment of the

wall gypsum panel membrane ensures that the ceiling gypsum panel membrane is supported by the wall gypsum panel membrane. Typically, ceiling gypsum panels are not attached to the ceiling framing close to the wall framing to avoid damage of the ceiling gypsum panel close to edges and ends of the panel. By attaching the ceiling gypsum panel membrane first, the wall gypsum panel membrane can be installed tight to the ceiling gypsum panels and support and prevent excessive sagging and minimize the formation of gaps due to gypsum contraction during fire exposure.

C1.7.8.3 Termination of gypsum panel membranes at wall-to-wall intersections. At wall-to-wall intersections, attachment of the gypsum panel membrane on the wall with a greater fire resistance rating prior to attachment of the gypsum panel membrane on the intersecting wall with a lesser fire-resistance rating minimizes the formation of gaps at the intersections due to gypsum contraction during the fire exposure.

C1.7.8.4 Wood members entering concrete or masonry fire walls. The 4-inch concrete “pocket” in masonry or concrete fire walls has historically shown to adequately protect the ends of wood structural members and prevent the spread of fire through the fire wall. Where the fire wall is hollow or where there are hollow units within the wall, the requirement for installing 4 inches of non-combustible materials around all sides of the wood structural member is to provide this same level of protection.

C1.7.9 Limitations and Protection of Openings

Limitations and requirements for protection of openings and penetrations in fire-resistance-rated assemblies vary and the user is directed to check with the requirements of the applicable building code.

CHAPTER C2: IGNITION AND FLAMMABILITY

C2.1 General

Chapter 2 establishes ignition and flammability requirements for wood products and provides reference test standards to be used to show compliance with these requirements. The provisions have been coordinated with requirements of model building codes, but have been expanded to address specific requirements for wood materials and assemblies.

C2.2 Ignition Resistance

Where ignition resistance of combustible exterior wall coverings is regulated, materials are required to be tested in accordance with NFPA 268 [3] and not exhibit sustained flaming when exposed to an incident radiant heat flux of 12.5 kW/m^2 . Since most wood and wood-based products do not exhibit sustained flaming when exposed to a radiant heat flux of 12.5 kW/m^2 , testing is not required for wood or wood-based products used as exterior wall coverings.

C2.3 Flame Spread Performance of Wood Products

C2.3.1 Interior wall and ceiling finish materials

C2.3.1.1 Interior wall and ceiling finishes are typically tested using ASTM E84 [4] or UL 723 [5] for flame spread and smoke development and are classified in accordance with their reported flame spread index (FSI) and smoke developed index (SDI) as indicated in FDS Table 2.3.1. Model building codes provide flame spread classification requirements for wall and ceiling finishes based on occupancy, location within the building, and presence of automatic sprinklers. For example, exit stairways and corridors typically have more restrictive requirements than other rooms within the building, and unsprinklered construction typically has more restrictive requirements than sprinklered construction. NFPA 286 is permitted to be used in lieu of ASTM E84 or UL 723 to meet the requirements of Class A; however, ASTM E84 or UL 723 are the primary methods used for wood products. Most occupancies in sprinklered buildings are required to meet the requirements of Class C interior finish in rooms, and Class B or C for corridors and exit elements. In unsprinklered buildings, most occupancies are required to meet the requirements of Class B or C for rooms and Class A or B for corridors and exit elements.

C2.3.1.2 Materials tested in accordance with ASTM E84 or UL 723 are provided in Supplement A as a reference to designers. These test assemblies can be used directly since they were tested in accordance with the code-referenced test standards. All wood products listed in Supplement A have SDI ratings below 450.

C2.3.2 Interior floor finish materials

With the exception of traditional floor finishes, including wood, vinyl, linoleum or terrazzo, and resilient floor covering materials that are not comprised of fibers, the IBC requires interior

floor finish and floor covering materials to be tested in accordance with ASTM E648 or NFPA 253 and classified based on minimum critical radiant heat flux. Interior floor finish materials in enclosures for stairways and ramps, exit passageways, corridors and rooms or spaces not separated from corridors by partitions extending from the floor to the underside of the ceiling are limited to Class I in Occupancy Groups I-1, I-2 and I-3 and not less than Class II in Occupancy Groups A, B, E, H, I-4, M, R-1, R-2 and S. However, where a building is equipped throughout with an automatic sprinkler system in accordance with NFPA 13 [9] or NFPA 13R [10], Class II materials are permitted in any area where Class I materials would otherwise be required, and materials complying with ASTM D2859 [11] are permitted in any area where Class II materials would otherwise be required.

C2.3.3 Fire retardant-treated wood

For approval of fire retardant-treated wood (FRTW), the U.S. model building codes reference the use of ASTM E84 or UL 723 with additional requirements for compliance with the following limits:

- flame spread index of 25 or less,
- no evidence of significant progressive combustion when the test is continued for an additional 20-minute period
- flame front does not progress more than 10.5 feet beyond the centerline of the burners at any time during the test.

In the FDS, ASTM E2768 [12] is referenced since the test procedure incorporates ASTM E84 and includes the additional requirements listed above. In addition, ASTM E84-19 states, “Materials required by the user to meet an extended 30-min duration tunnel test shall be tested in accordance with Test Method E2768.” Whether wood products are impregnated with chemicals by a pressure process or by other means during the manufacturing process, or protected by use of surface coatings, they must all meet the same performance requirements of ASTM E2768 and demonstrate acceptable durability for the intended use and life of the structure.

C2.3.3.1 Design values: The standards referenced in FDS 2.3.3.1 specify testing and analysis requirements for determining treatment adjustment factors for FRTW based on expected end-use conditions in several climate zones. However, these standards separate both the immediate and long-term effects of the chemical treatment from the effects of moisture and temperature on untreated wood. For this reason, it is important that the appropriate treatment adjustment factor be applied cumulatively with the NDS adjustment factors for moisture and temperature, as well as any other adjustment factors applicable to the end use application.

Design values for fire-retardant treated softwood plywood and fire-retardant-treated sawn lumber are determined starting with published design values for untreated plywood or lumber then multiplying by the appropriate treatment adjustment factor and all other adjustment factors applicable to untreated wood. However, laminated veneer lumber (LVL) is treated differently; ASTM D8223 requires reference design values to be established specifically for fire-retardant-treated LVL along with adjustment factors to account for long term effects of the treatment under expected climatological conditions.

C2.4 Vertical and Lateral Flame Propagation

C2.4.1 Exterior Wall Coverings

Building codes typically regulate the coverage area and the coverage height for combustible wall coverings based on the type of construction and proximity to adjacent buildings. Where FRTW, suitable for exterior use, is used as exterior wall covering, the coverage area is unlimited regardless of the proximity to other buildings and the permissible coverage height is increased from 40 feet to 60 feet when the exterior wall with the FRTW exterior wall covering is tested in accordance with and meets the requirements of NFPA 285.

C2.4.2 Building Projections

Balconies and similar projections of wood or wood-based materials extending to less than five feet from a property line or a line used to establish fire separation distance are subject to similar limitations as combustible exterior wall coverings; therefore, requirements should be sought in the applicable building code.

C2.5 Firestopping, Fireblocking and Draftstopping

C2.5.1 Firestopping

Firestopping is used to prevent the passage of fire through fire-resistance-rated construction. Through-penetration firestop systems are used to prevent the passage of fire and hot gases through fire-resistance-rated construction caused by penetrations, such as pipe or ducts. Membrane-penetration firestop systems are used to prevent the passage of flames and hot gases into fire-resistance-rated assemblies through penetrations in protective membranes. Fire-resistant joint systems are used to prevent the passage of fire and hot gases through design joints between of fire-resistance-rated assemblies. Model building codes typically require all three firestopping systems to be tested and approved. The provisions of 2.5.1 clarify that the wood members and wood assemblies can be designed in accordance with FDS Chapter 3 and only the firestop systems need to be tested and approved.

C2.5.2 Fireblocking

In wood construction, fireblocking is used to restrict the passage of flames within and between concealed spaces constructed using combustible materials that are exposed within the concealed space. Fireblocking is not typically required in concealed spaces where no combustible materials are exposed.

C2.5.2.1 Fireblocking materials: Materials listed in FDS 2.5.2.1, Items 1 through 9 have historically been permitted for use as fireblocking. FDS 2.5.2.1 Item 10 was added to allow the designer flexibility to determine whether other materials can be used as fireblocking by limiting the passage of flames for at least 15 minutes when exposed to the standard fire in ASTM E119. Table C2.5.2.1 provides calculated burn-through times for existing fireblocking materials using the thermal separation time or the burn-through time at abutting edges for each material based on the provisions of FDS 3.5.1 for wood, FDS 3.5.2 for Type X gypsum panel products, or FDS 3.5.3 for insulation used as fireblocking materials.

Table C2.5.2.1: Calculated Burn-Through Times of Fireblocking Materials

Material	Abutting Ends and Edges Backed	Calculated Burn-through Time (minutes)
One layer of 2-inch (nominal) lumber (1½-inch thick)	No	26
One layer of 1½-inch thick (minimum) structural composite lumber	No	18
One layer of 1½-inch thick (minimum) engineered wood rim board	No	18
Two layers of 1-inch (nominal) lumber (¾-inch thick)	abutting ends and edges in each layer spaced at least 2 inches apart.	26
One layer of 23/32-inch wood structural panel sheathing	all panel edges backed by 23/32-inch wood structural panels, wood framing, or wood blocking.	20
One layer of 3/4-inch particleboard	all panel edges backed by 3/4-inch particleboard, wood framing, or wood blocking.	21
One layer of 1/2-inch regular gypsum board	all panel edges backed by wood framing or wood blocking.	15 ¹
Batts or blankets of minimum 2.5 pcf mineral wool filling the entire cross section of the wall cavity, installed to be securely retained in place, and tightly packed around piping, conduit, or similar obstructions.		19

¹ Test-based value.

C2.5.3 Draftstopping

In wood construction, draftstopping is used to subdivide large areas and restrict the movement of air and hot gases between combustible concealed spaces within floor-ceiling assemblies, and within attic spaces.

C2.5.3.1 Draftstopping materials: Materials listed in FDS 2.5.3.1 have historically been permitted for use as draftstopping.

CHAPTER C3: FIRE RESISTANCE

C3.1 General

C3.1.1 Scope

Chapter 3 establishes fire resistance design provisions that apply to all wood structural members, wood assemblies, and connections designed using the National Design Specification® (NDS®) for Wood Construction [1].

C3.1.2 Fire Exposure

The provisions of Chapter 3 are based on the standard fire exposure and acceptance criteria specified in ASTM E119 [13] or UL 263 [14] and do not, therefore, apply to design fires used in performance-based design. Design fire scenarios, used in performance-based design, require development of new char rate information as a function of changes to the fire exposure. Until design fires are standardized, development of this new information is on hold.

C3.1.3 Fire-Resistance Rating

Typically, individual wood structural members that are required to have a fire resistance rating need only meet the structural requirements for the fire resistance time in ASTM E119 or UL 263. Wood assemblies that are required to have a fire-resistance rating need to meet the structural resistance requirements, provide adequate thermal separation (prevent an average temperature rise of 250°F or a maximum temperature rise of 325°F), and prevent burn-through for the fire resistance time. For some wood structural members, such as cross-laminated timber, the member itself can be used to meet the requirements for structural resistance, thermal separation, and burn-through.

C3.1.3.1 Design requirements: This Specification defines a national standard of practice for the fire design of wood members, wood assemblies, and wood connections. It references the NDS as the base document for structural design and builds on those structural requirements to meet the fire-resistance rating requirements in the building code.

C3.1.3.2 Reference design values: Reference design values and specific structural design provisions to be used with the provisions of the Specification are contained in the NDS or documents referenced therein. Applicable adjustment factors to NDS reference design values are provided in FDS 3.2.4.

C3.1.3.3 Test loads: Where the fire-resistance rating is determined by testing, ASTM E119 requires that the total load (w_T) to be applied throughout a fire-resistance rating test must induce the maximum allowable stress in the member or assembly being tested unless the intent of the test is to apply and report a reduced load.

Allowable Stress Design (ASD): For ASD, the superimposed load (w_s) for a wood member,

wood assembly, or a wood connection to be applied throughout a fire-resistance rating test is calculated as w_T minus the member or assembly dead load (w_D). For a wood member, wood assembly, or a wood connection, the superimposed load (w_S) is calculated as shown in FDS Equation 3.1-1. Guidance on calculating the full ASD load is provided for wood-frame walls in ASTM D6513 [15] and for wood-frame floor-ceiling assemblies in ASTM D7746 [16].

Strength Design (LRFD): For LRFD, the superimposed load (w_{S-LRFD}) to be applied throughout a fire-resistance rating test is calculated in accordance with ASTM E119 Appendix X7. Recognizing that LRFD design values for wood construction were calibrated for a live/dead ratio of 3 and a time effect factor (λ) of 0.7, the provisions of ASTM E119 Appendix X7 can be simplified for wood design as follows:

From ASTM E119 Appendix X7:

$$w_{T-LRFD} = \frac{1}{\alpha} \left(\frac{8M_n \phi \lambda}{sL^2} \right) \quad (C3.1-1)$$

where:

w_{T-LRFD}	= total load required for fire design of wood member or assembly designed by LRFD method
α	= load factor on total load
M_n	= nominal moment capacity
ϕ	= LRFD resistance factor
λ	= LRFD time effect factor = 0.7 at calibration
s	= spacing of structural members
L	= span of structural members

From ASTM E119 Appendix X7:

$$\alpha = \frac{1.2w_D + 1.6w_L}{w_D + w_L} \quad (C3.1-2)$$

For wood members, the nominal moment capacity, M_n , can be related to the ASD moment capacity, M_{ASD} , as follows:

$$M_n = \frac{2.16}{\phi} M_{ASD} \quad (C3.1-3)$$

and:

$$M_{ASD} = \frac{(w_D + w_L)sL^2}{8} \quad (C3.1-4)$$

Substituting Equations C3.1-2, C3.1-3 and C3.1-4 into C3.1-1 provides the following equation:

$$w_{T-LRFD} = \frac{1.5(w_D + w_L)^2}{1.2w_D + 1.6w_L} \quad (C3.1-5)$$

Recognizing that $w_{T-LRFD} = w_{S-LRFD} + w_D$, the value of w_{S-LRFD} is estimated to be:

$$w_{S-LRFD} = \frac{1.5(w_D + w_L)^2}{1.2w_D + 1.6w_L} - w_D \quad (C3.1-6)$$

C3.1.3.4 Design loads: Where the fire-resistance rating is determined by calculation, the design load used for calculating the fire-resistance time for a wood member, wood assembly, or a wood connection is required to be determined in accordance with the NDS and the provisions of 3.1.3.4.

Allowable Stress Design (ASD): For a wood member, wood assembly, or a wood connection designed using ASD methods, the total load (w_T) to be used to calculate the fire resistance time is calculated in accordance with FDS Equation 3.1-2. For simplicity, the design gravity live loads (w_L), include applicable occupancy live load, roof live load, and snow load, supported by the member or assembly. The load duration factor, C_D , associated with the shortest load duration load should be used in accordance with the NDS.

Strength Design (LRFD): Where a wood member, wood assembly, or a wood connection is designed using LRFD methods, the total load (w_{T-LRFD}) to be used to calculate the fire resistance time is calculated in accordance with FDS Equation 3.1-3, which is Equation C3.1-5 in the previous derivation of the total load required for fire design of a wood member or assembly designed by LRFD method in accordance with ASTM E119 Appendix X7.

C3.2 Calculation of Structural Fire Resistance of Exposed Wood Members

The mechanics-based design procedures in the Specification for exposed wood members are based on research described in AWC's *Technical Report 10: Calculating the Fire Resistance of Exposed and Protected Wood Members* (TR10) [17]. The design procedure calculates the capacity of exposed wood members using basic wood engineering mechanics. Section properties are computed assuming an effective char depth, a_{eff} , at a given time, t . Reductions of strength and stiffness of wood in the heated zone adjacent to the char layer are accounted for by assuming the effective char depth, a_{eff} , is equal to 1.2 times the char depth, a_{char} . Average member strength properties are approximated from accepted procedures used to calculate design properties. Finally, wood members are designed using accepted engineering procedures found in NDS for allowable stress design. The design procedures presented in this Standard are not intended to evaluate wood members for continued use after a fire event.

C3.2.1 Char Rate of Exposed Wood Members

Extensive one-dimensional char rate data is available for wood slabs. Two-dimensional char data is also available for timbers, but most of this data is limited to larger cross-sections. Evaluation of char rate models using one-dimensional char rate data suggests that charring of

wood is nonlinear, and that estimates using linear models based on one-hour char rate data tend to underestimate char depth for short time periods (<60 minutes) and overestimate char depth for longer time periods (>60 minutes). To account for char rate nonlinearity, a nonlinear, one-dimensional char rate model, based on the results of 40 one-dimensional charring tests of wood slabs of various species, was developed by White [18].

This non-linear model addressed accelerated charring which occurs early in the fire exposure by applying a power factor to the char depth, a_{char} , to adjust for char rate nonlinearity:

$$t = m(a_{char})^{1.23} \quad (C3.2-1)$$

where:

t = exposure time (hr.)

m = char slope (hr./in.^{1.23})

a_{char} = char depth (in.)

However, application of this model is limited since the char slope (hr./in.^{1.23}), m , is species-specific and limited data exists for different wood species fit to the model. In addition, the model is limited to one-dimensional slabs.

To develop a two-dimensional, nonlinear char rate model, the one-dimensional non-linear char rate model was modified to enable values for the slope factor, m , to be estimated using nominal char rate constants (in./hr.), β_n . The nominal char rate constant, β_n , is estimated using measured char depth at approximately one hour. The non-linear char rate constant, β_t , is estimated from the nominal char rate constant, β_n as follows:

$$\beta_t = \beta_n \frac{(1 \text{ hr})}{(1 \text{ hr})^{0.813}} \quad (C3.2-2)$$

where:

β_t = Non-linear char rate constant (in/hr^{0.813})

β_n = Nominal char rate constant (in/hr), linear char rate based on 1-hour exposure

t = Exposure time (hr)

C3.2.1.1 Standard Char Rate: For most wood and wood-based products, testing has confirmed that an average nominal char rate, β_n , of 1.5 in./hr is applicable for softwood materials and conservative for hardwood materials.

C3.2.2 Char Depth, a_{char}

C3.2.2.1 For sawn lumber, structural glued-laminated softwood timbers, laminated veneer lumber, parallel strand lumber, and laminated strand lumber, the char depth can be directly

estimated using FDS Equation 3.2-2 assuming a nominal char rate constant, β_n , of 1.5 inches/hr. The char depth, a_{char} , for each exposed surface can be calculated as:

$$a_{char} = \beta_n t^{0.813} = 1.5t^{0.813} \quad (C3.2-3)$$

C3.2.2.2 For cross-laminated timber manufactured with many adhesives approved for use in the manufacture of CLT, fall-off of charred laminations has been noted in full-scale tests. For adhesives meeting the minimum requirements of ANSI/APA PRG 320 [19], charred lamination fall-off occurs as the char front reaches the glueline, leaving the uncharred wood in the next layer exposed. When this occurs, the non-linear char rate in Equation FDS 3.2-2 starts anew at $t = 0$ for the next lamination. To model the condition where the char layer falls off just as the char front reaches the glueline, the time required for the char front to reach the glueline for each lamination, $t_{gl,i}$, is calculated using FDS Equation 3.2-3.

The number of laminations that could potentially fall off in this manner is estimated by subtracting each $t_{gl,i}$ from the total time until the last partial lamination is determined. The number of laminations charred completely through the depth, n_{lam} , is the truncated integer in which the following equation is true:

$$t - \sum_{i=1}^{n_{lam}} t_{gl,i} \geq 0 \quad (C3.2-4)$$

The values of $t_{gl,i}$ and n_{lam} determined in the above equations are used to calculate the char depth, a_{char} , in FDS Equation 3.2-5 or 3.2-6.

Some adhesives can hold the char layer well after the char front reaches the glueline and, like solid wood, the char layer provides thermal protection to uncharred wood beneath the char for an extended period of time. Where these adhesives are used and have shown that they perform like solid wood, they should be permitted to use FDS Equation 3.2-2.

C3.2.3 Effective Char Depth, a_{eff}

For structural calculations, section properties are calculated using dimensions which have been reduced for each surface exposed to fire. The dimensions are reduced by the effective char depth, a_{eff} , calculated in accordance with FDS Equation 3.2-8 which is 20% greater than the actual char depth, a_{char} , calculated in FDS 3.2.2. The 20% increase accounts for strength and stiffness loss in the elevated temperature zone ahead of the char front.

C3.2.3.1 For sawn lumber and timbers, structural glued-laminated softwood timbers, laminated veneer lumber (LVL), parallel strand lumber (PSL), and laminated strand lumber (LSL), section properties can be calculated using a_{eff} , using FDS Equations 3.2-2 and 3.2-8, and standard equations for area, section modulus, and moment of inertia using reduced cross-sectional dimensions. Equations for calculating cross-sectional properties for these rectangular members, exposed on all four sides, are shown in Table C3.2-1. Other exposures can be calculated using a similar method.

Table C3.2-1 Cross-Sectional Properties for Four-Sided Exposure

Cross-sectional Property	Four-Sided Exposure Example
Area of the cross-section, in ²	$A(t) = (D_{\min} - 2a_{\text{eff}})(D_{\max} - 2a_{\text{eff}})$
Section Modulus about major-axis(XX), in ³	$S_{XX}(t) = (D_{\min} - 2a_{\text{eff}})(D_{\max} - 2a_{\text{eff}})^2/6$
Section Modulus about minor-axis(YY), in ³	$S_{YY}(t) = (D_{\min} - 2a_{\text{eff}})^2(D_{\max} - 2a_{\text{eff}})/6$
Moment of Inertia about major-axis(XX), in ⁴	$I_{XX}(t) = (D_{\min} - 2a_{\text{eff}})(D_{\max} - 2a_{\text{eff}})^3/12$
Moment of Inertia about minor-axis(YY), in ⁴	$I_{YY}(t) = (D_{\min} - 2a_{\text{eff}})^3(D_{\max} - 2a_{\text{eff}})/12$

C3.2.3.2 For cross-laminated timbers, reduced cross-section dimensions are calculated using a_{eff} using FDS Equation 3.2-5a or 3.2-5b and FDS Equation 3.2-8; however, due to the complex interactions of crossing laminations and proprietary nature of cross-laminated timber layups, the effect of charring on the capacity of a specific CLT product should be checked with the manufacturer. Alternatively, the capacity of the charred cross-laminated timber can be conservatively estimated by limiting the post-fire capacity to that of a panel with the same number of full-depth laminations remaining in the axis being considered after a given fire resistance time. For example, for CLT layups in Annex A of APA PRG 320, the cross-laminated timber is permitted to be designed using properties for one of the tabulated CLT layups in Annex A where the number of laminations does not exceed the number of uncharred laminations remaining after the effective char depth, from FDS Table 3.2.3.2, has been removed.

C3.2.4 Member Strength

To approximate an average member strength using a reference design value, the reference design value from the NDS is multiplied by an adjustment factor, K , to adjust from an allowable design value to an average ultimate value [17]. For bending, F_b^* is multiplied by the adjustment factor, K , prior to calculation of the beam stability factor, C_L , from the NDS. Similarly, F_c^* is multiplied by the adjustment factor, K , prior to calculation of the column stability factor, C_P in the NDS.

The adjustment factor, K , has two components, the inverse of the applicable design value adjustment factor, $1/k$, and the inverse of the variability adjustment factor, c . To develop general design procedures for sawn lumber, structural glued laminated softwood timber, laminated veneer lumber, parallel strand lumber, laminated strand lumber, and cross-laminated timber, design value adjustment factors and estimates of design property COV were used to conservatively develop an allowable design stress to average ultimate strength adjustment factor, K , for each design property as shown in Table C3.2-2.

Since $F_{c\perp}$ reference design values are derived from deformation-based test values, the design values don't represent ultimate strength. Ultimate strength in compression perpendicular-to-grain is not well defined; however, ASTM D5457 [30] sets the Format Conversion Factor, K_F , equal to 1.67 for adjusting reference ASD $F_{c\perp}$ design values to nominal resistances for use with LRFD. This factor was deemed appropriate for design of wood members exposed to fire. Where fire exposure increases the aspect ratio of the cross section, the potential for buckling perpendicular-to-grain should also be considered.

Table C3.2-2 ASD Reference Value to Average Ultimate Strength Adjustment Factors

	F	$1/k$	c	Assumed COV	K
Bending Strength	F_b	2.1 ¹	1-1.645 COV _b	0.16 ²	2.85
Tensile Strength	F_t	2.1 ¹	1-1.645 COV _t	0.16 ²	2.85
Shear Strength	F_v	2.1 ¹	1-1.645 COV _v	0.14 ²	2.75
Compression Strength	F_c	1.9 ¹	1-1.645 COV _c	0.16 ²	2.58
Buckling Strength	E_{05}	1.66 ⁴	1-1.645 COV _E	0.11 ⁵	2.03
Bearing Strength	$F_{c\perp}$	1.67 ⁶	1.0 ⁷	<mean value>	1.67

¹ taken from Table 8 of ASTM D245 *Standard Practice for Establishing Structural Grades and Related Allowable Properties for Visually Graded Lumber* [20], Table 1 of ASTM D3737 *Standard Practice for Establishing Allowable Properties for Structural Glued Laminated Timber (Glulam)* [21], and Table 1 of ASTM D5456 *Standard Specification for Evaluation of Structural Composite Lumber Products* [22].

² taken from Table 5-6 of 2010 *Wood Handbook* [23] for clear wood bending values.

³ taken from Table 5-6 of 2010 *Wood Handbook* for clear wood shear values.

⁴ taken from Appendices D and H of 2018 *National Design Specification for Wood Construction*.

⁵ taken from Appendix F of 2018 *National Design Specification for Wood Construction*.

⁶ taken from Table 2 of ASTM D5457 *Standard Specification for Computing Reference Resistance of Wood-Based Materials and Structural Connections for Load and Resistance Factor Design*.

⁷ $F_{c\perp}$ is a mean-based value, so no adjustment for COV should be made.

C3.2.5 Design of Members

For fire design, the induced load cannot exceed the average member capacity of a wood member exposed to fire for a given time, t . The average member capacity is estimated using cross-sectional properties reduced for fire exposure in accordance with FDS 3.2.3 and average ultimate strength properties derived from reference design values in accordance with FDS 3.2.4.

C3.2.5.1 Special Provisions for Lumber Decking: Sides of individual timber decking members are shielded from full fire exposure by adjacent members. Partial exposure occurs as decking members shrink and gaps form between the decking members. The degree of exposure is a function of the view angle of the radiant flame and the ability of hot volatile gases to pass through the gaps.

C3.2.5.1.1 For intersections which are not open, as with tongue-and-groove timber decking, tests have shown that charring of the sides of members is negligible and can be ignored.

C3.2.5.1.2 When the gaps between mechanically-laminated decking are unobstructed, such as can occur when the decking is untopped, hot gases will carry into the gaps and the sides of the decking members will char. This charring can be conservatively approximated assuming the sides of a member, char to a depth of a_{eff} . When the gaps are obstructed, as when the decking is topped with wood structural panels or continuous topping, tests have shown that charring can be approximated assuming a partial exposure char rate, such that it chars to a depth of $a_{eff}/3$.

C3.2.5.2 Special Provisions for Structural Glued Laminated Timber Beams: The outer laminations of glued laminated timber bending members in Table 5A of the NDS Supplement [24] are typically higher strength laminations. When the beam is exposed to fire, these

laminations are the first to be charred. In order to maintain the ultimate capacity of the beam when these laminations are completely charred, core laminations must be replaced with the higher strength laminations in the beam layup. For unbalanced beams, only the core laminations adjacent to the tension side lamination need to be replaced as shown in FDS Figures 3-1(b) and 3-1(c). For balanced beams, the core laminations adjacent to the tension laminations on both sides need to be replaced as shown in FDS Figures 3-2(b) and 3-2(c).

C3.3 Protection of Structural Wood Members and Wood Assemblies

Where protective materials are used to increase the fire resistance of structural wood members, the structural fire resistance times of protected wood members are calculated in accordance with the provisions of exposed wood members in FDS 3.2; however, fire exposure and calculation of charring of each protected surface is delayed by the protection time, t_p . The value of t_p , for the protective material, is the delay of the onset of charring of the protected surface and is permitted to be determined either by testing or using assigned values and calculations in accordance with FDS 3.3. Where all surfaces of a structural wood member are protected with a protection system, such as when protected on the fire exposure side by one or more protective membranes, the protection time of the protection system is directly additive with the structural fire resistance time of the structural wood member calculated for the exposed wood member in FDS 3.2.

C3.3.1 Protection by Wood

C3.3.1.1 Wood cover in contact with protected member: Testing of single layer and multi-layer wood cover [25] has shown that t_p can be estimated with the non-linear char rate equations in FDS 3.2.2 and have been restructured to provide FDS Equations 3.3-1 and 3.3-2.

C3.3.1.2 Wood cover not in contact with protected member: Testing of single layer of protection that is unbacked by additional material appears to char faster. This accelerated charring is likely due to loss of moisture and introduction of fresh air from the unexposed surface [25]. FDS Equations 3.4-1a and 3.4-1b were derived to model this accelerated char which averaged approximately 2.1 in./hr in the last 17 minutes.

C3.3.1.3 Wood membrane: Where wood cover is used as a membrane, such as wood structural panels protecting a wood assembly, t_p is estimated using either the provisions of FDS 3.3.1.1 or 3.3.1.2 depending on whether the wood cover is in contact with the protected surfaces or not. Note that, since the wood cover is acting as a membrane, the protection time calculated in FDS 3.3.1.1 or FDS 3.3.1.2 is directly additive with protection times from Type X gypsum panel membranes and/or insulation membranes and with the structural fire resistance time of the structural wood member calculated for the exposed wood member in FDS 3.2.

C3.3.1.4 Fasteners attaching wood protection: Assuming a fastener tip length of 1/4 inches, (2 diameters for common fasteners per NDS 12.3.5.3b), a minimum penetration of 1 inch would hold the charred wood protection in place for approximately 25 minutes after the char front has moved

beyond the protection, effectively ensuring the insulating benefit of the char layer and slowing the charring of the protected surfaces below until a slower, more steady-state char rate is reached.

$$t = 60 \left(\frac{1-0.25}{1.5} \right)^{1.23} = 25 \text{ minutes} \quad (\text{C3.2-4})$$

C3.3.1.5 Char contraction: Construction tolerances and shrinkage of wood members leave wood member ends and edges exposed which results in ignition of those wood surfaces. As the wood chars, the char layer contracts so that the thickness of the char layer is less than the char depth previously denoted as a_{char} (see Figure C3-1). For structural calculations, the uncharred wood remaining after a given exposure time is all that is needed and the reduced char thickness is already included in the nonlinear char rate; however, where wood is used as protection, char contraction must be considered at ends and edges of protective elements. White measured the char contraction on the same wood specimens that were used to develop the non-linear char model [18]. Measured ratios of char thickness to a_{char} ranged from 0.50 to 0.90, with an average value of approximately 0.70 and a COV of 0.17.

The loss of dimension at any location within the char layer can thus be estimated by multiplying the char depth, a_{char} , at that location by 0.3 as shown in Figure C3-1. For example, a wood member with $a_{\text{char}} = 1$ inch in the face of the member would have a char contraction of approximately 0.3 inches, leaving a char thickness of 0.7 inches.

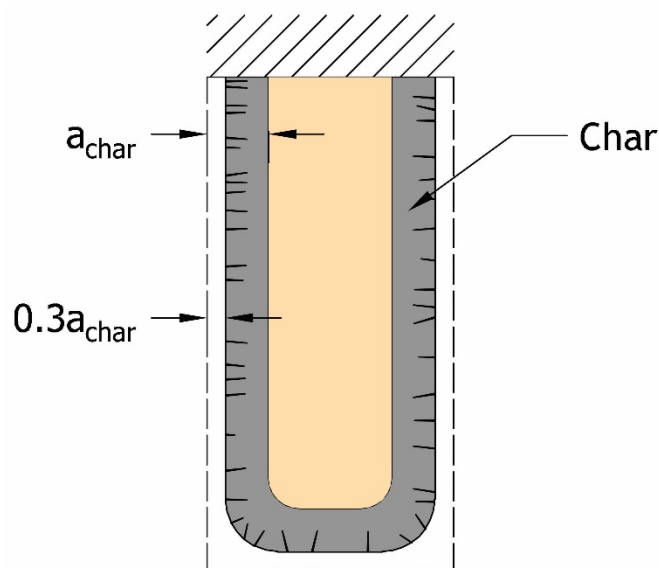


Figure C3-1. Char contraction

Charring and char contraction begin soon after ignition of the wood. Char contraction at unbonded wood member ends and edges results in ignition, albeit delayed, of wood surfaces in the gaps at these locations, as shown in Figure C3-2. As a result, ignition extends into these gaps a distance that is approximately twice the char depth, $2a_{\text{char}}$, as shown in Figure C3-3. Ignition occurs when the wood is initially exposed to fire providing insufficient time for an elevated temperature zone to form at the point of ignition. Since the elevated temperature zone does not initially extend beyond the point of ignition in the gap created by char contraction, the char

penetration into the gap does not need to be increased by the 1.2 factor used for structural calculations. The elevated temperature zone is depicted by the red line in Figure C3-3.



Figure C3-2. Example of char contraction at abutting edges of CLT floor panels (photo courtesy of Katerra)

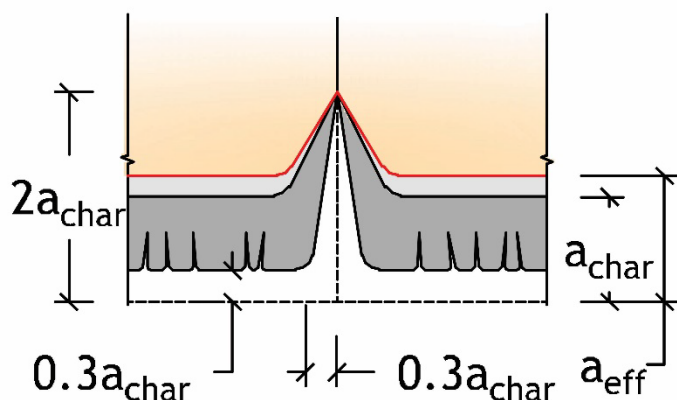


Figure C3-3. Char contraction at abutting wood members that are unbonded

C3.3.2 Protection by Type X Gypsum Panel Products

C3.3.2.1 Gypsum panel cover: Testing of single layer and multi-layer of Type X gypsum panels has shown that t_p can be consistently estimated [25][26]. The protection provided by two thicknesses of Type X gypsum board that have been extensively tested are documented in TR10 and provided in FDS Table 3.3.2.1.

C3.3.2.2 Gypsum panel membrane: Where Type X gypsum panels are used as a membrane to protect a wood member or wood assembly, t_p is estimated using the provisions of FDS 3.3.2.2. Note that, since the wood cover is acting as a membrane, the protection time calculated in FDS 3.3.2.2 is directly additive with protection times from wood and/or insulation membranes and with

the structural fire resistance time of the structural wood member calculated for the exposed wood member in FDS 3.2. For wall assemblies, fastener configurations with specified screws and spacings closer than those tabulated in FDS 3.3.2.1 have been shown to increase the added fire resistance time provided by the gypsum panel membrane see FDS Table 3.3.2.1 footnotes (7, 8 and 9); however, this benefit has not been observed in testing of floor-ceiling and roof-ceiling assemblies.

C3.3.2.3 Fasteners attaching gypsum panel products: Assuming a fastener tip length of 1/4 inches, (2 diameters for common fasteners per NDS 12.3.5.3b), a minimum penetration of 1 inch would hold the charred wood protection in place for approximately 25 minutes after the char front has moved beyond the protection, effectively ensuring the insulating benefit of the char layer and slowing the charring of the protected surfaces until a slower, more steady-state char rate is reached.

C3.3.2.4 Gypsum panel product contraction: Small-scale tests have shown that both regular and Type X gypsum board shrink very little until the gypsum board reaches a temperature of about 600°F. Shrinkage (contraction) increases slightly between 600°F and 850°F, slows between 850°F and 1650°F, then increases rapidly above 1650°F [27] (see Figure C3-4). The various stages of thermal contraction indicate chemical decomposition of the gypsum. Given that the E119 time – temperature curve reaches 1000°F in the first 5 minutes of the test, it can be assumed that the surface of gypsum panel products on the fire exposed side of the gypsum panel also reaches 1000°F in 5 minutes. Measurements of “finish ratings” of wood-frame assemblies protected with gypsum panel products (a finish rating is the time at which the wood stud or wood joist reaches an average temperature rise of 250°F or an individual temperature rise of 325°F as measured on the plane of the wood nearest the fire under the protection) suggest that the temperatures on the unexposed side of the gypsum panel at the finish rating time would be approximately 325-400F (assuming initial temperature of approximately 75°F at the start of the test). Assuming a linear temperature gradient through the gypsum panel, the average temperature in the gypsum panel, at the finish rating time would be approximately 650-700F, which is the point at which the first stage of significant thermal contraction occurs in gypsum, as shown in Figure C3-4. Thermal contraction in gypsum panels is responsible for the development of cracks and fissures in the gypsum panel, as well as the formation of gaps at the ends and edges of the gypsum panel that are initially considered to be in contact. A conservative estimate of the time at which gypsum panel contraction begins to form gaps at ends and edges of gypsum panels, that is initially tightly fitted, is at the finish rating time of the assembly, or approximately 50% of the protection time provided by the gypsum panel (see FDS 3.5.2.1).

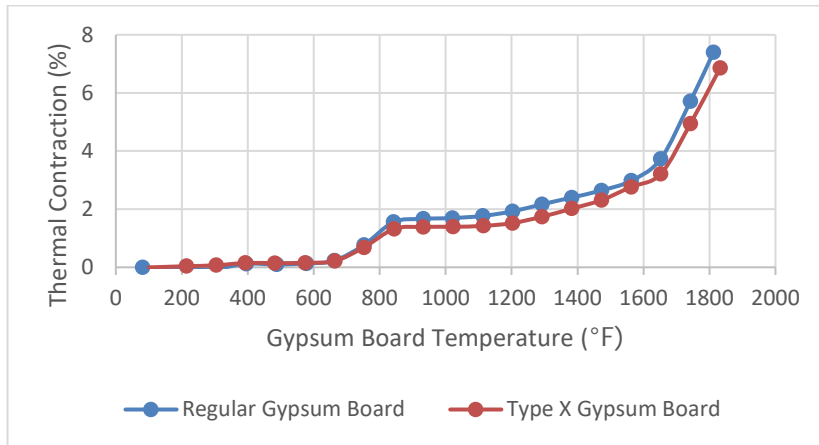


Figure C3-4. Thermal Contraction of Gypsum Board

C3.3.3 Protection by Insulation

C3.3.3.1 *Insulation cover*: Relative comparisons of E119 test data have been used to develop t_p values for two common insulation products; mineral wool batts with a minimum nominal density of 2.5 pcf and ranging from 1.5 inches thick to 5.5 inches thick and fiberglass batts ranging from 3.5 in. thick R-13 batts to and 6.25 in. thick R-19 batts compressed to 5.5 inch thickness (see TR10). In general, mineral wool batts of 3.5 inches and thicker provided approximately 19 minutes of protection, but 1.5 inches thick mineral wool batts provided slightly less protection at $t_p=15$ minutes. For fiberglass batts, there was no significant difference between R-13 (3.5 inches thick) batts and R-19 (5.5 inches thick) batts, both providing $t_p=3$ minutes. Because thicknesses of mineral wool insulation and fiberglass insulation greater than 3.5 inches did not provide increased protection times, the tabulated protection times specified in FDS Table 3.3.3.1 are not to be additive with each other and should not be increased for additional insulation thickness, density, or R-value without additional testing.

C3.3.3.2 *Insulation as part of a membrane*: Like other materials used as protection, where mineral wool or fiberglass insulation are used as part of a membrane to protect the entire wood member or wood assembly, the protection time calculated in FDS 3.3.3.1 is directly additive with protection times from wood and/or gypsum panel membranes and the structural fire resistance time of the structural wood member calculated for the exposed wood member in FDS 3.2.

C3.4 Calculation of Structural Fire Resistance Time of Protected Wood Members and Wood Assemblies

Protection of wood members or assemblies delays the onset of charring on each protected surface. The delay can range from a few minutes to several hours. The structural fire resistance time for protected wood members and assemblies can be calculated in accordance with the provisions for exposed wood member in FDS 3.2, accounting for delayed charring on each

protected surface when calculated in accordance with FDS 3.3. The provisions for calculating the structural fire resistance time for a structural member is limited to charring for up to 2 hours, but when a surface is protected, that 2-hour limit starts after the delay of charring on that surface. When exposure of a member or assembly is delayed on all surfaces, as by a protective membrane, the 2-hour limit can be extended by the protection time.

C3.5 Calculation of Thermal Separation Time

The thermal separation time is defined as the time at which an average temperature rise of 250°F or an individual temperature rise of 325°F is reached on the unexposed side of the wood assembly. The thermal separation time of a wood assembly can be determined by testing to ASTM E119 or UL 263 or by calculation. When determined by calculation following the procedures of FDS 3.5, thermal separation can be estimated by summing the times assigned to the protective membranes on both the fire-exposed side of the assembly and the unexposed side of the assembly, and additional contribution by other protective components in the assembly, such as insulation. During testing or by calculation, if the structural fire resistance time occurs before the thermal separation time is reached, the thermal separation time is limited to the structural fire resistance time since the structural assembly is assumed to hold the protective membranes in place.

C3.5.1 Thermal Separation Time provided by Wood Layers

C3.5.1.1 *Wood cover or membranes*: Testing has shown that the contribution of wood layers to the thermal separation time is equal to the sum of protection times assigned to each layer, determined in FDS 3.3.1, except where a single layer of wood is used to provide thermal separation or where the final layer is located on the unexposed side of the thermal separation is wood, the time assigned to that wood layer, as determined in FDS 3.3.1, should be multiplied by 0.85 [17][18]. The 0.85 factor limits the temperature rise on the backside of the last layer of wood to an average temperature rise of 250°F.

C3.5.1.2 *Char contraction*: Where char contraction will cause gaps to form between wood members or wood cover that are initially considered to be in contact, additional protection may be necessary to ensure that wood members or wood cover provide the required thermal separation time. See C3.3.1.5 for calculation of depth of char penetration into gaps.

C3.5.2 Thermal Separation Time provided by Type X Gypsum Panel Products

C3.5.2.1 *Gypsum panel cover or membranes*: Testing has shown that the contribution of Type X gypsum panel layers to the thermal separation time is equal to the sum of protection times assigned to each layer, determined in FDS 3.3.2, except where a single layer of Type X gypsum panel is used to provide thermal separation or where the final layer of a multi-layer construction located on the unexposed side of the thermal separation is Type X gypsum panel, the time assigned to that Type X gypsum panel layer, determined in FDS 3.3.2, should be multiplied by 0.50 [17][18]. The 0.50 factor limits the temperature rise on the backside of the last layer of Type X gypsum

panel to an average temperature rise of 250°F and is a conservative estimate of the “finish rating”. See C3.3.2.4 for discussion of the “finish rating”.

C3.5.2.2 Gypsum panel product contraction: Where Type X gypsum panel contraction will cause gaps to form between adjoining gypsum panels that are initially considered to be in contact, limited ignition of combustible materials directly behind the gaps will likely occur at the time assigned to that Type X gypsum panel layer, determined in FDS 3.3.2, multiplied by 0.50; however, the effect on the thermal separation time, estimated in FDS 3.5.2.1, is permitted to be ignored since the impact on the wood assembly is typically only limited to ignition of the wood directly behind the gap and doesn’t impact the overall wood assembly. See C3.3.2.4 for discussion of gypsum panel product contraction.

C3.5.3 Thermal Separation Time provided by Insulation

3.5.3.1 Insulation protection time: Testing has shown that the contribution of insulation within an assembly to the protection time can be directly added to the thermal separation time, determined in FDS 3.3.3, since the location where limiting temperature rise for thermal separation is measured is not on the surface of the insulation. If an unconventional assembly were developed that measured the temperature rise on the unexposed side of the insulation, the contribution of the insulation may need to be limited. Because thicknesses of mineral wool insulation and fiberglass insulation greater than 3.5 inches did not provide increased protection times, the tabulated protection times specified in FDS Table 3.3.3.1 are not intended to be additive with each other and should not be increased for additional insulation thickness, density, or R-value without additional testing (see also C3.3.3).

C3.6 Calculation of Burn-Through Time

Burn-through time between wood members or through wood assemblies is also limited in wood assemblies tested or designed to meet the requirements of ASTM E119 or UL 263. Burn-through of wood assemblies is typically limited by char contraction between the wood members or wood cover or by Type X gypsum panel product contraction between the gypsum panels on the unexposed side of the wood assembly. Char contraction can be estimated using the provisions of FDS 3.5.1.2. Gypsum panel product contraction can be estimated using the provisions of FDS 3.5.2.2. Typically, burn-through is addressed by detailing of adequate protection to ensure that gaps on the unexposed side of the assembly don’t occur before the required structural fire resistance time or the thermal separation time is reached.

C3.7 Tested Fire-resistance-rated Wood Assemblies

The wood assemblies tested in accordance with ASTM E119 or UL 263 are provided in Supplement B as a reference to designers. These tested assemblies can be used directly since they were tested in accordance with the code-referenced test standards and meet the specified fire-resistance ratings.

C3.8 Component Additive Method for Wood Assemblies

FDS 3.8 provides a new Component Additive Method for determining the fire-resistance ratings of wall assemblies, floor/ceiling assemblies, and roof/ceiling assemblies. The provisions are based on analysis of test data from wood assemblies tested in accordance with ASTM E119, UL 263, ISO 834 [28], and ULC S101 [29] as reported in TR10 [17] and calculations in accordance with FDS 3.1 through 3.6.

C3.8.1 Calculating the Structural Fire Resistance Time

The structural fire resistance times of wood assemblies in FDS 3.8.1 are based on structural fire resistance times for the structural members calculated per provisions of FDS 3.2 [17] and the protection times assigned to protective membranes on the fire-exposed side in accordance with FDS 3.3. For ease of use, typical structural fire resistance times for the structural members are provided in FDS 3.8.1.1 and typical protection times assigned to protective membranes are provided in FDS 3.8.1.2. Because these wood assemblies are wood structural members protected with membranes, the structural fire resistance time is the sum of the structural fire resistance time (FDS 3.8.1.1) and the membrane protection time (FDS 3.8.1.2). Note that since insulation may only protect certain surfaces, especially in more complex shapes such as wood I-joists, the contribution of insulation is included in the tabulated structural fire resistance times for the structural members. Insulation, where required for member protection, should fill the cavities between wall studs or be placed between joists or trusses at the ceiling side of horizontal assemblies. The membrane on the unexposed side does not contribute to the structural fire resistance time of the assembly, so it should not be included in the structural fire resistance time. However, the membrane on the unexposed side of the assembly may be required to provide lateral bracing to the structural wood members after degradation of the membrane on the exposed side.

C3.8.1.1.1 Sawn Lumber, LVL, PSL, or LSL Studs: The structural fire resistance times for studs in FDS Table 3.8.1.1.1 are calculated using the provisions from FDS 3.2 for wood members exposed on 3 sides and assuming an initial concentric compression load for each stud limited as a percentage of either the maximum bearing (ASD adjusted compression perpendicular to grain stress, $F_c \perp'$, at the stud to plate bearing) or the maximum axial compression (ASD adjusted compression parallel to grain stress, F_c' , for an individual stud) with an unbraced length of 115.5 inches (a wall height of 120 inches minus the thickness of three 1.5 inch thick wall plates) and a buckling length coefficient, $K_e = 1.0$. Tabulated values in FDS Table 3.8.1.1 are based on common ratios of maximum bearing or axial compression typically used in testing. During E119 fire tests of walls with membranes on both faces, it has been observed that structural failure occurs when the studs buckle out of the furnace in the strong axis due to charring of the edge of studs on the exposed side of the assembly creating eccentric loading. To model this behavior using the provisions of FDS 3.2, the stress interaction in NDS 15.4.1 is calculated assuming an eccentricity, $e = a_{char}/2$ and $K_e = 0.7$ to simulate square-cut bearing on the wood plates. The delay in charring

on the sides of the studs when insulation is present is addressed in the model and represented in the tabulated values. For more information, see TR10.

C3.8.1.1.2 Sawn Lumber, LVL, PSL, or LSL Joists: The structural fire resistance times for rectangular joists in FDS Table 3.8.1.1.2 are calculated using the provisions from FDS 3.2 for wood members exposed on 3 sides and assuming full lateral bracing of the compression edge and a uniform load for each joist limited as a percentage of the maximum ASD adjusted bending stress, F_b' . The delay in charring on the sides of the joists when insulation is present is addressed in the model and represented in the tabulated values. For more information, see TR10. While the tabulated times are based on ratios of f_b/F_b' , for cases where f_v/F_v' controls the design, the tabulated fire resistance time for a given stress ratio is slightly conservative for all cases.

C3.8.1.1.3 Wood I-Joists: The structural fire resistance time for wood I-joists in FDS Table 3.8.1.1.3 are calculated using the provisions from FDS 3.2 for wood members exposed on multiple surfaces and assuming a uniform load for each I-joist limited to the maximum bending capacity provided by the manufacturer. The maximum bending capacity is based on the ASD adjusted moment capacity for given flange dimensions and the maximum shear capacity is based on the ASD adjusted shear capacity for a given web thickness. The structural fire resistance time is the minimum resistance time assigned to the flange and the web in Table 3.8.1.1.3. The delay in charring on protected surfaces of the I-joists when insulation is present is addressed in the model and represented in the tabulated values. For more information, see TR10.

The structural fire-resistance times assigned for wood I-joists based on flange dimensions can be conservatively applied for joists with larger flange sizes. Alternatively, times for other flange sizes can be determined based on calculations using the procedures of FDS 3.4.

C3.8.1.2 Protection of Wood Members: The added fire protection times in FDS Table 3.8.1.2a for a wood membrane(s) are based on FDS 3.3.1.3. The added fire protection times in FDS Table 3.8.1.2b for a Type X gypsum panel membrane(s) are based on the FDS 3.3.2.2.

C3.8.2 Calculating the Thermal Separation Time

The provisions of FDS 3.8.2 allow calculation of the thermal separation time based on provisions of FDS 3.5. Specific provisions for calculation of thermal separation time allow more accurate fire protection times to be assigned to wood cover and Type X gypsum panel membranes for the calculation of structural fire resistance times without overpredicting the thermal separation times provided by these membranes. Note that, where the calculated thermal separation time for a structural assembly exceeds the structural fire resistance time, the thermal separation time must be limited to the structural fire resistance time, because the structural members are required to hold the membranes and insulation (if present) in place.

C3.8.2.1 Contribution from Membranes: Thermal separation times assigned to protective membranes are based on the protection times in FDS Tables 3.8.1.2a and 3.8.1.2b. Where a single layer of wood or Type X gypsum panel membrane is used to provide all of the thermal separation or where the final layer of thermal separation on the unexposed side of the assembly is a wood

layer or Type X gypsum panel layer, the time assigned to that wood layer or Type X gypsum panel layer are multiplied by 0.85 based on FDS 3.5.1.1 or 0.5 based on FDS 3.5.2.1, respectively.

C3.8.2.2 Contribution from Insulation: Thermal separation times assigned to insulation in FDS Table 3.8.2.2 assume that the insulation fills the cavity between the studs in a wall or is continuous between joists or trusses in a horizontal assembly. Because thicknesses of mineral wool insulation and fiberglass insulation greater than 3.5 inches did not provide increased protection times, the tabulated protection times specified in FDS Table 3.3.3.1 are not to be additive with each other and should not be increased for additional insulation thickness, density, or R-value without additional testing (see also C3.3.3).

C3.9 Design of Protected Wood Connections

Where a wood member or a wood assembly is required to have a fire-resistance rating, wood structural connections in that member or assembly must perform their function for the time corresponding to the required fire resistance rating. For wood-frame assemblies, such as wall, floor, and roof assemblies, testing and calculations have demonstrated that structural connections within a fire-resistance rated assembly are adequately protected to ensure that the assembly meets the required fire resistance rating. For wood members that are not within an assembly, such as beams and columns, structural connections to or between these wood members are typically protected using the same or additional protection used to protect the wood members. Since neither ASTM E119 nor UL 263 contain provisions for testing the fire resistance of structural connections, these connections are designed using the requirements of FDS 3.9. For wood structural connections, all required components of the connection are required to be protected, including any metal connectors, fasteners that are part of the structural connection, and portions of the connected members that are part of the structural connection. Fasteners that attach the protection, but are not part of the structural connection, do not need to be protected; however, those fasteners should meet the minimum attachment requirements in FDS 3.3.1.4 for wood cover and in FDS 3.3.2.3 for Type X gypsum panel product protection.

C3.9.1 Connection Protection

Since structural connections are not specifically designed for a fire-resistance rating, these connections must be protected. Using the provisions of FDS 3.5 ensure that no part of the connection is exposed to an average temperature rise of 250°F or an individual temperature rise of 325°F, well below the level of significant strength loss of steel or charring of wood.

C3.9.2 Gaps at Ends and Edges

The penetration of ignition into gaps formed by char contraction at unbonded wood member ends and edges can adversely impact the protection provided by portions of the wood member that are not part of the structural connection or additional wood cover that is intended to protect the structural connection. Detailing that takes into account the effects of char contraction should be

incorporated in the connection protection design. See also C3.3.1. Examples of protection detailing of structural connections at ends and edges of wood members are provided in TR10 [17].

The exception to the char contraction provisions in 3.9.2 is based on results of E119 testing of beam-column bearing intersections [31]. The test results indicated that char contraction is not an issue in bearing intersections when a minimal load is applied. In these bearing intersections, progression of the char front is the same as the expected char depth, a_{char} , in solid wood as shown in Figure C3-5.

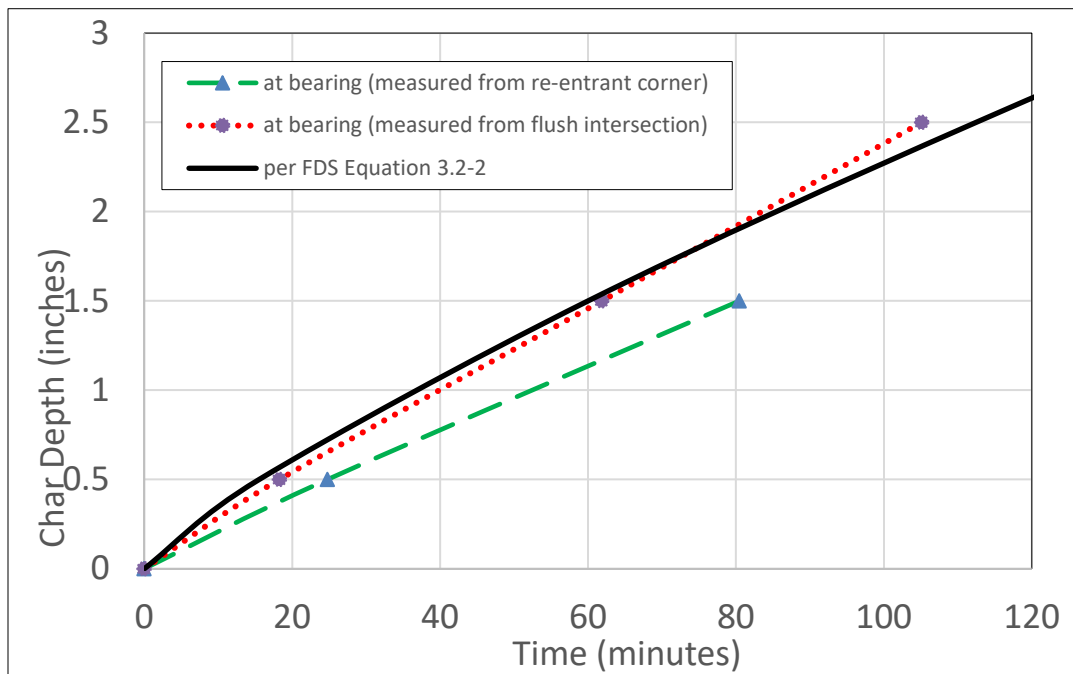



Figure C3-5. Char Depth, a_{char} , at beam/column bearing intersection

COMMENTARY REFERENCES

1. ANSI/AWC NDS-2018: “National Design Specification® (NDS®) for Wood Construction”. American Wood Council, Leesburg, VA, 2018.
2. International Building Code (IBC). International Code Council, Washington, DC, 2021.
3. NFPA 268-2017: “Standard Test Method for Determining Ignitability of Exterior Wall Assemblies Using A Radiant Heat Energy Source, 2017 Edition”. National Fire Protection Association [NFPA], New York, NY, 2017.
4. ASTM E84 - 20: “Standard Test Method for Surface Burning Characteristics of Building Materials”. ASTM, Philadelphia, PA, 2020.
5. UL 723: “Standard for Test for Surface Burning Characteristics of Building Materials”. Underwriters Laboratories Inc, Northbrook, IL, 2018.
6. NFPA 286-2019: “Standard Methods of Fire Tests for Evaluating Contribution of Wall and Ceiling Interior Finish to Room Fire Growth”. National Fire Protection Association [NFPA], New York, NY, 2019.
7. ASTM E648 – 19ae1: “Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source”. ASTM, Philadelphia, PA, 2019.
8. NFPA 253-2019: “Standard Method of Test for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source”. National Fire Protection Association [NFPA], New York, NY, 2019.
9. NFPA 13-2019: “Standard for the Installation of Sprinkler Systems”. National Fire Protection Association [NFPA], New York, NY, 2019.
10. NFPA 13R-2019: “Standard for the Installation of Sprinkler Systems in Low-Rise Residential Occupancies”. National Fire Protection Association [NFPA], New York, NY, 2019.
11. ASTM 2859 – 16: “Standard Test Method for Ignition Characteristics of Finished Textile Floor Covering Materials”. ASTM, Philadelphia, PA, 2016.
12. ASTM E2768 – 11(2018): “Standard Test Method for Extended Duration Surface Burning Characteristics of Building Materials (30 min Tunnel Test)”. ASTM, Philadelphia, PA, 2018.
13. ASTM E119 - 20: “Standard Test Methods for Fire Tests of Building Construction and Materials”. ASTM, Philadelphia, PA, 2020.
14. UL 263. “Fire Tests of Building Construction and Material”. Underwriters Laboratories Inc, Northbrook, IL, 2014.
15. ASTM D6513 – 14: “Standard Practice for Calculating the Superimposed Load on Wood-frame Walls for Standard Fire-Resistance Tests”. ASTM, Philadelphia, PA, 2014.
16. ASTM D7746 – 11(2016): “Standard Practice for Calculating the Superimposed Load on Wood-frame Floor-Ceiling Assemblies for Standard Fire-Resistance Tests”. ASTM, Philadelphia, PA, 2016.

17. TR10-2020: “Technical Report 10: Calculating the Fire Resistance of Wood Members and Assemblies”. American Wood Council, Leesburg, VA, 2020.
18. White, Robert H., “Charring Rates of Different Wood Species,” PhD Thesis, University of Wisconsin, Madison, WI, 1988.
19. ANSI/APA PRG 320-19: “Standard for Performance-Rated Cross-Laminated Timber”, APA – The Engineered Wood Association, 7011 South 19th Street, Tacoma, WA. 2019.
20. ASTM D245 – 06(2019): “Standard Practice for Establishing Structural Grades and Related Allowable Properties for Visually Graded Lumber”. ASTM, Philadelphia, PA, 2019.
21. ASTM D3737 – 18e1: “Standard Practice for Establishing Allowable Properties for Structural Glued Laminated Timber (Glulam)”. ASTM, Philadelphia, PA, 2018.
22. ASTM D5456 – 19: “Standard Specification for Evaluation of Structural Composite Lumber Products”. ASTM, Philadelphia, PA, 2019.
23. Wood Handbook, Agriculture Handbook No. 72, U.S. Department of Agriculture, Forest Service, Forest Products Laboratory, Washington, DC, 2010.
24. NDS Supplement to the National Design Specification® (NDS®) for Wood Construction. American Wood Council, Leesburg, VA, 2018.
25. White, Robert H. “Fire Resistance of Engineered Wood Rim Board Products”, Research Paper FPL-RP-610, U.S. Forest Products Laboratory, U.S. Department of Agriculture, Madison, WI, May 2003.
26. “Fire Resistance Testing of CLT Floor/Ceiling Assemblies to Establish Contribution of Gypsum Protection”. WFCi Report #17091r1, Western Fire Center Inc., Kelso, WA, November 28, 2017.
27. Bénichou, N.; Sultan, M.A.; MacCallum, C.; and Hum, J. “Thermal Properties of Wood, Gypsum and Insulation at Elevated Temperatures”. IR-710. National Research Council of Canada. ON, Canada, October 2001.
28. ISO 834:2019 “Fire-Resistance Tests - Elements of Building Construction”. International Organization for Standardization, Geneva, Switzerland, 2019.
29. CAN/ULC S101, “Standard Methods of Fire Endurance Tests of Building Construction and Materials”, Underwriters’ Laboratories of Canada, Toronto, ON, Canada, 2014.
30. ASTM D5457 - 20: “Standard Specification for Computing Reference Resistance of Wood-Based Materials and Structural Connections for Load and Resistance Factor Design”. ASTM, Philadelphia, PA, 2020.
31. “Fire Resistance Testing of Beam/Column Intersections”, WFCi Report #20062, Western Fire Center Inc., Kelso, WA, November 19, 2020.

SUPPLEMENT

S

Supplement A: Flame Spread Performance of Wood Products Used for Interior Finish

Table A1 Reported Flame Spread Indices of Solid Wood Products

Material ¹	ASTM E84 Flame Spread Index	Flame Spread Class	ASTM E84 Smoke Developed Index	Source ²
Alder	80	C	165	HPVA T-14189 (2013)
Aspen	105	C	45	Exova 15-002-475(C1) (2015)
Birch, Yellow	NA ⁴	C ⁴	NA	UL527 (1971)
Cedar, Alaska	40	B	140	HPVA T-15591 (2017)
Cedar, Alaska Yellow	50	B	115	HPVA T-12704 (2008)
Cedar, Eastern White	40	B	200	HPVA T-15318 (2017)
Cedar, Incense	45	B	150	HPVA T-15204 (2016)
Cedar, Port Orford	60	B	150	HPVA T-12694 (2008)
Cedar, Western Red	45	B	125	HPVA T-15172 (2016)
Cottonwood	NA ⁴	C ⁴	NA	UL527 (1971)
Cypress	75	B	200	HPVA T-14530 (2014)
Douglas-fir	70	B	80	HPVA T-14253 (2013)
Fir, Balsam	45	B	105	HPVA T-15557 (2017)
Fir, White	40	B	80	HPVA T-15088 (2016)
Gum, Red	NA ⁴	C ⁴	NA	UL527 (1971)
Hem-Fir Species Group ³	60	B	70	HPVA T-10602 (2001)
Hemlock, Eastern	35	B	175	HPVA T-15320 (2017)
Hemlock, Western	40	B	60	Exova 15-002-475(A1) (2015)
Maple (flooring)	NA ⁴	C ⁴	155	CWC FP-6 (1973)
Maple (rough sawn)	35	B	250	HPVA T-14573 (2014)
Oak, Red or White	NA ⁴	C ⁴	NA	UL527 (1971)
Pine, Eastern White	70	B	110	HPVA T-14186 (2013)
Pine, Idaho White	NA ⁴	B ⁴	125	HPVA T-592 (1974)
Pine, Jack	50	B	165	HPVA T-15556 (2017)
Pine, Lodgepole	75	B	140	HPVA T-15029 and T-15069 (2015)
Pine, Ponderosa	55	B	135	HPVA T-15067 (2016)
Pine, Red	115	C	65	Exova 15-002-475(B1) (2015)
Pine, Southern Yellow	70	B	165	HPVA T-14254 (2013)
Pine, Sugar	45	B	110	HPVA T-15068 (2016)
Pine, Western White	NA ⁴	B ⁴	NA	UL527 (1971)
Poplar, Yellow	125	C	125	HPVA T-14512 (2014)
Redwood	55	B	135	HPVA T-14185 and T-14243 (2013)
Spruce, Black	45	B	250	HPVA T-14053 (2013)
Spruce, Black (4" thick, 3 layers of cross laminations)	35	B	55	HPVA T-14054 (2013)
Spruce, Eastern Red	65	B	170	HPVA T-15034 (2015)
Spruce, Western White	45	B	120	HPVA T-15032 (2015)
Tamarack	35	B	90	HPVA T-15393 (2017)
Walnut	75	B	125	HPVA T-14526 (2014)

Table A1 Footnotes

- ¹ Thickness of material tested is one-inch nominal except where indicated.
- ² Sources: CWC – Canadian Wood Council; Exova – Exova Warringtonfire North America; HPVA – Hardwood Plywood Veneer Association; UL – Underwriters' Laboratories. Test report numbers and year of test are indicated. Where multiple reports are cited, tabulated FSI and SDI values represent the average of values from the respective test reports.
- ³ The Hem-Fir Species Group represents six species: Californian Red Fir, Grand Fir, Noble Fir, Pacific Silver Fir, Western Hemlock, and White Fir. The reported flame spread index represents a product containing a mixture of these species. When lumber is from a single species refer to the specific species flame spread index.
- ⁴ Flame spread index cannot be directly determined from the referenced source; however, the reported Flame Spread Class is deemed to be a reasonable estimate based on changes to the analysis method of test results as reported within the referenced source.

Table A2 Reported Flame Spread Indices of Wood Panels

Material	ASTM E84 Flame Spread Index	Flame Spread Class	ASTM E84 Smoke Developed Index	Source ¹
ORIENTED STRAND BOARD (Exterior Glue) ²				
5/16"	127-138	C	155-171	APA (1985)
3/8"	100	C	95	HPVA T-15116 (2016)
7/16"	115-155	C	75-130	APA 8901-8 (1989)
15/32"	100	C	80	HPVA T-15117 (2016)
1/2"	75-172	C	109-194	APA (1985)
19/32"	175	C	95	HPVA T-14312 (2013)
23/32"	100	C	60	HPVA T-15118 (2016)
3/4"	147-158	C	111	APA (1985)
1-1/8"	110	C	115	HPVA T-15298 (2016)
SOFTWOOD PLYWOOD (Exterior Glue) ³				
1/4"	NA ⁵	C ⁵	55-200	UL R6829 (1973)
3/8"	NA ⁵	C ⁵	22-144	UL R6829 (1973)
1/2"	NA ⁵	C ⁵	55	UL R6829 (1973)
19/32"	95	C	50	HPVA T-14311 (2013)
5/8"	NA ⁵	C ⁵	50-85	UL R6829 (1973)
1/4" Douglas-fir Plywood	85	C	70	HPVA T-15293 (2016)
3/8" Douglas-fir Plywood	65	B	60	HPVA T-15295 (2016)
15/32" Douglas-fir Plywood	40	B	50	HPVA T-15114 (2016)
23/32" Douglas-fir Plywood	35	B	55	HPVA T-15294 (2016)
11/32" Southern Pine Plywood	75	B	115	HPVA T-15113 (2016)
15/32" Southern Pine Plywood	95	C	135	HPVA T-15297 (2016)
23/32" Southern Pine Plywood	65	B	175	HPVA T-15296 (2016)
HARDWOOD PLYWOOD⁴				
Ash 3/4" - Particleboard Core	135	C	80	HPVA T-9344 (1995)
Birch 1/4" – MDF Core	120	C	200	HPVA T-14750 (2015)
Birch 1/4" - Douglas Fir Veneer Core	115	C	40	HPVA T-14911 (2015)
Birch 1/4" - Fuma Veneer Core	125	C	15	HPVA T-9665 (1996)
Birch 1/4" - High Density Veneer Core	165	C	65	HPVA T-9234 (1995)
Birch 1/4" – Poplar Veneer Core	110	C	15	HPVA T-14697 (2015)
Birch 3/4" – Combination Core	90	C	120	HPVA T-14691 (2015)
Birch 3/4" - High Density Veneer Core	115	C	50	HPVA T-9317 (1995)
Birch 3/4" - Particleboard Core	125	C	100	HPVA T-9431 (1995)
Birch 3/4" - MDF Core	120	C	110	HPVA T-14917 (2015)
Birch 3/4" – Aspen Veneer Core	135	C	70	HPVA T-14700 (2015)
Birch 3/4" – Baltic Birch Veneer Core	120	C	70	HPVA T-14694 (2015)
Birch 3/4" – Douglas Fir Veneer Core	70	B	55	HPVA T-14704 (2015)
Birch 3/4" – Poplar Veneer Core	95	C	140	HPVA T-14689 (2015)
Birch 3/4" – Russian Birch Veneer Core	110	C	70	HPVA T-14764 (2015)
Mahogany 3/4" - High Density Veneer Core	105	C	90	HPVA T-9354 (1995)
Maple 1/4" – Douglas Fir Veneer Core	130	C	45	HPVA T-14910 (2015)
Maple 1/4" – Poplar Veneer Core	170	C	55	HPVA T-14695 (2015)
Maple 3/4" – Combination Core	100	C	85	HPVA T-14706 (2015)
Maple 3/4" – MDF Core	130	C	70	HPVA T-14763 (2015)
Maple 3/4" – Particleboard Core	85	C	75	HPVA T-14912 (2015)
Maple 3/4" – Aspen Veneer Core	180	C	75	HPVA T-14699 (2015)
Maple 3/4" – Baltic Birch Veneer Core	125	C	70	HPVA T-14693 (2015)

Table A2 Reported Flame Spread Indices of Wood Panels (continued)

Material	ASTM E84 Flame Spread Index	Flame Spread Class	ASTM E84 Smoke Developed Index	Source ¹
Maple 3/4" – Douglas Fir Veneer Core	95	C	50	HPVA T-14703 (2015)
Maple 3/4" – Poplar Veneer Core	150	C	60	HPVA T-14702 (2015)
Maple 3/4" – Russian Birch Veneer Core	120	C	50	HPVA T-14752 (2015)
Oak 1/4" - High Density Veneer Core	155	C	65	HPVA T-9237 (1995)
Oak 1/4" – Fuma Veneer Core	60	B	50	HPVA T-14698 (2015)
Oak 1/4" – Poplar Veneer Core	140	C	60	HPVA T-14696 (2015)
Oak 3/4" – Medium Density Fiberboard Core	100	C	85	HPVA T-14916 (2015)
Oak 3/4" – Combination Core	90	C	155	HPVA T-14690 (2015)
Oak 3/4" – Particleboard Core	80	C	80	HPVA T-14914 (2015)
Oak 3/4" – Aspen Veneer Core	160	C	75	HPVA T-14701 (2015)
Oak 3/4" – Baltic Birch Veneer Core	105	C	80	HPVA T-14692 (2015)
Oak 3/4" – Douglas Fir Veneer Core	60	B	65	HPVA T-14762 (2015)
Oak 3/4" – Russian Birch Veneer Core	95	C	110	HPVA T-14751 (2015)
Walnut 3/4"	NA ⁵	C ⁵	NA	HUD (1973)
PARTICLEBOARD				
1/3" (No Added Formaldehyde)	130	C	135	HPVA T-14387 (2014)
3/8"	150	C	65	HPVA T-14350 (2014)
1/2"	125	C	125	HPVA T-14376 (2014)
3/4"	95	C	130	HPVA T-14296 (2014)
3/4"	135	C	80	HPVA T-14351 (2014)
3/4" Birch Particle Board	80	C	95	HPVA T-14913 (2016)
3/4" (Floor Underlayment)	110	C	80	HPVA T-14315 (2013)
1" (No Added Formaldehyde)	105	C	145	HPVA T-14386 (2014)
MEDIUM DENSITY FIBERBOARD (MDF)				
7/32"	125	C	200	HPVA T-14370 (2014)
5/8"	120	C	250	HPVA T-9567 (1996)
3/4"	120	C	170	HPVA T-14372 (2014)
6mm (No Added Formaldehyde)	135	C	200	HPVA T-14369 (2014)
1/4"	135	C	300	HPVA T-14371 (2014)
HARDBOARD				
0.118" Tempered Hardboard	155	C	150	HPVA T-14313 (2013)
0.386" Engineered Wood Siding	95	C	50	HPVA T-14297 (2013)

Table A2 Footnotes

¹ Sources: APA – American Plywood Association; DOC – US Department of Commerce; HPVA – Hardwood Plywood Veneer Association; HUD – US Department of Housing and Urban Development Manual of Acceptable Practices to the HUD Minimum Property Standards; UL – Underwriters' Laboratories. Test report numbers and year of test are indicated.

² Values reported for oriented strand board (OSB) are derived from multiple tests performed on panels comprised of a variety of strand species, including aspen, Douglas-fir southern pine, and mixed softwood species.

³ Flame spread classes and Smoke-Developed Indices reported for softwood plywood are derived from multiple tests performed on panels comprised of a variety of veneer species, including Douglas-fir, hemlock, southern pine and cedar.

- ⁴ Flame spread classes and Smoke-Developed Indices reported for hardwood plywood are derived from multiple tests performed on panels comprised of a variety of face veneer species, core species and adhesive systems.
- ⁵ Flame spread index cannot be directly determined from the referenced source; however, the reported Flame Spread Class is deemed to be a reasonable estimate based on changes to the analysis method of test results as reported within the referenced source.

Supplement B: Fire-Resistance-Rated Wood-Frame Wall and Floor-Ceiling Assemblies

S

SUPPLEMENT

Table B1 One-Hour Fire-Resistance-Rated Loadbearing Wood-Frame Wall Assemblies

Assemblies Rated from Both Sides						
Studs	Insulation	Sheathing on Both Sides		Fasteners	Details	IBC Assembly ^a
2x4 @ 16" o.c.	3½" mineral wool batts	5/8" Type X Gypsum Wallboard (H)		2¼" #6 Type S drywall screws @ 12" o.c.	WS4-1.1	15-1.15
2x6 @ 16" o.c.	(none)	5/8" Type X Gypsum Wallboard (H)		2¼" #6 Type S drywall screws @ 7" o.c.	WS6-1.1	15-1.14
2x6 @ 16" o.c.	5½" mineral wool batts	5/8" Type X Gypsum Wallboard (H)		2¼" #6 Type S drywall screws @ 12" o.c.	WS6-1.2	15-1.12
2x6 @ 16" o.c.	R-19 fiberglass insulation	5/8" Type X Gypsum Wallboard (V)		2¼" #6 Type S drywall screws @ 12" o.c.	WS6-1.4	15-1.13
Assemblies Rated from One Side (Fire on Interior Only)						
Studs	Insulation	Sheathing		Fasteners	Details	IBC Assembly ^a
2x4 @ 16" o.c.	3½" mineral wool batts	I	5/8" Type X Gypsum Wallboard (H)	2¼" #6 Type S drywall screws @ 12" o.c.	WS4-1.2	16-1.1
		E	3/8" wood structural panels (V)	6d common nails @ 6" edges/12" field		
2x4 @ 16" o.c.	4 mil polyethylene 3½" mineral wool batts	I	5/8" Type X Gypsum Wallboard (V)	6d cement coated box nails @ 7" o.c.	WS4-1.3	
		E	1/2" fiberboard (V)	1½" roofing nails @ 3" edges/6" field		
			3/8" hardboard shiplapped panel siding	8d galv. nails @ 4" edges/8" field		
2x6 @ 16" o.c.	5½" mineral wool batts	I	5/8" Type X Gypsum Wallboard (H)	2¼" #6 Type S drywall screws @ 12" o.c.	WS6-1.3	16-1.2
		E	7/16" wood structural panels (V)	6d common nails @ 6" edges/12" field		
2x6 @ 16" o.c.	R-19 fiberglass insulation	I	5/8" Type X Gypsum Wallboard (V)	2¼" #6 Type S drywall screws @ 7" o.c.	WS6-1.5	16-1.3
		E	3/8" wood structural panels (V)	6d common nails @ 6" edges/12" field		
2x6 @ 24" o.c.	R-19 fiberglass insulation	I	5/8" Type X Gypsum Wallboard (V)	2¼" #6 Type S drywall screws @ 7" o.c.	WS6-1.6	
		E	15/32" wood structural panels (V)	6d common nails @ 6" edges/12" field		
H - applied horizontally with vertical joints over studs I - Interior sheathing V - applied vertically with vertical joints over studs E - Exterior sheathing						

^a Item number of comparable assembly from IBC Table 721.1(2).

Table B2 Two-Hour Fire-Resistance-Rated Loadbearing Wood-Frame Wall Assemblies

Assemblies Rated from Both Sides						
Studs	Insulation	Sheathing on Both Sides		Fasteners	Details	IBC Assembly ^a
2x6 @ 24" o.c.	5½" mineral wool batts	B	5/8" Type X Gypsum Wallboard (H)	2¼" #6 Type S drywall screws @ 24" o.c.	WS6-2.1	15-1.16
		F	5/8" Type X Gypsum Wallboard (H)	2¼" #6 Type S drywall screws @ 8" o.c.		
<div>H - applied horizontally with vertical joints over studs; B - Base layer sheathing; F - Face layer sheathing</div>						

^a Item number of comparable assembly from IBC Table 721.1(2).

Table B3 One-Hour Fire-Resistance-Rated Wood Floor-Ceiling Assemblies

Wood I-Joist Assemblies						
Joists	Insulation	Furring	Ceiling Sheathing	Fasteners	Details	IBC Assembly ^a
I-joists @ 24" o.c. maximum Min. flange depth: 1-1/2" Min. flange area: 5.25 sq. in. Min. web thickness: 3/8" Min. I-joist depth: 9-1/4"	1-1/2" mineral wool batts (2.5 pcf-nominal) Resting on hat-shaped channels	Hat-shaped channels or Resilient channels	F 5/8" Type C Gypsum Wall-board (GWB)	1-1/8" Type S drywall screws spaced 12" o.c. in GWB field spaced 8" o.c. at GWB end joints (see fastening details)	WIJ-1.1	24-1.1
I-joists @ 24" o.c. maximum Min. flange depth: 1-1/2" Min. flange area: 5.25 sq. in. Min. web thickness: 7/16" Min. I-joist depth: 9-1/4"	1-1/2" mineral wool batts (2.5 pcf-nominal) Resting on resilient channels	Resilient channels	F 5/8" Type C Gypsum Wall-board (GWB)	1" Type S drywall screws spaced 12" o.c. in GWB field spaced 8" o.c. at GWB end joints (see fastening details)	WIJ-1.2	25-1.1
I-joists @ 24" o.c. maximum Min. flange depth: 1-5/16" Min. flange area: 2.25 sq. in. Min. web thickness: 3/8" Min. I-joist depth: 9-1/4"	2" mineral wool batts (3.5 pcf-nominal) Resting on 1x4 setting strips	Resilient channels	F 5/8" Type C Gypsum Wall-board (GWB)	1-1/8" Type S drywall screws spaced 7" o.c. in GWB field spaced 7" o.c. at GWB end joints (see fastening details)	WIJ-1.3	23-1.1
I-joists @ 24" o.c. maximum Min. flange depth: 1-1/2" Min. flange area: 3.45 sq. in. Min. web thickness: 3/8" Min. I-joist depth: 9-1/4"	1" mineral wool batts (6 pcf-nominal) Resting on hat-shaped channels under I-joist bottom flange	Hat-shaped channels supported by CSC clips	F 1/2" Type C Gypsum Wall-board (GWB)	1" Type S drywall screws spaced 12" o.c. in GWB field spaced 6" o.c. at GWB end joints (see fastening details)	WIJ-1.4	
I-joists @ 24" o.c. maximum Min. flange depth: 1-1/2" Min. flange area: 2.25 sq. in. Min. web thickness: 3/8" Min. I-joist depth: 9-1/4"	(none)	(none)	B 1/2" Type C Gypsum Wall-board (GWB)	1" Type S drywall screws spaced 12" o.c. in GWB field spaced 12" o.c. at GWB end joints	WIJ-1.5	
			F 1/2" Type C Gypsum Wall-board (GWB)	1-5/8" Type S drywall screws spaced 12" o.c. in GWB field spaced 8" o.c. at GWB end joints 1-1/2" Type G drywall screws spaced 8" o.c. at GWB end joints (see fastening details)		
I-joists @ 24" o.c. maximum Min. flange depth: 1-5/16" Min. flange area: 1.95 sq. in. Min. web thickness: 3/8" Min. I-joist depth: 9-1/2"	(none)	Resilient channels	B 1/2" Type X Gypsum Wall-board (GWB)	1-1/4" Type S drywall screws spaced 12" o.c. in GWB field spaced 12" o.c. at GWB end joints	WIJ-1.6	27-1.1
			F 1/2" Type X Gypsum Wall-board (GWB)	1-5/8" Type S drywall screws spaced 12" o.c. in GWB field spaced 12" o.c. at GWB end joints 1-1/2" Type G drywall screws spaced 8" o.c. at GWB end joints (see fastening details)		
I-joists @ 24" o.c. maximum Min. flange depth: 1-1/2" Min. flange area: 2.25 sq. in. Min. web thickness: 3/8" Min. I-joist depth: 9-1/2"	Fiberglass batts Resting on resilient channels	Resilient channels	B 1/2" Type X Gypsum Wall-board (GWB)	1-1/4" Type S drywall screws spaced 12" o.c. in GWB field spaced 12" o.c. at GWB end joints	WIJ-1.7	30-1.1
			F 1/2" Type X Gypsum Wall-board (GWB)	1-5/8" Type S drywall screws spaced 12" o.c. in GWB field spaced 12" o.c. at GWB end joints 1-1/2" Type G drywall screws spaced 8" o.c. at GWB end joints (see fastening details)		

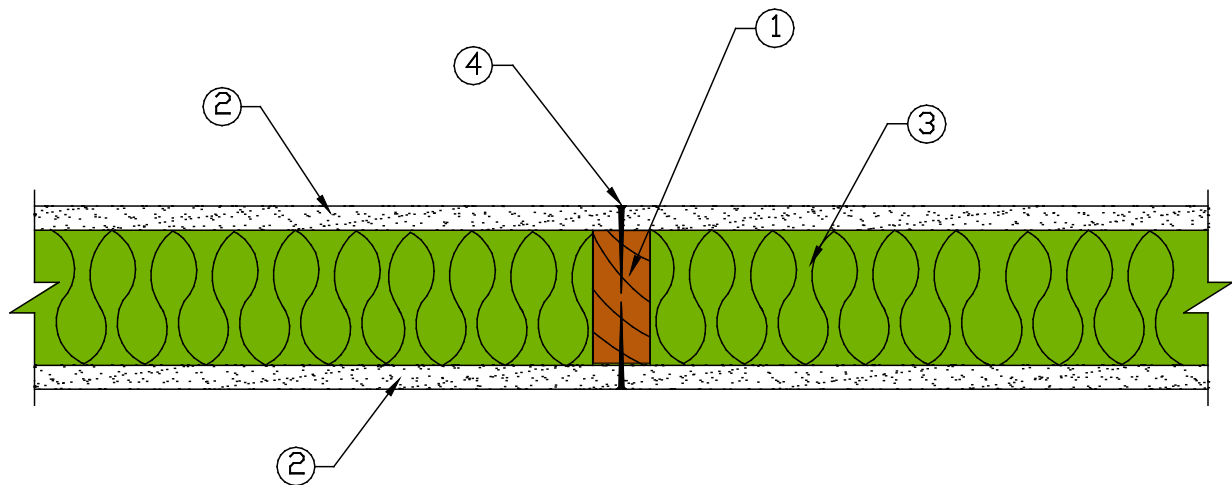
B - Base layer sheathing; F - Face layer sheathing

^a Item number of comparable assembly from IBC Table 721.1(3).

Table B4 Two-Hour Fire-Resistance-Rated Wood Floor/Ceiling Assemblies

Wood I-Joist Assemblies							
Joists	Insulation	Furring	Ceiling Sheathing		Fasteners	Details	IBC Assembly ^a
I-joists @ 24" o.c. maximum Min. flange depth: 1-1/2" Min. flange area: 2.25 sq. in. Min. web thickness: 3/8" Min. I-joist depth: 9-1/4"	3-1/2" fiberglass insulation Supported by stay wires spaced 12" o.c.	(none)	B	5/8" Type C Gypsum Wallboard (GWB)	1-5/8" Type S drywall screws spaced 12" o.c. in GWB field spaced 12" o.c. at GWB end joints	WIJ-2.1	28-1.1
		Hat-shaped channels or Resilient channels	M	5/8" Type C Gypsum Wallboard (GWB)	1" Type S drywall screws spaced 12" o.c. in GWB field spaced 12" o.c. at GWB end joints		
			F	5/8" Type C Gypsum Wallboard (GWB)	1-5/8" Type S drywall screws spaced 8" o.c. in GWB field spaced 8" o.c. at GWB end joints <i>(see fastening details)</i>		
B - Base layer sheathing (direct attached); M - Middle layer sheathing; F - Face layer sheathing							

^a Item number of comparable assembly from IBC Table 721.1(3).

WS4-1.1 One Hour Fire-Resistance-Rated Wood-Frame Wall Assembly**2x4 Wood Stud Wall – 100% Design Load – ASTM E 119/NFPA 251**

1. Framing - Nominal 2x4 wood studs, spaced 16 in. o.c., double top plates, single bottom plate
2. Sheathing - 5/8 in. Type X gypsum wallboard, 4 ft. wide, applied horizontally. Horizontal joints are unblocked. Horizontal application of wallboard represents the direction of least fire resistance as opposed to vertical application.
3. Insulation - 3-1/2-inch-thick mineral wool insulation (2.5 pcf, nominal)
4. Fasteners - 2-1/4 in. #6 Type S drywall screws, spaced 12 in. o.c.
5. Joints and Fastener Heads - Wallboard joints covered with paper tape and joint compound, fastener heads covered with joint compound

Tests conducted at the Fire Test Laboratory of National Gypsum Research Center

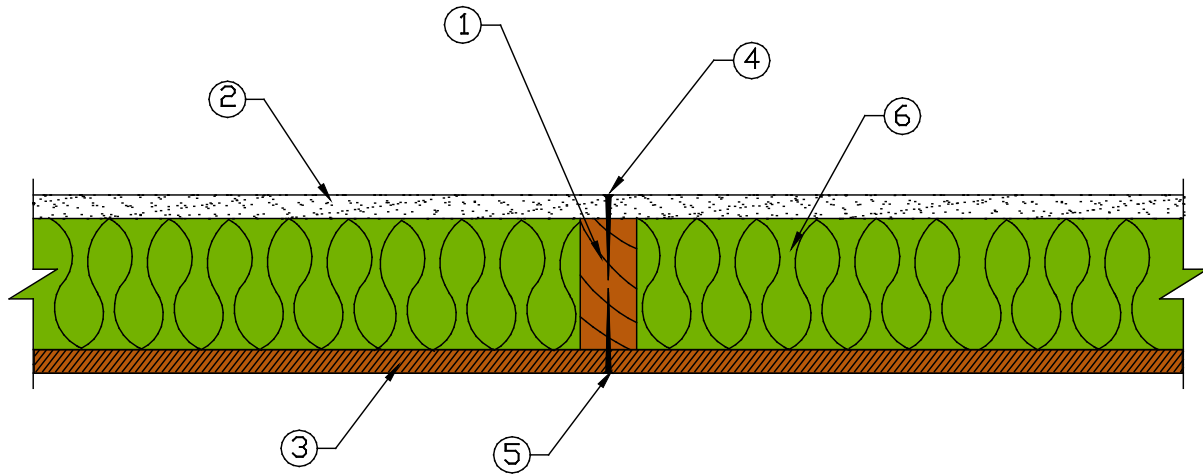
Test No:	WP-1248 (Fire Endurance)	March 29, 2000
	WP-1246 (Hose Stream)	March 09, 2000

Third Party Witness: Intertek Testing Services
Report J20-06170.1

This assembly was tested at 100% design load, calculated in accordance with the 2018 *National Design Specification® for Wood Construction*. The authority having jurisdiction should be consulted to assure acceptance of this report.

WS4-1.2 One-Hour Fire-Resistance-Rated Wood-Frame Wall Assembly (Rated from gypsum wallboard side)

2x4 Wood Stud Wall – 100% Design Load – ASTM E 119/NFPA 251



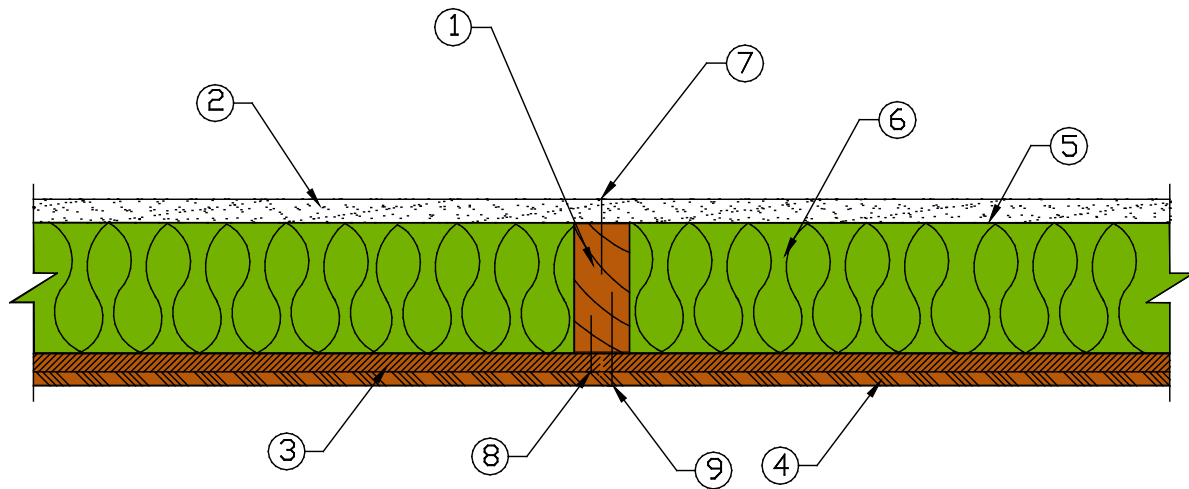
- 1 Framing - Nominal 2x4 wood studs, spaced 16 in. o.c., double top plates, single bottom plate
2. Interior Sheathing - 5/8 in. Type X gypsum wallboard, 4 ft. wide, applied horizontally. Horizontal joints are unblocked. Horizontal application of wallboard represents the direction of least fire resistance as opposed to vertical application.
3. Exterior Sheathing - Minimum 3/8 in. wood structural panels (oriented strand board), applied vertically, horizontal joints blocked
4. Gypsum Fasteners - 2-1/4 in. #6 Type S drywall screws, spaced 12 in. o.c.
5. Panel Fasteners - 6d common nails (bright) - 12 in. o.c. in the field, 6 in. o.c. panel edges
6. Insulation - 3-1/2-inch-thick mineral wool insulation (2.5 pcf, nominal)
7. Joints and Fastener Heads - Wallboard joints covered with paper tape and joint compound, fastener heads covered with joint compound

Tests conducted at the Fire Test Laboratory of National Gypsum Research Center

Test No: WP-1261 (Fire Endurance & Hose Stream) November 1, 2000

Third Party Witness: Intertek Testing Services
Report J20-006170.2

This assembly was tested at 100% design load, calculated in accordance with the 2018 *National Design Specification® for Wood Construction*. The authority having jurisdiction should be consulted to assure acceptance of this report.

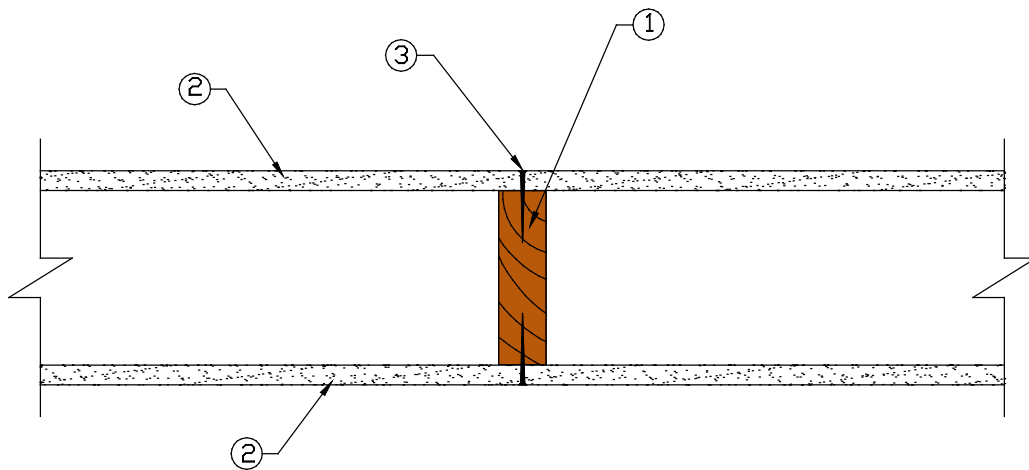
**WS4-1.3 One-Hour Fire-Resistance-Rated Wood-Frame Wall Assembly
(Rated from gypsum wallboard side)**
2x4 Wood Stud Wall – 78% Design Load – ASTM E 119/NFPA 251


1. Framing - Nominal 2x4 wood studs, spaced 16 in. o.c., double top plates, single bottom plate
2. Interior Sheathing - 5/8 in. Type X gypsum wallboard, 4 ft. wide, applied vertically, unblocked
3. Exterior Sheathing - Minimum 1/2 in. fiberboard sheathing. *Alternate construction - minimum 1/2 in. lumber siding or 1/2 in. wood based sheathing.*
4. Exterior Siding - 3/8 in. hardboard shiplap edge panel siding. *Alternate construction - lumber, wood based, vinyl, or aluminum siding.*
5. Vapor Barrier - 4-mil polyethylene sheeting
6. Insulation - 3-1/2-inch-thick mineral wool insulation (2.5 pcf, nominal)
7. Gypsum Fasteners - 6d cement coated box nails spaced 7 in. o.c.
8. Fiberboard Fasteners - 1-1/2 in. galvanized roofing nails - 6 in. o.c. in the field, 3 in. o.c. panel edges
9. Hardboard Fasteners - 8d galvanized nails - 8 in. o.c. in the field, 4 in. o.c. panel edges
10. Joints and Fastener Heads - Wallboard joints covered with paper tape and joint compound, fastener heads covered with joint compound

Tests conducted at the Gold Bond Building Products Fire Testing Laboratory
Test No: WP-584 (Fire Endurance & Hose Stream) March 19, 1981

Third Party Witness: Warnock Hersey International, Inc.
Report WHI-690-003

This assembly was tested at 78% design load using an l_e/d of 33, calculated in accordance with the 2018 *National Design Specification® for Wood Construction*. The authority having jurisdiction should be consulted to assure acceptance of this report.

WS6-1.1 One-Hour Fire-Resistance-Rated Wood-Frame Wall Assembly**2x6 Wood Stud Wall – 100% Design Load – ASTM E 119/NFPA 251**

1. Framing - Nominal 2x6 wood studs, spaced 16 in. o.c., double top plates, single bottom plate
2. Sheathing - 5/8 in. Type X gypsum wallboard, 4 ft. wide, applied horizontally. Horizontal joints are unblocked. Horizontal application of wallboard represents the direction of least fire resistance as opposed to vertical application.
3. Fasteners - 2-1/4 in. #6 Type S drywall screws, spaced 7 in. o.c.
4. Joints and Fastener Heads - Wallboard joints covered with paper tape and joint compound, fastener heads covered with joint compound

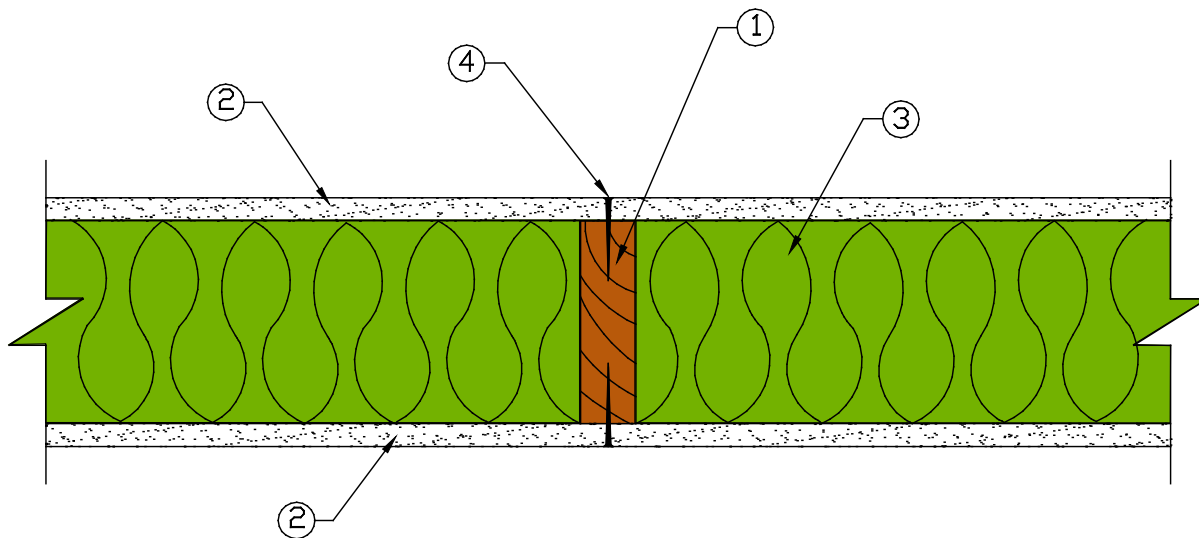
Tests conducted at the Fire Test Laboratory of National Gypsum Research Center

Test No: WP-1232 (Fire Endurance) September 16, 1999

WP-1234 (Hose Stream) September 27, 1999

Third Party Witness: Intertek Testing Services
Report J99-22441.2

This assembly was tested at 100% design load, calculated in accordance with the 2018 *National Design Specification® for Wood Construction*. The authority having jurisdiction should be consulted to assure acceptance of this report.

WS6-1.2 One-Hour Fire-Resistance-Rated Wood-Frame Wall Assembly**2x6 Wood Stud Wall – 100% Design Load – ASTM E 119/NFPA 251**

1. Framing - Nominal 2x6 wood studs, spaced 16 in. o.c., double top plates, single bottom plate
2. Sheathing - 5/8 in. Type X gypsum wallboard, 4 ft. wide, applied horizontally. Horizontal joints are unblocked. Horizontal application of wallboard represents the direction of least fire resistance as opposed to vertical application.
3. Insulation - 5-1/2-inch-thick mineral wool insulation (2.5 pcf, nominal)
4. Fasteners - 2-1/4 in. #6 Type S drywall screws, spaced 12 in. o.c.
5. Joints and Fastener Heads - Wallboard joints covered with paper tape and joint compound, fastener heads covered with joint compound

Tests conducted at the Fire Test Laboratory of National Gypsum Research Center

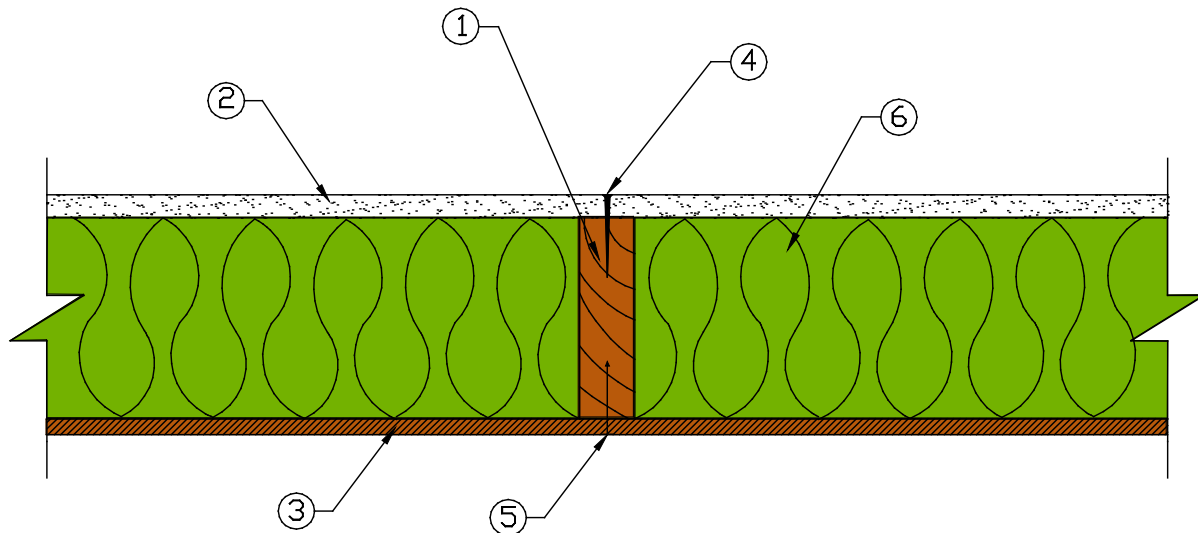
Test No: WP-1231 (Fire Endurance) September 14, 1999

WP-1230 (Hose Stream) August 30, 1999

Third Party Witness: Intertek Testing Services

Report J99-22441.1

This assembly was tested at 100% design load, calculated in accordance with the 2018 *National Design Specification® for Wood Construction*. The authority having jurisdiction should be consulted to assure acceptance of this report.

**WS6-1.3 One-Hour Fire-Resistance-Rated Wood-Frame Wall Assembly
(Rated from gypsum wallboard side)**
2x6 Wood Stud Wall – 100% Design Load – ASTM E 119/NFPA 251


1. Framing - Nominal 2x6 wood studs, spaced 16 in. o.c., double top plates, single bottom plate
2. Interior Sheathing - 5/8 in. Type X gypsum wallboard, 4 ft. wide, applied horizontally. Horizontal joints are unblocked. Horizontal application of wallboard represents the direction of least fire resistance as opposed to vertical application.
3. Exterior Sheathing - Minimum 7/16 in. wood structural panels (oriented strand board), applied vertically, horizontal joints blocked
4. Gypsum Fasteners - 2-1/4 in. #6 Type S drywall screws, spaced 12 in. o.c.
5. Panel Fasteners - 6d common nails (bright) - 12 in. o.c. in the field, 6 in. o.c. panel edges
6. Insulation - 5-1/2-inch-thick mineral wool insulation (2.5 pcf, nominal)
7. Joints and Fastener Heads - Wallboard joints covered with paper tape and joint compound, fastener heads covered with joint compound

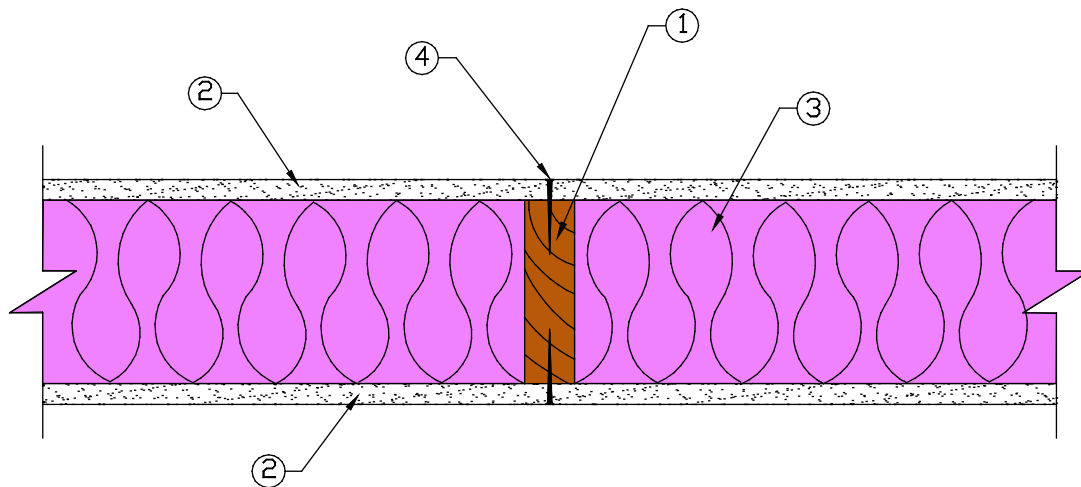
Tests conducted at the Fire Test Laboratory of National Gypsum Research Center

Test No: WP-1244 (Fire Endurance & Hose Stream) February 25, 2000

Third Party Witness: Intertek Testing Services

Report J99-27259.2

This assembly was tested at 100% design load, calculated in accordance with the 2018 *National Design Specification® for Wood Construction*. The authority having jurisdiction should be consulted to assure acceptance of this report.

WS6-1.4 One-Hour Fire-Resistance-Rated Wood-Frame Wall Assembly**2x6 Wood Stud Wall – 100% Design Load – ASTM E 119/NFPA 251**

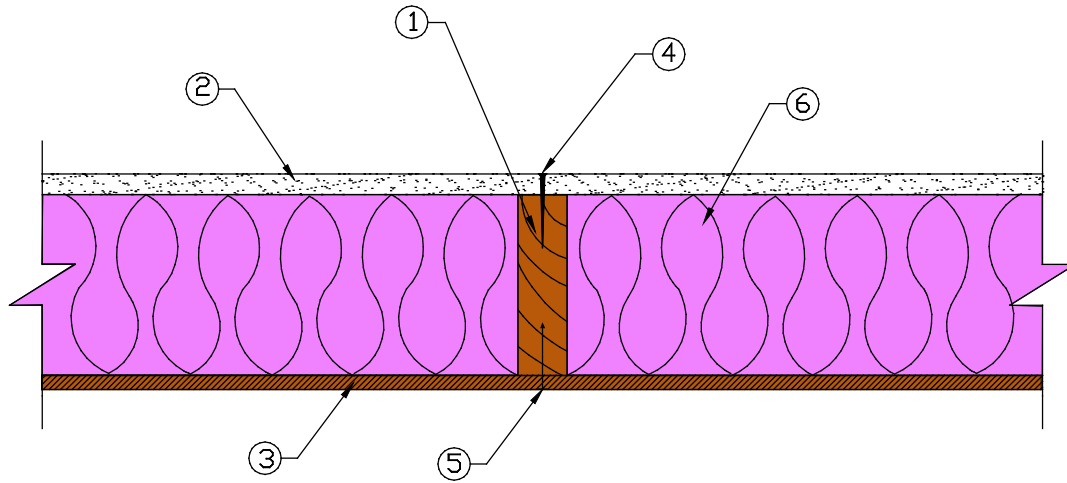
1. Framing - Nominal 2x6 wood studs, spaced 16 in. o.c., double top plates, single bottom plate
2. Sheathing - 5/8 in. Type X gypsum wallboard, 4 ft. wide, applied vertically. All panel edges backed by framing or blocking.
3. Insulation - R-19 fiberglass insulation
4. Fasteners - 2-1/4 in. #6 Type S drywall screws, spaced 12 in. o.c.
5. Joints and Fastener Heads - Wallboard joints covered with paper tape and joint compound, fastener heads covered with joint compound

Tests conducted at NGC Testing Services

Test No: WP-1346 (Fire Endurance) August 22, 2003
 WP-1351 (Hose Stream) September 17, 2003

Third Party Witness: NGC Testing Services

This assembly was tested at 100% design load, calculated in accordance with the 2018 *National Design Specification® for Wood Construction*. The authority having jurisdiction should be consulted to assure acceptance of this report.

**WS6-1.5 One-Hour Fire-Resistance-Rated Wood-Frame Wall Assembly
(Rated from gypsum wallboard side)**
2x6 Wood Stud Wall – 100% Design Load – ASTM E 119/NFPA 251


1. Framing - Nominal 2x6 wood studs, spaced 16 in. o.c., double top plates, single bottom plate
2. Interior Sheathing - 5/8 in. Type X gypsum wallboard, 4 ft. wide, applied vertically. All panel edges backed by framing or blocking.
3. Exterior Sheathing - Minimum 3/8 in. wood structural panels (oriented strand board), applied vertically, horizontal joints blocked
4. Gypsum Fasteners - 2-1/4 in. #6 Type S drywall screws, spaced 7 in. o.c.
5. Panel Fasteners - 6d common nails (bright) - 12 in. o.c. in the field, 6 in. o.c. panel edges
6. Insulation - R-19 fiberglass insulation
7. Joints and Fastener Heads - Wallboard joints covered with paper tape and joint compound, fastener heads covered with joint compound

Tests conducted at the NGC Testing Services

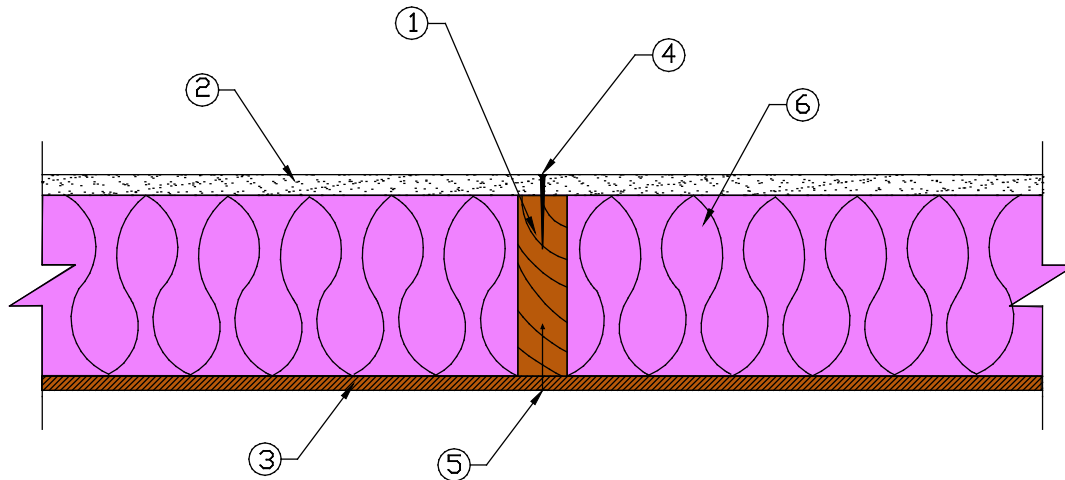
Test No: WP-1408 (Fire Endurance & Hose Stream) August 13, 2004

Third Party Witness: NGC Testing Services

This assembly was tested at 100% design load, calculated in accordance with the 2018 *National Design Specification® for Wood Construction*. The authority having jurisdiction should be consulted to assure acceptance of this report.

WS6-1.6 One-Hour Fire-Resistance-Rated Wood-Frame Wall Assembly (Rated from gypsum wallboard side)

2x6 Wood Stud Wall – 100% Design Load – ASTM E 119/NFPA 251



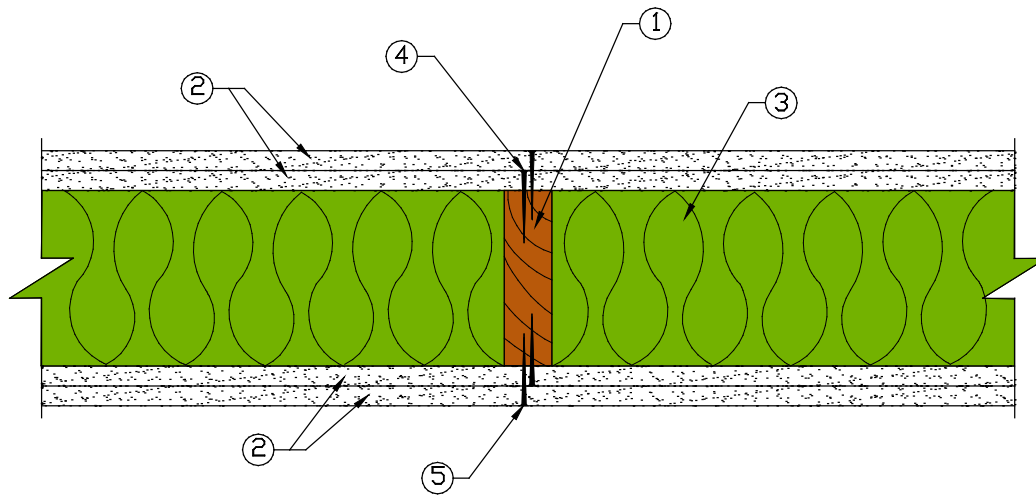
1. Framing - Nominal 2x6 wood studs, spaced 24 in. o.c., double top plates, single bottom plate
2. Interior Sheathing - 5/8 in. Type X gypsum wallboard, 4 ft. wide, applied vertically. All panel edges backed by framing or blocking.
3. Exterior Sheathing - Minimum 15/32 in. wood structural panels, applied vertically, horizontal joints blocked
4. Gypsum Fasteners - 2-1/4 in. #6 Type S drywall screws, spaced 7 in. o.c.
5. Panel Fasteners - 6d common nails (bright) - 12 in. o.c. in the field, 6 in. o.c. panel edges
6. Insulation - minimum R-19 fiberglass insulation
7. Joints and Fastener Heads - Wallboard joints covered with paper tape and joint compound, fastener heads covered with joint compound

Tests conducted at Western Fire Center

Test No: WFCi Report #18090r1 (Fire Endurance & Hose Stream) February 22, 2019

Third Party Witness: Western Fire Center, Inc.

This assembly was tested at 100% design load, calculated in accordance with the 2018 *National Design Specification® for Wood Construction*. The authority having jurisdiction should be consulted to assure acceptance of this report.

WS6-2.1 Two-Hour Fire-Resistance-Rated Wood-Frame Wall Assembly**2x6 Wood Stud Wall – 100% Design Load – ASTM E 119/NFPA 251**

1. Framing - Nominal 2x6 wood studs, spaced 24 in. o.c., double top plates, single bottom plate.
2. Sheathing:
 - Base Layer - 5/8 in. Type X gypsum wallboard, 4 ft. wide, applied horizontally, joints staggered on opposite sides of the wall.
 - Face Layer - 5/8 in. Type X gypsum wallboard, 4 ft. wide, applied horizontally, joints staggered with base layer.
 - Horizontal joints are unblocked. Horizontal application of wallboard represents the direction of least fire resistance as opposed to vertical application.
3. Insulation - 5-1/2-inch-thick mineral wool insulation (2.5 pcf, nominal)
4. Gypsum Fasteners: Base Layer - 2-1/4 in. #6 Type S drywall screws, spaced 24 in. o.c.
5. Gypsum Fasteners: Face Layer - 2-1/4 in. #6 Type S drywall screws, spaced 8 in. o.c.
6. Joints and Fastener Heads - Wallboard joints covered with paper tape and joint compound, fastener heads covered with joint compound

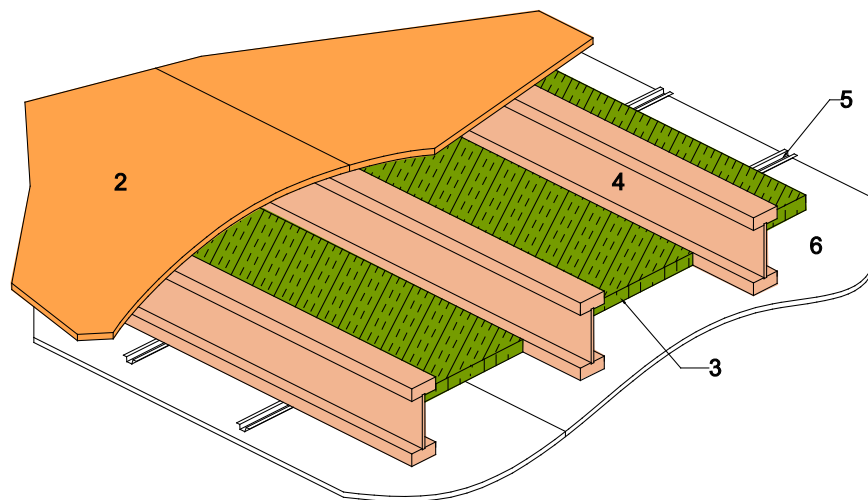
Tests conducted at the Fire Test Laboratory of National Gypsum Research Center

Test No: WP-1262 (Fire Endurance) November 3, 2000

WP-1268 (Hose Stream) December 8, 2000

Third Party Witness: Intertek Testing Services
Report J20-006170.3

This assembly was tested at 100% design load, calculated in accordance with the 2018 *National Design Specification® for Wood Construction*. The authority having jurisdiction should be consulted to assure acceptance of this report.

WIJ-1.1 One-Hour Fire-Resistance-Rated Ceiling AssemblyFloor^a/Ceiling - 100% Design Load - 1 Hour Rating - ASTM E 119 / NFPA 251

1. **Floor Topping (optional, not shown):** Gypsum concrete, lightweight or normal concrete topping.
2. **Floor Sheathing:** Minimum 23/32-inch-thick tongue-and-groove wood sheathing (Exposure 1). Installed per code requirements with minimum 8d common nails and glued to joist top flanges with AFG-01 construction adhesive.
3. **Insulation:** Minimum 1-1/2-inch-thick mineral wool batt insulation – 2.5 pcf (nominal), supported by furring channels.
4. **Structural Members:** Wood I-joists spaced a maximum of 24 inches on center. See ASTM D 5055 for qualification requirements. Additional requirements are as follows:

Minimum I-joist flange depth: 1-1/2 inches	Minimum I-joist flange area: 5.25 inches ²
Minimum I-joist web thickness: 3/8 inch	Minimum I-joist depth: 9-1/4 inches
5. **Furring Channels:** Minimum 0.026-inch-thick galvanized steel hat-shaped furring channels, attached perpendicular to I-joists using 1⁵/₈-inch-long drywall screws. Furring channels spaced 16 inches on center and doubled at each wallboard end joint extending to the next joist. Based on ASTM E2032, minimum 0.019-inch-thick galvanized steel resilient channels may be used in lieu of hat-shaped furring channels if installed at the same spacing and attached in the same manner. In order to achieve the sound ratings given below, resilient channels must be used in lieu of hat-shaped furring channels.
6. **Gypsum Wallboard:** Minimum 5/8-inch-thick Type C gypsum wallboard installed with long dimension perpendicular to furring channels and fastened to each channel with minimum 1-1/8-inch-long Type S drywall screws. Fasteners spaced 12 inches on center in the field of the wallboard, 8 inches on center at wallboard end joints, and 3/4 inches from panel edges and ends. End joints of wallboard staggered.
7. **Finish System (not shown):** Face layer joints covered with tape and coated with joint compound. Screw heads covered with joint compound.

Fire Test conducted at Gold Bond Building Products Research Center
 Third Party Witness: Warnock Hersey International, Inc.

February 9, 1990
 Report No: WHI-651-0311.1

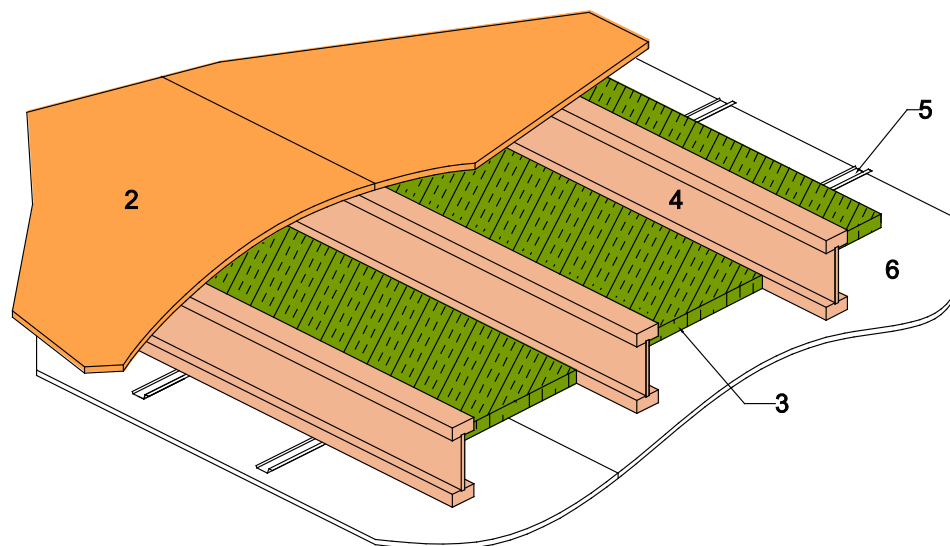
STC and IIC Sound Ratings (with Resilient Channels)

Joist/ RC Spacing ^c	Without Gypsum Concrete				With 1" Gypsum Concrete			
	Cushioned Vinyl		Carpet & Pad		Cushioned Vinyl		Carpet & Pad	
	STC	IIC	STC	IIC	STC	IIC	STC	IIC
24"o.c./16"o.c.	48 (51) ^b	42 (43) ^b	48 (51) ^b	61 (63) ^b	63 (65) ^b	50 (52) ^b	63 (65) ^b	65 (67) ^b
16"o.c./16"o.c.	44 (46) ^b	37 (39) ^b	44 (46) ^b	60 (61) ^b	56 (57) ^b	46 (47) ^b	56 (57) ^b	58 (59) ^b

^a This assembly may also be used in a fire-rated roof/ceiling application, but only when constructed exactly as described.

^b STC and IIC values established by engineering analysis using the AWC Technical Report 15 (TR15) model, assuming 1.5"-thick mineral wool batt insulation (values in parentheses assume 3.5"-thick mineral wool batt) and resilient channels at 16" o.c.

^c STC and IIC values for assemblies with a joist spacing of 16"o.c. may be used for assemblies with joist spacings between 16"o.c. and 24"o.c..

WIJ-1.2 One-Hour Fire-Resistance-Rated Ceiling AssemblyFloor^a/Ceiling - 100% Design Load - 1 Hour Rating - ASTM E 119 / NFPA 251

1. **Floor Topping (optional, not shown):** Gypsum concrete, lightweight or normal concrete topping.
2. **Floor Sheathing:** Minimum 23/32-inch-thick tongue-and-groove wood sheathing (Exposure 1). Installed per code requirements with minimum 8d common nails and glued to joist top flanges with AFG-01 construction adhesive.
3. **Insulation:** Minimum 1-1/2-inch-thick mineral wool batt insulation – 2.5 pcf (nominal), supported by resilient channels.
4. **Structural Members:** Wood I-joists spaced a maximum of 24 inches on center. See ASTM D 5055 for qualification requirements. Additional requirements are as follows:
 Minimum I-joist flange depth: 1-1/2 inches Minimum I-joist flange area: 5.25 inches²
 Minimum I-joist web thickness: 7/16 inch Minimum I-joist depth: 9-1/4 inches
5. **Resilient Channels:** Minimum 0.019-inch-thick galvanized steel resilient channels, attached perpendicular to I-joists using 1-5/8-inch-long drywall screws. Resilient channels spaced 16 inches on center and doubled at each wallboard end joint extending to the next joist.
6. **Gypsum Wallboard:** Minimum 5/8-inch-thick Type C gypsum wallboard installed with long dimension perpendicular to resilient channels and fastened to each channel with minimum 1-inch-long Type S drywall screws. Fasteners spaced 12 inches on center in the field of the wallboard, 8 inches on center at wallboard end joints, and 3/4 inches from panel edges and ends. End joints of wallboard staggered.
7. **Finish System (not shown):** Face layer joints covered with tape and coated with joint compound. Screw heads covered with joint compound.

Fire Test conducted at Gold Bond Building Products Research Center
 Third Party Witness: Warnock Hersey International, Inc.

June 19, 1984
 Report No: WHI-694-0159

STC and IIC Sound Ratings

Joist/ RC Spacing ^c	Without Gypsum Concrete				With 1" Gypsum Concrete			
	Cushioned Vinyl		Carpet & Pad		Cushioned Vinyl		Carpet & Pad	
	STC	IIC	STC	IIC	STC	IIC	STC	IIC
24"o.c./16"o.c.	48 (51) ^b	42 (43) ^b	48 (51) ^b	61 (63) ^b	63 (65) ^b	50 (52) ^b	63 (65) ^b	65 (67) ^b
16"o.c./16"o.c.	44 (46) ^b	37 (39) ^b	44 (46) ^b	60 (61) ^b	56 (57) ^b	46 (47) ^b	56 (57) ^b	58 (59) ^b

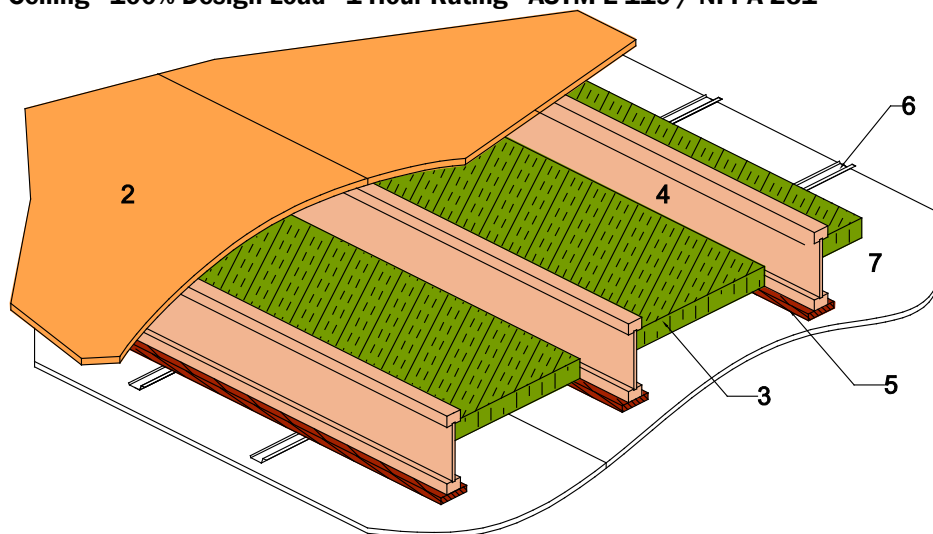
^a This assembly may also be used in a fire-rated roof/ceiling application, but only when constructed exactly as described.

^b STC and IIC values established by engineering analysis using the AWC Technical Report 15 (TR15) model, assuming 1.5"-thick mineral wool batt insulation (values in parentheses assume 3.5"-thick mineral wool batt).

^c STC and IIC values for assemblies with a joist spacing of 16"o.c. may be used for assemblies with joist spacings between 16"o.c. and 24"o.c..

WIJ-1.3 One-Hour Fire-Resistance-Rated Ceiling Assembly

Floor^a/Ceiling - 100% Design Load - 1 Hour Rating - ASTM E 119 / NFPA 251



1. **Floor Topping (optional, not shown):** Gypsum concrete, lightweight or normal concrete topping.
2. **Floor Sheathing:** Minimum 23/32-inch-thick tongue-and-groove wood sheathing (Exposure 1). Installed per code requirements.
3. **Insulation:** Minimum 2-inch-thick mineral wool batt insulation – 3.5 pcf (nominal), supported by setting strip edges, friction-fitted between the sides of the I-joist flanges.
4. **Structural Members:** Wood I-joists spaced a maximum of 24 inches on center. See ASTM D 5055 for qualification requirements. Additional requirements are as follows:

Minimum I-joist flange depth: 1-5/16 inches

Minimum I-joist web thickness: 3/8 inch

Minimum I-joist flange area: 2.25 inches²

Minimum I-joist depth: 9-1/4 inches
5. **Setting Strips:** Minimum 1x4 (nominal) wood setting strips attached with 1-1/2-inch-long drywall screws at 24 inches on center along the bottom flange of I-joist creating a ledge to support insulation.
6. **Resilient Channels:** Minimum 0.019-inch-thick galvanized steel resilient channels, attached perpendicular to I-joists using 1-7/8-inch-long drywall screws. Resilient channels spaced 16 inches on center and doubled at each wallboard end joint extending to the next joist.
7. **Gypsum Wallboard:** Minimum 5/8-inch-thick Type C gypsum wallboard installed with long dimension perpendicular to resilient channels and fastened to each channel with minimum 1-1/8-inch-long Type S drywall screws. Fasteners spaced 7 inches on center and 3/4 inches from panel edges and ends. End joints of wallboard staggered.
7. **Finish System (not shown):** Face layer joints covered with tape and coated with joint compound. Screw heads covered with joint compound.

Fire Test conducted at National Gypsum Testing Services, Inc.
Third Party Witness: Underwriter's Laboratories, Inc.

September 28, 2001
Report No: NC3369

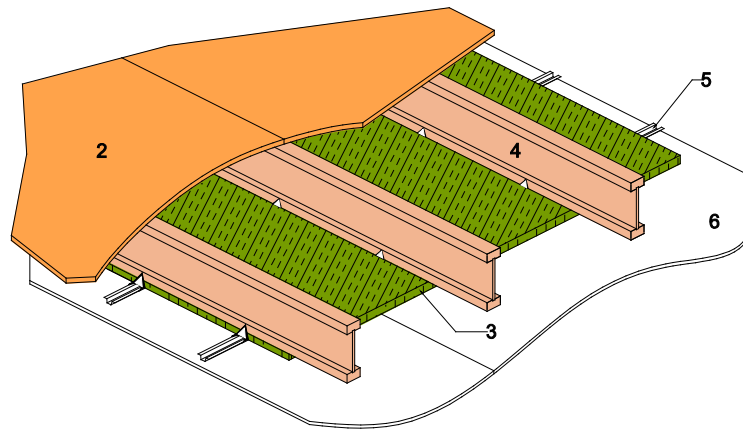
STC and IIC Sound Ratings

Joist/ RC Spacing ^c	Without Gypsum Concrete				With 1" Gypsum Concrete			
	Cushioned Vinyl		Carpet & Pad		Cushioned Vinyl		Carpet & Pad	
	STC	IIC	STC	IIC	STC	IIC	STC	IIC
24"o.c./16"o.c.	50 (51) ^b	43 (43) ^b	52	66	63 (65) ^b	51 (52) ^b	63 (65) ^b	67 (67) ^b
16"o.c./16"o.c.	45 (46) ^b	38 (39) ^b	45 (46) ^b	60 (61) ^b	57 (57) ^b	46 (47) ^b	57 (57) ^b	59 (59) ^b

^a This assembly may also be used in a fire-rated roof/ceiling application, but only when constructed exactly as described.

^b STC and IIC values established by engineering analysis using the AWC Technical Report 15 (TR15) model, assuming 2"-thick mineral wool batt insulation (values in parentheses assume 3.5"-thick mineral wool batt) and neglecting the influence (if any) of the setting strips.

^c STC and IIC values for assemblies with a joist spacing of 16"o.c. may be used for assemblies with joist spacings between 16"o.c. and 24"o.c..

WIJ-1.4 One-Hour Fire-Resistance-Rated Ceiling AssemblyFloor^a/Ceiling - 100% Design Load - 1 Hour Rating - ASTM E 119 / NFPA 251

1. **Floor Topping (optional, not shown):** Gypsum concrete, lightweight or normal concrete topping.
2. **Floor Sheathing:** Minimum 23/32-inch-thick tongue-and-groove wood sheathing (Exposure 1). Installed per code requirements with minimum 8d common nails.
3. **Insulation:** Minimum 1-inch-thick mineral wool batt insulation – 6 pcf (nominal), with width equal to the on-center spacing of the I-joists. Batts installed on top of furring channels and under bottom flange of I-joists with the sides butted against support clips. Abutted ends of batts centered over furring channels with batts tightly butted at all joints.
4. **Structural Members:** Wood I-joists spaced a maximum of 24 inches on center. See ASTM D 5055 for qualification requirements. Additional requirements are as follows:

Minimum I-joist flange depth: 1-1/2 inches	Minimum I-joist flange area: 3.45 inches ²
Minimum I-joist web thickness: 3/8 inch	Minimum I-joist depth: 9-1/4 inches
5. **Furring Channels:** Minimum 0.019-inch-thick galvanized steel hat-shaped furring channels, attached perpendicular to I-joists spaced 24 inches on center. At channel splices, adjacent pieces overlapped a minimum of 6 inches and tied with a double strand of No. 18 gage galvanized steel wire at each end of the overlap. Channels secured to I-joists with Simpson Type CSC support clips at each intersection with the I-joists. Clips nailed to the side of I-joist bottom flange with one 1-1/2-inch-long No. 11 gage nail. A row of furring channel located on each side of wallboard end joints and spaced 2.25 inches from the end joint (4.5 inches on center).
6. **Gypsum Wallboard:** Minimum 1/2-inch-thick Type C gypsum wallboard. Wallboard installed with long dimension perpendicular to furring channels and fastened to each channel with minimum 1-inch-long Type S drywall screws. Fasteners spaced 12 inches on center in the field of the wallboard, 6 inches on center at wallboard end joints, and 3/4 inches from panel edges and ends. End joints of wallboard staggered. For staggered wallboard end joints, furring channels extend a minimum of 6 inches beyond each end of the joint.
7. **Finish System (not shown):** Face layer joints covered with tape and coated with joint compound. Screw heads covered with joint compound.

Fire Test conducted at Underwriter's Laboratories, Inc.
Third Party Witness: Underwriter's Laboratories, Inc.

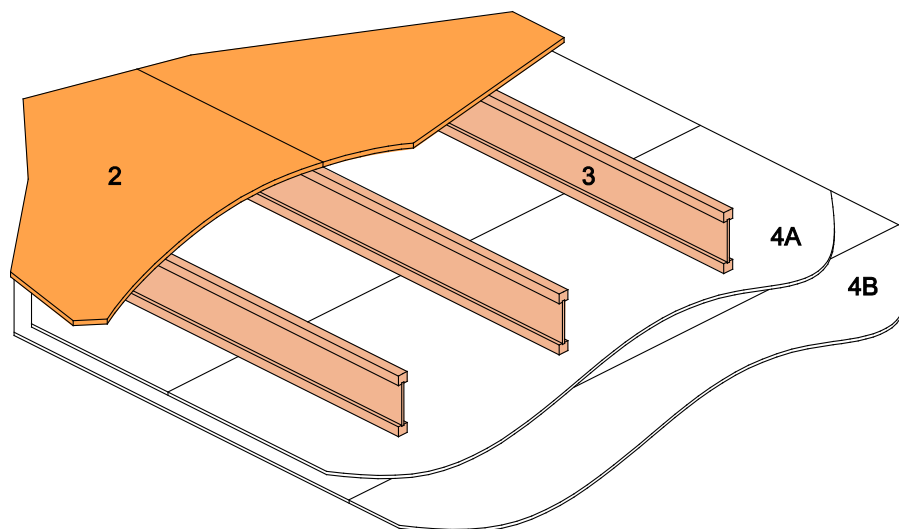
May 11, 1983
Report No: UL R10371-1

STC and IIC Sound Ratings^b

Joist /RC Spacing	Without Gypsum Concrete				With 3/4" Gypsum Concrete			
	Cushioned Vinyl		Carpet & Pad		Cushioned Vinyl		Carpet & Pad	
	STC	IIC	STC	IIC	STC	IIC	STC	IIC
24"o.c./24"o.c.	-	-	46	68	51	47	50	73

^a This assembly may also be used in a fire-rated roof/ceiling application, but only when constructed exactly as described.

^b Tabulated STC and IIC sound ratings are based tests of assemblies having 5/8-inch-thick gypsum wallboard.

WIJ-1.5 One-Hour Fire-Resistance-Rated Ceiling AssemblyFloor^a/Ceiling - 100% Design Load - 1 Hour Rating - ASTM E 119 / NFPA 251

1. **Floor Topping (optional, not shown):** Gypsum concrete, lightweight or normal concrete topping.
2. **Floor Sheathing:** Minimum 23/32-inch-thick tongue-and-groove wood sheathing (Exposure 1). Installed per code requirements with minimum 8d common nails.
3. **Structural Members:** Wood I-joists spaced a maximum of 24 inches on center. See ASTM D 5055 for qualification requirements. Additional requirements are as follows:

Minimum I-joist flange depth: 1-1/2 inches	Minimum I-joist flange area: 2.25 inches ²
Minimum I-joist web thickness: 3/8 inch	Minimum I-joist depth: 9-1/4 inches
4. **Gypsum Wallboard:** Two layers of minimum 1/2 inch Type C gypsum wallboard attached with the long dimension perpendicular to the I-joists as follows:
 - 4a. **Wallboard Base Layer:** Base layer of wallboard attached to bottom flange of I-joists using 1 inch Type S drywall screws at 12 inches on center. End joints of wallboard centered on bottom flange of the I-joist and staggered.
 - 4b. **Wallboard Face Layer:** Face layer of wallboard attached to bottom flange of I-joists through base layer using 1-5/8 inch Type S drywall screws spaced 12 inches on center on intermediate joists and 8 inches on center at end joints. Edge joints of wallboard face layer offset 24 inches from those of base layer. End joints centered on bottom flange of I-joists and offset a minimum of 48 inches from those of base layer. Additionally, wallboard face layer attached to base layer with 1-1/2 inch Type G drywall screws spaced 8 inches on center with a 4" stagger, placed 6 inches from face layer end joints.
5. **Finish System (not shown):** Face layer joints covered with tape and coated with joint compound. Screw heads covered with joint compound.

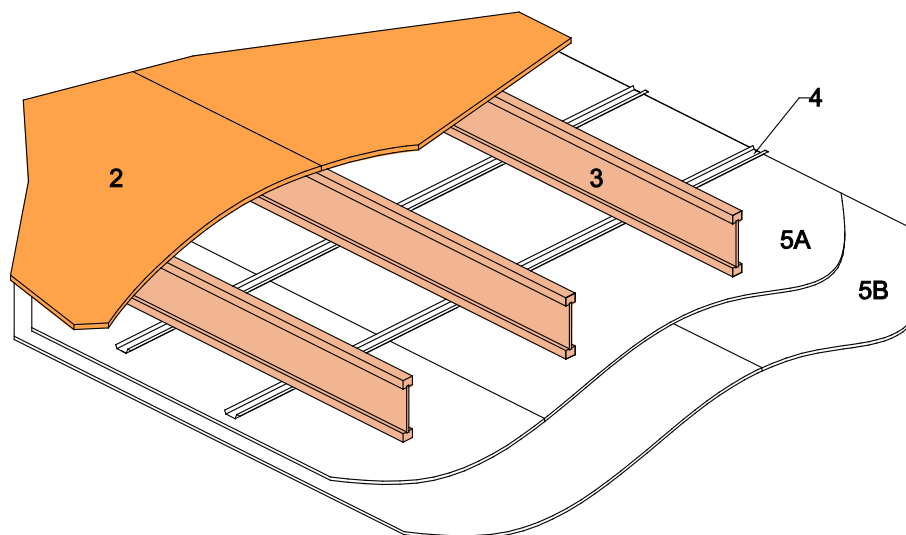
Fire Test conducted at NGC Testing Services, Inc

Report No. FC-687 January 25, 2007

STC and IIC Sound Ratings

Joist Spacing	Without Gypsum Concrete				With 3/4" Gypsum Concrete			
	Cushioned Vinyl		Carpet & Pad		Cushioned Vinyl		Carpet & Pad	
	STC	IIC	STC	IIC	STC	IIC	STC	IIC
24"o.c.	-	-	-	-	-	-	49 ^b	55 ^b

^a This assembly may also be used in a fire-rated roof/ceiling application, but only when constructed exactly as described.^b STC and IIC values established by engineering analysis performed by David L. Adams Associates, Inc.

WIJ-1.6 One-Hour Fire-Resistance-Rated Ceiling AssemblyFloor^a/Ceiling - 100% Design Load - 1 Hour Rating - ASTM E 119 / NFPA 251

1. **Floor Topping (optional, not shown):** Gypsum concrete, lightweight or normal concrete topping.
2. **Floor Sheathing:** Minimum 23/32-inch-thick tongue-and-groove wood sheathing (Exposure 1). Installed per code requirements with minimum 8d common nails.
3. **Structural Members:** Wood I-joists spaced a maximum of 24 inches on center. See ASTM D 5055 for qualification requirements. Additional requirements are as follows:

Minimum I-joist flange depth: 1-5/16 inches	Minimum I-joist flange area: 1.95 inches ²
Minimum I-joist web thickness: 3/8 inch	Minimum I-joist depth: 9-1/2 inches
4. **Resilient Channels^b:** Minimum 0.019-inch-thick galvanized steel resilient channel attached perpendicular to the bottom flange of the I-joists with one 1-1/4 inch drywall screw. Channels spaced a maximum of 16 inches on center [24 inches on center when I-joists are spaced a maximum of 16 inches on center].
5. **Gypsum Wallboard:** Two layers of minimum 1/2 inch Type X gypsum wallboard attached with the long dimension perpendicular to the resilient channels as follows:
 - 5a. **Wallboard Base Layer:** Base layer of wallboard attached to resilient channels using 1-1/4 inch Type S drywall screws at 12 inches on center.
 - 5b. **Wallboard Face Layer:** Face layer of wallboard attached to resilient channels through base layer using 1-5/8 inch Type S drywall screws spaced 12 inches on center. Edge joints of wallboard face layer offset 24 inches from those of base layer. Additionally, wallboard face layer attached to base layer with 1-1/2 inch Type G drywall screws spaced 8 inches on center, placed 1-1/2 inches from face layer end joints.
6. **Finish System (not shown):** Face layer joints covered with tape and coated with joint compound. Screw heads covered with joint compound.

Fire Test conducted at National Research Council of Canada Report No. A-4440.1 June 24, 1997

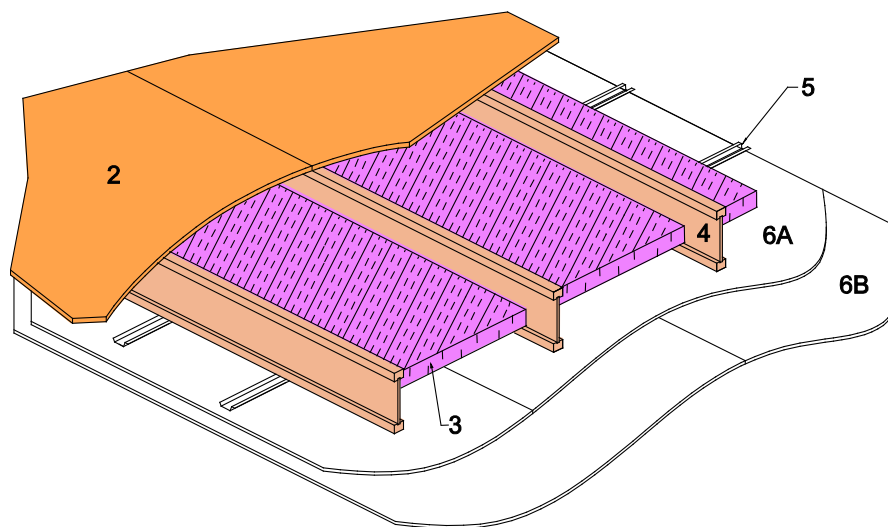
STC and IIC Sound Ratings^b

Joist/ RC Spacing ^c	Without Gypsum Concrete				With 1" Gypsum Concrete			
	Cushioned Vinyl		Carpet & Pad		Cushioned Vinyl		Carpet & Pad	
	STC	IIC	STC	IIC	STC	IIC	STC	IIC
24"o.c./16"o.c.	46 ^c	44 ^c	46 ^c	61 ^c	58 ^c	47 ^c	58 ^c	67 ^c
16"o.c./24"o.c.	47 ^c	43 ^c	47 ^c	64 ^c	60 ^c	49 ^c	60 ^c	67 ^c

^a This assembly may also be used in a fire-rated roof/ceiling application, but only when constructed exactly as described.^b Direct attachment of gypsum wallboard in lieu of attachment to resilient channels is typically deemed acceptable. When gypsum wallboard is directly attached to the I-joists, the wallboard should be installed with long dimension perpendicular to the I-joists and sound ratings for WIJ-1.5 should be used.^c STC and IIC values established by engineering analysis using the AWC Technical Report 15 (TR15) model.^c STC and IIC values for assemblies with a joist spacing of 16"o.c. may be used for assemblies with joist spacings between 16"o.c. and 24"o.c..

WIJ-1.7 One-Hour Fire-Resistance-Rated Ceiling Assembly

Floor^a/Ceiling - 100% Design Load - 1 Hour Rating - ASTM E 119 / NFPA 251



1. **Floor Topping (optional, not shown):** Gypsum concrete, lightweight or normal concrete topping.
2. **Floor Sheathing:** Minimum 23/32-inch-thick tongue-and-groove wood sheathing (Exposure 1). Installed per code requirements with minimum 8d common nails.
3. **Insulation:** Fiberglass insulation placed between I-joists supported by the resilient channels.
4. **Structural Members:** Wood I-joists spaced a maximum of 24 inches on center. See ASTM D 5055 for qualification requirements. Additional requirements are as follows:
 - Minimum I-joist flange depth: 1-1/2 inches
 - Minimum I-joist web thickness: 3/8 inch
 - Minimum I-joist flange area: 2.25 inches²
 - Minimum I-joist depth: 9-1/2 inches
5. **Resilient Channels:** Minimum 0.019-inch-thick galvanized steel resilient channel attached perpendicular to the bottom flange of the I-joists with one 1-1/4 inch drywall screw. Channels spaced a maximum of 16 inches on center [24 inches on center when I-joists are spaced a maximum of 16 inches on center].
6. **Gypsum Wallboard:** Two layers of minimum 1/2 inch Type X gypsum wallboard attached with the long dimension perpendicular to the resilient channels as follows:
 - 6a. **Wallboard Base Layer:** Base layer of wallboard attached to resilient channels using 1-1/4 inch Type S drywall screws at 12 inches on center.
 - 6b. **Wallboard Face Layer:** Face layer of wallboard attached to resilient channels through base layer using 1-5/8 inch Type S drywall screws spaced 12 inches on center. Edge joints of wallboard face layer offset 24 inches from those of base layer. Additionally, wallboard face layer attached to base layer with 1-1/2 inch Type G drywall screws spaced 8 inches on center, placed 1-1/2 inches from face layer end joints.
7. **Finish System (not shown):** Face layer joints covered with tape and coated with joint compound. Screw heads covered with joint compound.

Fire Test conducted at National Research Council of Canada Report No. A-4219.13.2 March 23, 1998

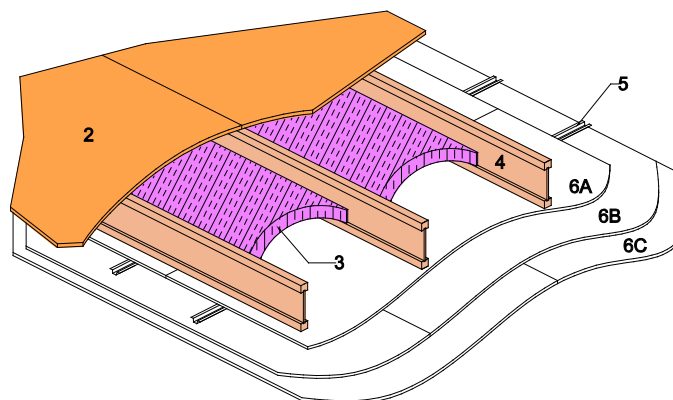
STC and IIC Sound Ratings

Joist/ RC Spacing	Without Gypsum Concrete				With 1" Gypsum Concrete			
	Cushioned Vinyl		Carpet & Pad		Cushioned Vinyl		Carpet & Pad	
	STC	IIC	STC	IIC	STC	IIC	STC	IIC
24"o.c./16"o.c.	56 ^b	51 ^b	56 ^b	69 ^b	64 ^b	53 ^b	64 ^b	71 ^b
16"o.c./24"o.c.	55 ^b	48 ^b	55 ^b	67 ^b	64 ^b	54 ^b	64 ^b	67 ^b

^a This assembly may also be used in a fire-rated roof/ceiling application, but only when constructed exactly as described.

^b STC and IIC values established by engineering analysis using the AWC Technical Report 15 (TR15) model, assuming minimum 3.5"-thick fiberglass insulation is used.

^c STC and IIC values for assemblies with a joist spacing of 16"o.c. may be used for assemblies with joist spacings between 16"o.c. and 24"o.c.

WIJ-2.1 Two-Hour Fire-Resistance-Rated Ceiling AssemblyFloor^a/Ceiling - 100% Design Load - 2 Hour Rating - ASTM E 119 / NFPA 251

1. **Floor Topping (optional, not shown):** Gypsum concrete, lightweight or normal concrete topping.
2. **Floor Sheathing:** Minimum 23/32-inch-thick tongue-and-groove wood sheathing (Exposure 1). Installed per code requirements.
3. **Insulation:** Minimum 3-1/2-inch-thick unfaced fiberglass insulation fitted between I-joists supported by stay wires spaced 12 inches on center.
4. **Structural Members:** Wood I-joists spaced a maximum of 24 inches on center. See ASTM D 5055 for qualification requirements. Additional requirements are as follows:

Minimum I-joist flange depth: 1-1/2 inches	Minimum I-joist flange area: 2.25 inches ²
Minimum I-joist web thickness: 3/8 inch	Minimum I-joist depth: 9-1/4 inches
5. **Furring Channels:** Minimum 0.0179-inch-thick galvanized steel hat-shaped furring channels, attached perpendicular to I-joists using 1⁵/₈-inch-long drywall screws. Furring channels spaced 16 inches on center (furring channels used to support the second and third layers of gypsum wallboard). Based on ASTM E2032, minimum 0.019-inch-thick galvanized steel resilient channels may be used in lieu of hat-shaped furring channels if installed at the same spacing and attached in the same manner. In order to achieve the sound ratings given below, resilient channels must be used in lieu of hat-shaped furring channels.
6. **Gypsum Wallboard:** Three layers of minimum 5/8 inch Type C gypsum wallboard as follows:
 - 6a. **Wallboard Base Layer:** Base layer of wallboard attached to bottom flange of I-joists using 1-5/8 inch Type S drywall screws at 12 inches on center with the long dimension of wallboard perpendicular to I-joist. End joints of wallboard centered on bottom flange of the I-joist and staggered from end joints in adjacent sheets.
 - 6b. **Wallboard Middle Layer:** Middle layer of wallboard attached to furring channels using 1 inch Type S drywall screws spaced 12 inches on center with the long dimension of wallboard perpendicular to furring channels. End joints staggered from end joints in adjacent sheets.
 - 6c. **Wallboard Face Layer:** Face layer of wallboard attached to furring channels through middle layer using 1-5/8 inch Type S drywall screws spaced 8 inches on center. Edge joints of face layer of wallboard offset 24 inches from those of middle layer. End joints of face layer of wallboard staggered with respect to the middle layer.
7. **Finish System (not shown):** Face layer joints covered with tape and coated with joint compound. Screw heads covered with joint compound.

Fire Test conducted at Gold Bond Building Products Research Center

December 16, 1992


Third Party Witness: PFS Corporation

Report No: #92-56

STC and IIC Sound Ratings (with Resilient Channels)

Joist /RC Spacing	Without Gypsum Concrete				With 1" Gypsum Concrete			
	Cushioned Vinyl		Carpet & Pad		Cushioned Vinyl		Carpet & Pad	
	STC	IIC	STC	IIC	STC	IIC	STC	IIC
24"o.c./16"o.c.	-	-	49 ^b	54 ^b	58	45	58	64

^a This assembly may also be used in a fire-rated roof/ceiling application, but only when constructed exactly as described.^b STC and IIC values established by engineering analysis performed by David L. Adams Associates, Inc.



American Wood Council
222 Catoctin Circle SE, Suite 201
Leesburg, VA 20175
www.awc.org
info@awc.org